



**NTI** NETWORK  
TECHNOLOGIES  
INCORPORATED

1275 Danner Dr Tel:330-562-7070  
Aurora, OH 44202 Fax:330-562-1999  
www.networktechinc.com

## ENVIROMUX® Series

# ENVIROMUX-2D

## Server Environment Monitoring System Installation and Operation Manual



Front View of ENVIROMUX-2D

---

**TRADEMARK**

ENVIROMUX is a registered trademark of Network Technologies Inc in the U.S. and other countries.

**COPYRIGHT**

Copyright © 2009, 2012 by Network Technologies Inc. All rights reserved. No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form or by any means, electronic, mechanical, photocopying, recording, or otherwise, without the prior written consent of Network Technologies Inc, 1275 Danner Drive, Aurora, Ohio 44202.

**CHANGES**

The material in this guide is for information only and is subject to change without notice. Network Technologies Inc reserves the right to make changes in the product design without reservation and without notification to its users.

**FIRMWARE VERSION**

Current firmware version 1.7

This product contains software licensed under the GNU Public License version 2 and other open source licenses. (<http://www.gnu.org/copyleft/gpl.html>)

You may obtain the complete open-source code free of charge from Network Technologies Inc (send email to [tech-consult@ntigo.com](mailto:tech-consult@ntigo.com)) for more information.

# TABLE OF CONTENTS

<b>Introduction</b> .....	<b>1</b>
<b>Supported Web Browsers</b> .....	<b>2</b>
<b>Materials</b> .....	<b>2</b>
<b>Connectors and LEDs</b> .....	<b>3</b>
<b>Installation</b> .....	<b>4</b>
Connect Sensors .....	4
Output Relay .....	6
Auxiliary Power .....	7
Ethernet Connection .....	7
USB Console Port.....	8
Installing Drivers .....	8
Using the USB Console Port .....	13
Connect the Power .....	14
Front Panel LEDs Indicate Status .....	14
Connect a Modem, Flash drive, or LCD Monitor .....	15
<b>Overview</b> .....	<b>16</b>
Administration .....	16
General Functions.....	16
Security .....	17
<b>Device Discovery Tool</b> .....	<b>18</b>
<b>Operation via Web Interface</b> .....	<b>19</b>
Log In and Enter Password .....	19
Monitoring .....	21
Configure Sensors .....	23
Digital Inputs .....	27
Configure Digital Inputs .....	28
Monitor IP Devices.....	29
Monitor Output Relay .....	31
Monitor IP Cameras .....	33
DC Power.....	34
Administration .....	35
System Configuration .....	35
Enterprise Configuration .....	38
Network Configuration .....	39
User Configuration .....	42
Security .....	46
System Information .....	48
Update Firmware .....	49
Reboot the System .....	50
Smart Alerts .....	51
Log .....	58
View Event Log .....	58

View Data Log.....	59
Log Settings.....	59
Support .....	61
Logout.....	61
<b>Operation via Text Menu- ENVIROMUX .....</b>	<b>62</b>
Connect to ENVIROMUX from a Terminal Program .....	62
Connect to ENVIROMUX from Command Line.....	63
Connect Via Telnet .....	63
Connect Via SSH.....	63
Using the Text Menu.....	65
Monitoring .....	65
System Configuration .....	80
Enterprise Configuration .....	82
Network Configuration .....	82
User Configuration.....	86
Security Configuration .....	90
Event and Data Logs .....	94
System Information.....	97
Reboot .....	97
Text Menu for Non-Administrative Users.....	98
Monitoring.....	98
User Accessible Settings .....	100
<b>Reset Button .....</b>	<b>104</b>
<b>Restore Defaults Button .....</b>	<b>104</b>
<b>USB Ports.....</b>	<b>104</b>
<b>How To Setup Email.....</b>	<b>105</b>
<b>Wiring Methods .....</b>	<b>107</b>
PC-to ENVIROMUX Crossover Cable.....	107
<b>Technical Specifications .....</b>	<b>108</b>
<b>Troubleshooting .....</b>	<b>109</b>
<b>Index .....</b>	<b>110</b>
<b>Warranty Information.....</b>	<b>111</b>

## TABLE OF FIGURES

Figure 1- Connect Sensors.....	4
Figure 2- Terminal block for dry-contact sensors.....	4
Figure 3- Secure liquid detection sensor with tape .....	5
Figure 4- Portion of Water Sensor configuration page.....	5
Figure 5- Output Relay Application Examples .....	6
Figure 6- Control multiple devices from relay.....	6
Figure 7- Use AUX PWR to supply 12VDC.....	7
Figure 8- Connect ENVIROMUX-2D to the Ethernet .....	7
Figure 9- Connect terminal to USB Console port.....	8
Figure 10- COM port assigned to ENVIROMUX .....	13
Figure 11- Configure COM port in HyperTerminal .....	13
Figure 12- Connect the AC adapter and power-up .....	14

Figure 13- LEDs on front of ENVIROMUX .....	14
Figure 14- Connect a USB device .....	15
Figure 15- Device Discovery Tool page .....	18
Figure 16- Login prompt to access web interface .....	19
Figure 17- Summary page .....	20
Figure 18- Summary page and the Monitoring menu.....	21
Figure 19- Status page for a temperature sensor .....	22
Figure 20- Sensor Configuration page .....	23
Figure 21- Sensor Configuration- exploded view of additional settings .....	24
Figure 22- Chart to setup alert notification .....	26
Figure 23- Digital Input Sensors Summary .....	27
Figure 24- Status of Digital Input #2 .....	27
Figure 25- Sensor Configuration for Digital Inputs .....	28
Figure 26- IP Devices listing-none monitored yet .....	29
Figure 27- Add New IP Device page.....	29
Figure 28- IP Device Configuration page.....	30
Figure 29- IP Device list with new devices added.....	31
Figure 30- IP Device Status page .....	31
Figure 31- Output Relay on Summary Page .....	31
Figure 32- Output Relay Status .....	32
Figure 33- Output Relay Contact State .....	32
Figure 34- Configure Output Relay .....	32
Figure 35- IP Camera Monitoring.....	33
Figure 36- Configure IP Cameras .....	33
Figure 37- Excerpt from the Summary Page showing DC Power monitoring.....	34
Figure 38- DC Power Alert Configuration.....	34
Figure 39- System Configuration page .....	35
Figure 40- Select language setting for menus .....	37
Figure 41- Select what will be displayed on connected USB LCD Monitor .....	37
Figure 42- Enterprise Configuration- Modem Status "Ready" .....	38
Figure 43- No Modem Installed.....	38
Figure 44- Network Configuration page .....	39
Figure 45- Network Configuration- more settings .....	40
Figure 46- Users page .....	42
Figure 47- Configure Users page.....	42
Figure 48- Configure User- more options.....	43
Figure 49-Summary page for User without Admin privileges .....	45
Figure 50- Security Configuration page .....	46
Figure 51- Security Configuration- IP Filtering Rules .....	47
Figure 52- System Information page.....	48
Figure 53- Update Firmware page .....	49
Figure 54- Reboot System page .....	50
Figure 55- System is rebooting .....	50
Figure 56- Events used for Smart Alerts.....	51
Figure 57- Sensor to be used for a predefined event.....	51
Figure 58- Configuration options for new event .....	52
Figure 59- Smart Alert summary page .....	53
Figure 60- Smart Alert configuration .....	54
Figure 61- Event Logical Function Diagram.....	56
Figure 62- Examples of Smart Alert conditions.....	57
Figure 63- Event Log page .....	58

Figure 64- Data Log page .....	59
Figure 65- Log Settings page.....	60
Figure 66- Support.....	61
Figure 67- Logout .....	61
Figure 68- Text Menu Login screen .....	62
Figure 69- Text Menu- Administrator Main Menu.....	63
Figure 70- Text Menu- User Main Menu .....	64
Figure 71- Text Menu-Monitoring Menu.....	65
Figure 72- Text Menu-Sensor Status.....	66
Figure 73- Text Menu- Digital Input Status .....	66
Figure 74- Text Menu-View IP Devices.....	67
Figure 75- Text Menu- View Output Relay Status.....	67
Figure 76- Text Menu-Configure Sensors list .....	68
Figure 77- Text Menu-Configuration Menu for Sensor.....	68
Figure 78- Text Menu-Sensor Settings .....	69
Figure 79- Text Menu-Non-Critical and Critical Alert Settings.....	70
Figure 80- Text Menu-Sensor Data Logging.....	71
Figure 81- Configure Digital Input Sensors .....	71
Figure 82- Digital Input Sensor Settings Menu .....	72
Figure 83- Digital Input Alert Settings .....	72
Figure 84- Data Logging for Digital Input Sensors .....	73
Figure 85- Text Menu-Configure IP Devices List .....	74
Figure 86- Text menu-Configuration Menu for IP Devices .....	74
Figure 87-Text Menu-IP Device Settings .....	75
Figure 88- Text Menu-IP Device Alert Settings.....	76
Figure 89- Text Menu-IP Device Data Logging.....	77
Figure 90- Text Menu- Select Configure Output Relay .....	77
Figure 91- Text Menu- Output Relay Settings.....	78
Figure 92- Text Menu- Output Relay Alert Settings .....	78
Figure 93- Text Menu- IP Camera List for Configuration .....	79
Figure 94- Text Menu- IP Camera Settings .....	79
Figure 95- Text Menu- System Configuration .....	80
Figure 96- Text Menu-Time Settings menu.....	80
Figure 97- Text Menu-Restore Default Settings.....	81
Figure 98- Text Menu-Enterprise Configuration.....	82
Figure 99- Text Menu-Network Configuration.....	82
Figure 100- Text Menu-IPv4 Settings Menu .....	83
Figure 101- Text Menu-IPv6 Settings Menu .....	83
Figure 102- Text Menu-SMTP Server Settings .....	84
Figure 103- Text Menu-SNMP Server Settings.....	84
Figure 104- Text Menu-Misc. Service Settings menu .....	85
Figure 105- Text Menu-User Configuration.....	86
Figure 106- Text Menu-Confirm to add new user .....	86
Figure 107- Text Menu-Configuration List for User.....	87
Figure 108- Text Menu-User Account Settings .....	87
Figure 109- Text Menu-User Contact Settings.....	88
Figure 110- Text Menu-User Activity Schedule.....	89
Figure 111-Text Menu- SNMP User Settings.....	89
Figure 112- Text Menu-Security Configuration .....	90
Figure 113- Text Menu-Authentication Settings.....	91
Figure 114- Text Menu-IP Filtering .....	92

---

Figure 115- Text Menu-Configure IP Filter rule.....	92
Figure 116- Text Menu-Event & Data Logs.....	94
Figure 117- Text Menu-View Event Log.....	94
Figure 118- Text Menu-View Data Log .....	95
Figure 119- Text Menu-Event Log Settings .....	96
Figure 120-Text Menu-Data Log Settings .....	96
Figure 121-Text Menu-System Information.....	97
Figure 122- Text Menu-Reboot the ENVIROMUX .....	97
Figure 123- Text Menu-User Main Menu .....	98
Figure 124-Text Menu-User Monitoring Menu .....	98
Figure 125- Text Menu-User accessible status menus .....	99
Figure 126- Text Menu-User Accessible Settings.....	100
Figure 127- Text Menu-User Account Settings .....	100
Figure 128- Text Menu-User Contact Settings.....	101
Figure 129- Text Menu-User Activity Schedule.....	102
Figure 130- Text Menu-User SNMP Settings.....	102
Figure 131- Location of Reset button.....	104
Figure 132- USB ports for Flash Drive, GSM modem, and/or LCD Monitor .....	104
Figure 149- Example of configuration for Gmail server.....	105
Figure 150- Configure user to receive alerts via email.....	106

## INTRODUCTION

The ENVIROMUX-2D (ENVIROMUX) is a Server Environment Monitoring System designed to monitor, from a remote location, the critical environmental conditions in cabinets and rooms containing servers, hubs, switches and other network components. Remote monitoring is provided via a 10/100BaseT Ethernet web interface, secure web interface, SSH, or Telnet. The input data is filtered, collected, analyzed and processed to allow the user to configure it to meet individual requirements. The user is able to specify parameters for all monitored signals. When a sensor reading goes out of range of a configurable threshold, the unit will signal an alert. Alert methods include email, SMS, SNMP traps (MIBs), web-page alerts, and a visual indicator (red LED).

The ENVIROMUX is capable of monitoring a maximum of 2 external sensors (available from NTI) and up to 5 additional contact-type sensors (often called open-collector, contact-closure, relay-style, normal-open, or normal-closed). ENVIROMUX includes 1 output relay to control a device such as a door lock, keypad, or circulation fan.

The external sensors sold by NTI will monitor temperature and humidity, monitor AC line voltage, frequency, and current, detect smoke, motion, vibration, glass breaking, a door opening, and detect the presence of water on a flat surface (such as the floor). The temperature and humidity sensors will provide current readings as well as alerts when thresholds are exceeded. The AC line monitor detects AC line input voltages between 50~250V AC, the Frequency (Hertz) between 47~63Hz, and the Power (Current) up to 12 amperes from a single AC line. The remainder of the sensors will simply provide alerts. These sensors can be manufactured by any third party, provided the alert notification method is compatible. Each of the aforementioned NTI sensors will connect to the ENVIROMUX via RJ45 connectors and CAT5 cable. The ENVIROMUX can also work with both 4-wire and 2-wire contact-style sensors (4-wire sensors require a power connection, 2-wire do not). Screw terminals are provided for the connection of external contact-style sensors.

### Features and Applications

- Monitor and manage server room environmental conditions over IP.
- Monitors and operates at temperatures from 32°F to 122°F (0°C and 50°C) and 20% to 90% relative humidity.
- Sensors supported:
  - 2 sensors connected via RJ45 connectors and CAT5 cable
  - 5 digital input devices
- Operates and configures via HTTP web page.
- 12VDC power connection for a connected device (up to 500mA maximum load)
- Up to 4 remote users can access the system simultaneously via Ethernet.
- Supports SMS alert messages via USB GSM modem
- Supports SMTP protocol
- Limited configuration via SNMP (v1, v2c, and/or v3), Telnet or RS232 interface
- Supports Microsoft Internet Explorer 6.0 and higher, Firefox 2.0 and higher, Chrome, Safari 4.0 or higher, and Opera 9.0
- Sensor alerts and log messages are sent using email, Syslog, and SNMP traps when any monitored environmental condition exceeds a user-specified range.
- Sensor alerts, end of alerts, and log-ins are posted in message log, which is accessible through web interface.
- SNMP trap messages can be imported into Microsoft Excel
- Use in data centers, co-lo sites, web hosting facilities, telecom switching sites, POP sites, server closets, or any unmanned area that needs to be monitored.
- Security: HTTPS, SSHv2, SSLv3, IP Filtering, LDAPv3, AES 256-bit encryption, 3DES, Blowfish, RSA, EDH-RSA, Arcfour, SNMPv3, IPV6, Sntp support, 16-character username/password authentication, user account restricted access rights.
- Monitor (ping) up to 16 IP network devices.
  - Configure the timeout and number of retries to classify a device as unresponsive.
  - Alerts are sent if devices are not responding.
- Monitored sensors and devices can be individually named (up to 63 characters).

- Monitor environmental conditions.
  - Supports two sensors, including: temperature, humidity, up to 5 dry contacts or water detection sensors.
  - When a sensor goes out of range of a configurable threshold, the system will notify you via email, syslog, LEDs, web page, and network management (SNMP).
- Operates on a Linux system.
- Firmware upgradeable "in-field" through Ethernet port.
- USB Console port for single-user serial control of the ENVIROMUX from a terminal.
- Supports USB flash drive for extended data logging capacity.
- Output relay for control of external device (contacts rated for up to 1A, 30VDC or 0.5A, 125VAC).
- Monitor up to 8 IP cameras.

### Options:

- The ENVIROMUX can be ordered with a DIN rail mounting bracket- Add "D" to the part number (i.e. ENVIROMUX-2D-D)
- The ENVIROMUX can be ordered with battery backup support and DC power monitoring installed, providing up to 2.3 hours of operation in the event of a power failure- to order, add "B" to the part number (i.e. ENVIROMUX-2DB)

## SUPPORTED WEB BROWSERS

Most modern web browsers should be supported. The following browsers have been tested:

- Microsoft Internet Explorer 6.0 or higher
- Mozilla FireFox 2.0 or higher
- Opera 9.0
- Google Chrome
- Safari 4.0 or higher for MAC and PC

## MATERIALS

### Materials supplied with this kit:


- NTI ENVIROMUX-2D Server Environment Monitoring System
- 1- 120VAC or 240VAC at 50 or 60Hz-9VDC/3A AC Adapter (PS4225)
- 1- Line cord- country specific
- 1- USB2-AB-2M-5T 2 meter USB 2.0 male type A-male type-B transparent cable (CB4306)
- CD containing a pdf of this manual, a SNMP MIB file, and the NTI Discovery Tool

### Additional materials may need to be ordered;

CAT5/5e/6 unshielded twisted-pair cable(s) terminated with RJ45 connectors wired straight thru- pin 1 to pin 1, etc. for Ethernet connection

Contact your nearest NTI distributor or NTI directly for all of your cable needs at 800-RGB-TECH (800-742-8324) in US & Canada or 330-562-7070 (Worldwide) or at our website at <http://www.networktechinc.com> and we will be happy to be of assistance.

## CONNECTORS AND LEDS

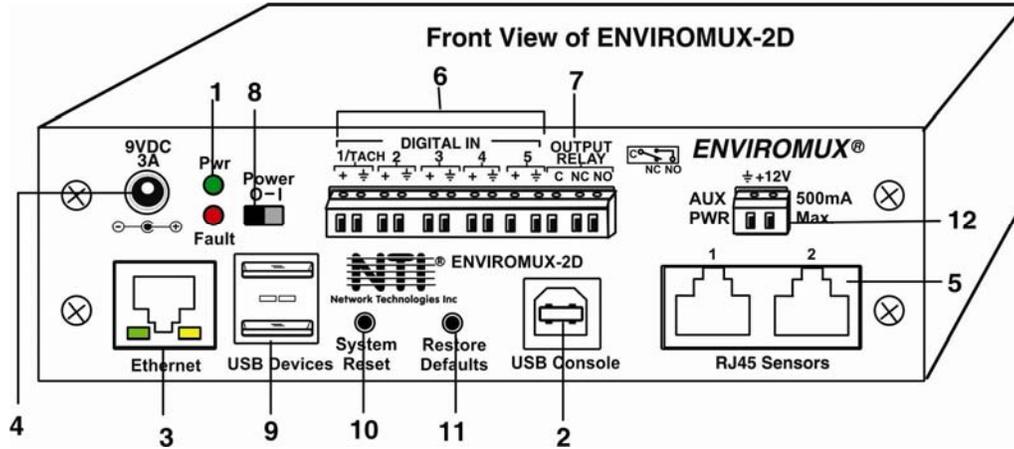

#	LABEL	CONNECTOR/LED	DESCRIPTION
1	Pwr	Green LED	green — indicates device is powered
	Fault	Red LED	red — illuminates if a sensor goes out of range of a configurable threshold
2	USB Console	USB Type B female connector	For connection of terminal for control through Text Menu
3	ETHERNET	RJ45 female connector	for connection to an Ethernet for remote multi-user control and monitoring <ul style="list-style-type: none"> <li>• Yellow LED- indicates 100Base-T activity when illuminated, 10Base-T activity when dark</li> <li>• Green LED – illuminated when Ethernet link is present, strobing indicates activity on the Ethernet port</li> </ul>
4	9V 3A	2.1x5.5mm Power Jack	for connection of power supply
5	RJ45 Sensors	RJ45 female connectors	for connection of optional RJ45 connected sensors (The left port is "#1", the right port is "#2" as listed in the Summary Page on Page 20.)
6	DIGITAL IN	Wire terminal block	For connecting dry-contact and liquid detection sensors
7	OUTPUT RELAY	Wire terminal block	For control of external devices (contacts rated up to 1A, 30VDC or 0.5A, 125VAC)
8	Power	Slide switch	For powering the ENVIROMUX On (I) and Off (O)
9	USB Devices	USB Type A female connectors	For connecting USB Flashdrive, USB Modem, and/or USB LCD Monitor
10	System Reset	Push button	For manually rebooting the ENVIROMUX without powering down-momentary press to activate
11	Restore Defaults	Push button	Press and hold for 5 seconds to reset the ENVIROMUX to factory default settings
12	AUX Pwr	Wire terminal block	For powering 12VDC device (max. load 500mA)

# INSTALLATION

## Connect Sensors

Connect the desired sensors (sold separately) to the available ports on the ENVIROMUX. Plug the RJ45 connectors to either of the two RJ45 ports marked "RJ45 Sensors". Mount the sensors according to their individual operating characteristics. Power-cycle the ENVIROMUX after sensors have been connected.

**Note: The maximum CAT5 cable length for attachment of temperature and humidity sensors in the ENVIROMUX-2D is 1000 feet.**

**Note: Mounting the temperature sensor in the path of a fan or on a heated surface may affect the accuracy of the sensor's readings.**

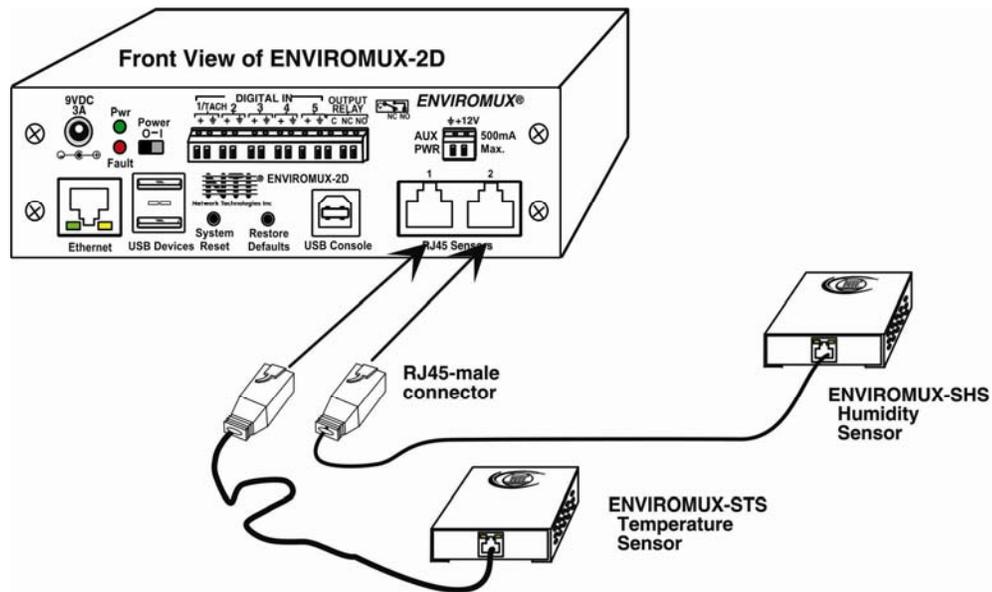


Figure 1- Connect Sensors

Up to five dry-contact sensors can also be connected. Sensors with 16-26 AWG connection wires, that operate on 5V at 10mA maximum current may be used. A contact resistance of 10kΩ or less will be interpreted by the ENVIROMUX as a closed contact. The maximum cable length for attachment of contact sensors is 1000 feet.

To install the dry-contact sensor(s) to "DIGITAL IN" terminals:

- A. Attach the positive lead to a terminal corresponding to a "+" marking on the ENVIROMUX and the ground lead to the next terminal to the right that will correspond to a  $\perp$  marking on the ENVIROMUX. Tighten the set screw above each contact. Terminal sets are numbered 1-5.

- B. Mount the sensors as desired.

**Example:**  
Device with potential-free break/make contact relay (i.e. door switch)

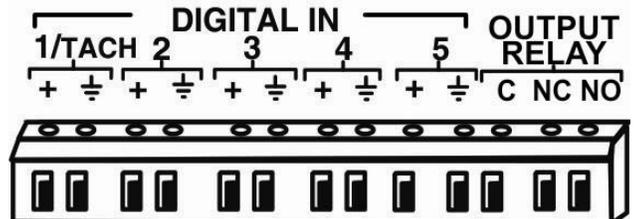



Figure 2- Terminal block for dry-contact sensors

**Note: The terminal block is removable for easy sensor wire attachment if needed.**

Optionally, connect the two-wire cable from a liquid detection sensor (ENVIROMUX-LD shown below- sold separately) to a set of "DIGITAL IN" contacts.

The twisted orange sensing cable should be placed flat on the surface (usually the floor) where liquid detection is desired. If tape is required to hold the sensor in place, be sure to only apply tape to the ends, exposing as much of the sensor as possible. At least 5/8" of the sensor must be exposed for it to function. (See Figure 3)

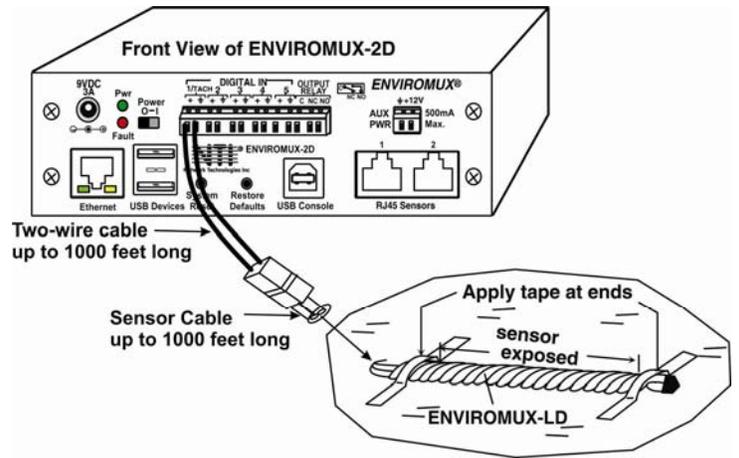


Figure 3- Secure liquid detection sensor with tape

**To test the ENVIROMUX-LD;**

1. Configure the sensor (page 28). (Normal Status set to "Open", Refresh Rate set to 5 seconds.)
2. Submerge at least ½ inch of the exposed twisted orange wire (not the wrapped end) for up to 30 seconds. Do NOT use distilled water as water must be conductive.
3. Monitor the sensor (page 21) to see the sensor "Value" change from "Open" (dry) to "Closed" (wet).
4. Dry the exposed area of sensor and the sensor "Value" should change back to "Open" within 30 seconds.

**Digital Input Configuration**

Sensor Settings	
Description	Water Sensor <small>Descriptive name for the sensor</small>
Group	1 <small>Select which group the sensor belongs to</small>
Normal Status	Open <small>Select the normal status for the sensor</small>
Refresh Rate	5 Sec <small>The refresh rate at which the digital input view is updated</small>

Figure 4- Portion of Water Sensor configuration page

**For added flexibility, install an ENVIROMUX-LDSx-Y (right) using CAT5 cable to a port labeled "RJ45 Sensors". With the ENVIROMUX-LDS you can use up to 1000 feet of CAT5 cable, 1000 feet of two-wire cable plus 1000 feet of sensor cable.**



## Output Relay

An output relay is provided to control an external device with a rating of up to 1A, 30VDC or 0.5A, 125VAC. Three terminals are provided to enable a normally-open connection (using the N.O. and C terminals) or a normally-closed connection (using the N.C. and C terminals). Using the web interface, this relay can be set to change state (close the normally-open connection, or open the normally-closed connection) either manually (page 31) or as a result of an alert state from one or more of the connected sensors (page 23). The terminals for these connections will accept 16-26AWG.

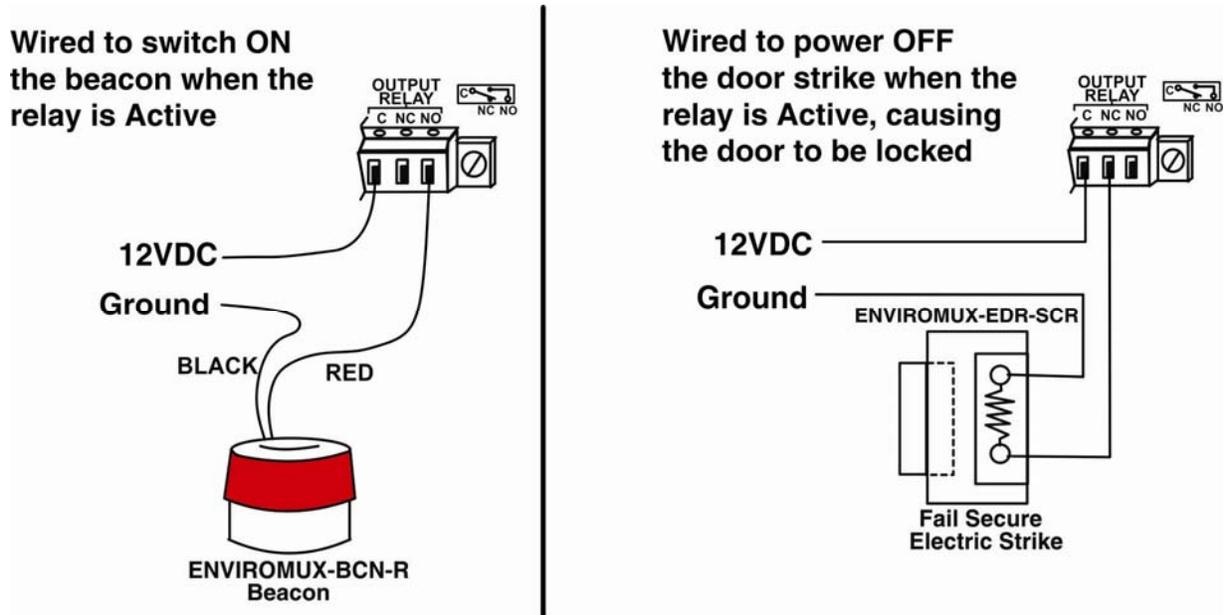


Figure 5- Output Relay Application Examples

Take note that the 12VDC required to make the Beacon work could be supplied by the “AUX PWR” terminals (next page). In fact, more than one device can be wired to activate at the same time when wired as indicated in Fig. 6. Once wired as illustrated below, configure any sensor to activate the output relay when an alert state is reached. Once activated, the output relay will switch power ON to the powered devices (siren and beacon in the illustration) until the alarm is acknowledged or dismissed by the user.

### Connections:

- Connect 12V wires of siren and beacon to “NO” (normally-open) terminal of the output relay.
- Connect ground wires of siren and beacon to ground terminal of “AUX PWR”.
- Apply a 18-22AWG jumper between the “12V” terminal of the “AUX PWR” and the “C” (common) terminal of the output relay.

**Note:** The maximum combined load that can be connected to the “AUX PWR” terminals is 500mA.

### Note: Design Change

The ENVIROMUX-SEMS-2D (the predecessor of the ENVIROMUX-2D) had an Output Relay with a different wiring order. Please be aware of the change.

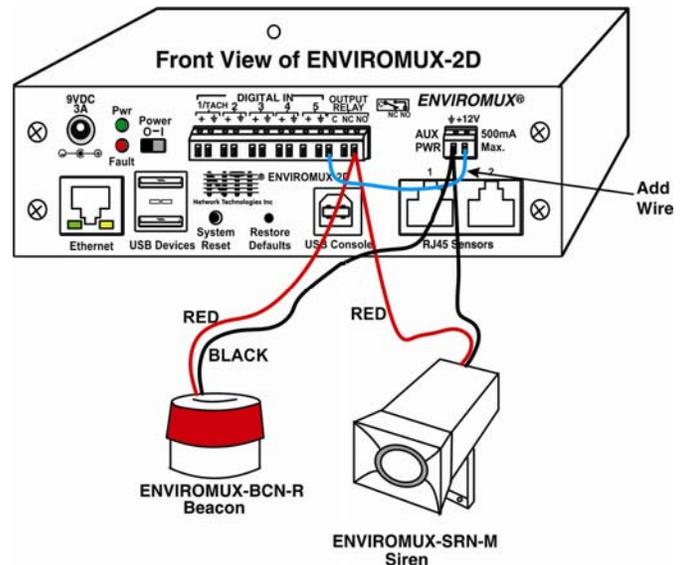


Figure 6- Control multiple devices from relay

## Auxiliary Power

If a dry contact device connected to the "DIGITAL IN" terminals requires 12VDC in order to operate, the "AUX PWR" terminals may be used provided the device does not require more the 500mA to operate. Power from the "AUX PWR" terminals is continuous and not interruptible through the ENVIROMUX firmware.

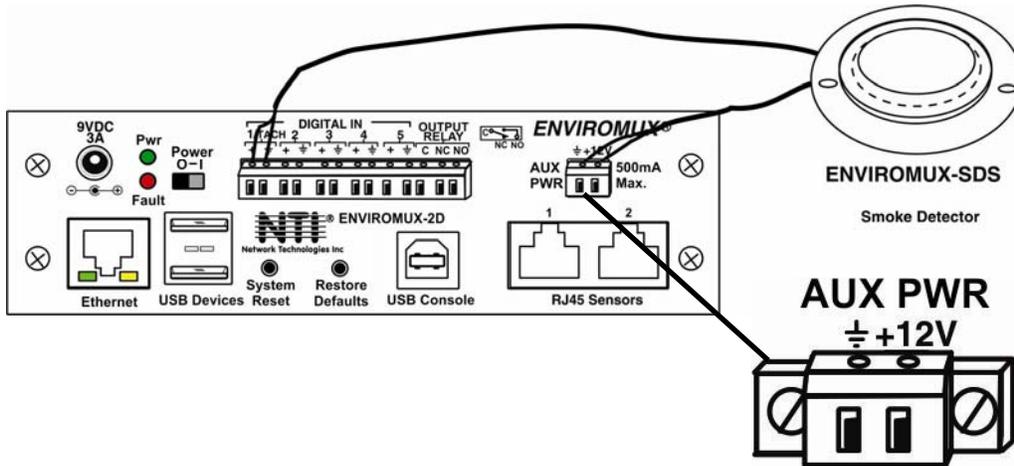


Figure 7- Use AUX PWR to supply 12VDC

## Ethernet Connection

Connect a CAT5 patch cable (RJ45 connectors on each end wired pin 1 to pin 1, pin 2 to pin 2 etc) from the local Ethernet network connection to the connector on the ENVIROMUX marked "Ethernet".

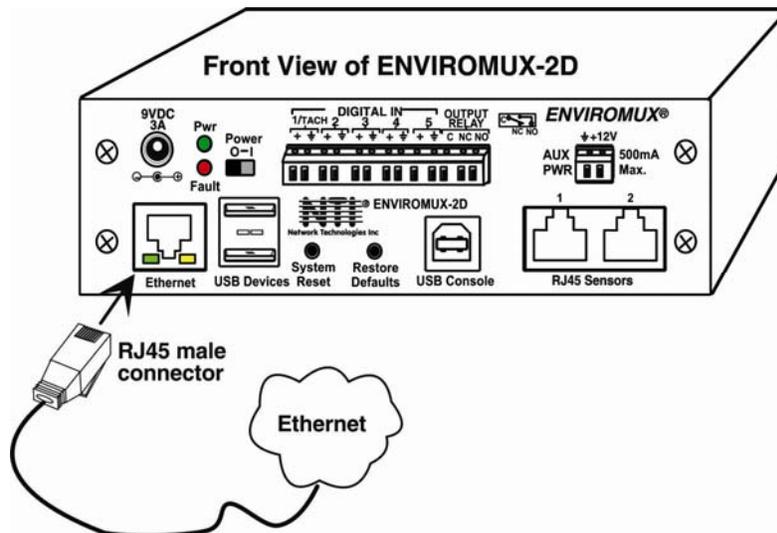


Figure 8- Connect ENVIROMUX-2D to the Ethernet

**Note:** A direct Ethernet connection can be made with a PC using a crossover cable. For the pinout of this cable, see page 107.

## USB Console Port

Your ENVIROMUX includes a USB Type B connector labeled “USB Console”. If you connect a USB cable between the ENVIROMUX and your PC you will be able to control your ENVIROMUX serially from a terminal console using this connection.

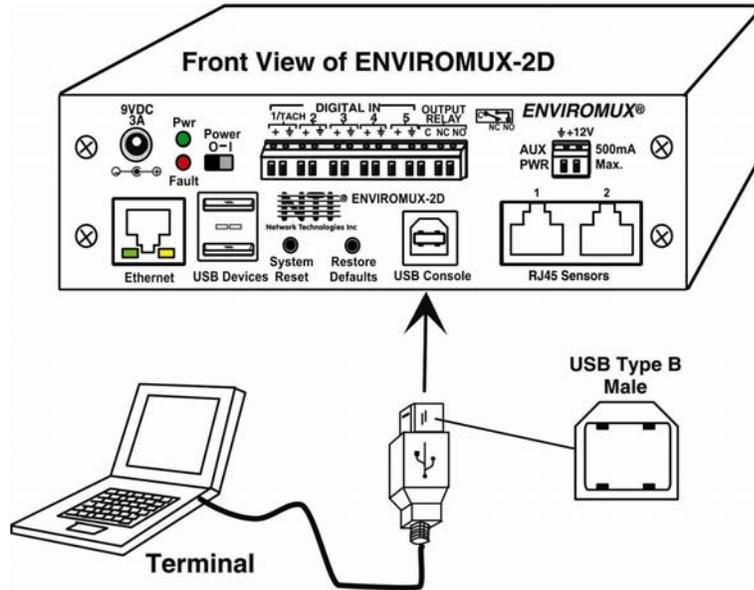


Figure 9- Connect terminal to USB Console port

## Installing Drivers

You will only need to install drivers the first time the ENVIROMUX is connected to your PC. After the first time, when the ENVIROMUX is connected, your PC should recognize the ENVIROMUX and re-assign the COM port. Follow the steps below to install the drivers.

1. Make sure the USB cable is connected between the ENVIROMUX and your PC.
2. Power ON the ENVIROMUX. The PC will see the ENVIROMUX as “New Hardware” and create a virtual COM port to communicate with it.
3. You will be prompted to load drivers. A driver file compatible with Windows XP, 2000, Vista and 7 (32 and 64 bit versions) can be found on the CD that came with your ENVIROMUX. Browse to the drive your Product Manual CD is in and locate and select the file named “**enviromux.inf**” in a directory named “**windows-drivers\32bit** or “**\64bit**” depending upon your operating system.


The .inf file will direct your PC to locate and install the file **usbser.sys** (already on your PC, comes with Windows). Installing the **usbser.sys** file should happen automatically. When finished, Windows will indicate installation is successful.

## Windows XP-32 bit Installation


Your typical installation will include windows like the ones that follow. The images below are from a Windows XP SP2 32 bit installation.




A. Windows will want to check the internet for drivers. Choose **“No, not this time”** because the drivers are unique to the ENVIROMUX.

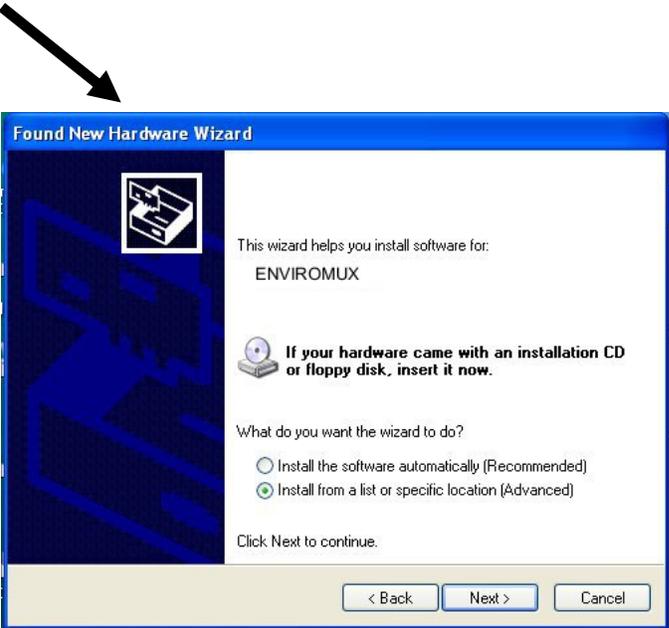

B. You can try to **“Install the software automatically”** but if windows doesn't check the CD, you will need to use **“Install from a list or specific location”** instead.

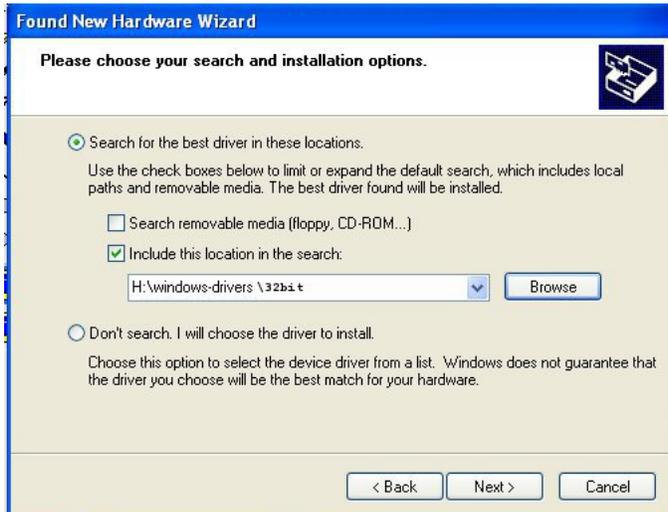

C. Let the New Hardware Wizard search for the driver, but direct it to the drive the Product Manual CD is in and the directory of either the 32 bit driver or the 64 bit driver.




D. Once the driver is installed, you will get this screen and the ENVIROMUX USB Console Port will be ready to use.

## Windows 7-64 bit Installation

A Windows 7 64 bit installation has a few extra steps. The images below are from a Windows 7, 64-bit installation.




A. Upon ENVIROMUX power ON, the driver cannot be found. Press **“Close”**.

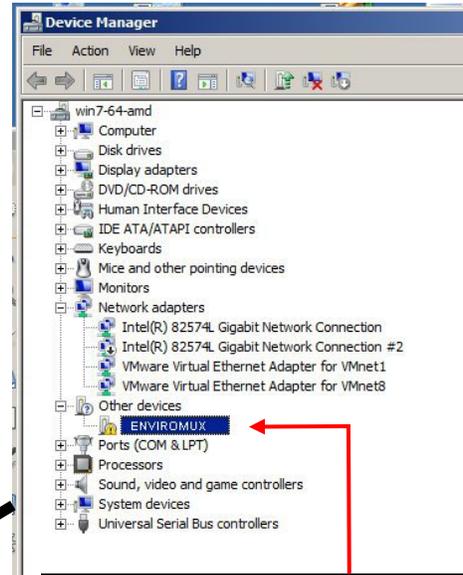


B. Open the Device Manger and select the ENVIROMUX in the device list. Right-click and open **“Properties”**. Select **“Update Driver Software”**.


**Tip: The Device Manager can be opened by right-clicking on “My Computer” on the desktop, selecting “Properties”, and selecting “Device Manager”.**

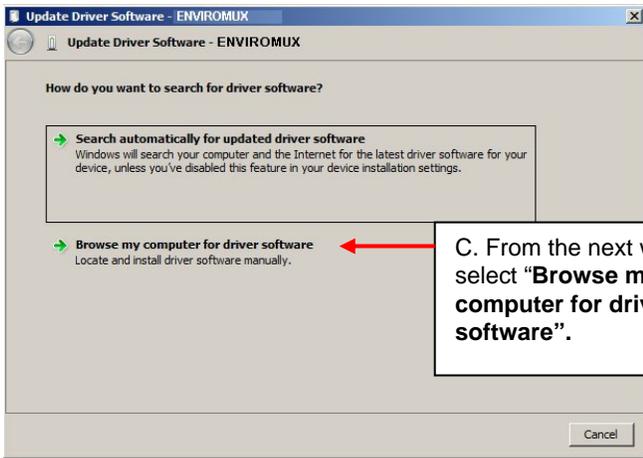


C. From the next window, select **“Browse my computer for driver software”**.

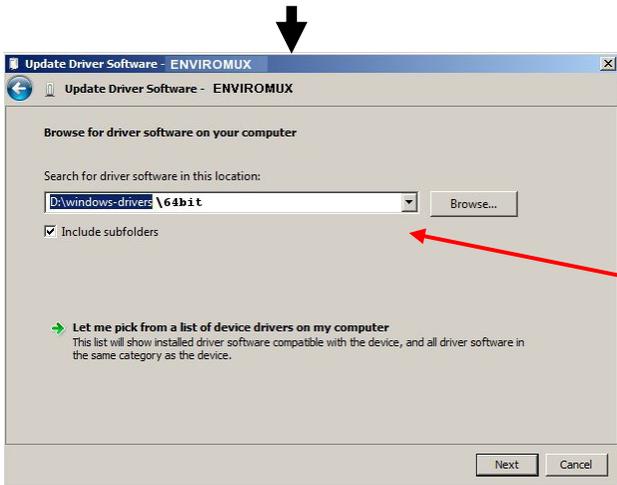

D. In the next window, enter the path to the .inf driver file (on the Product Manual CD). Press **“Next”**.

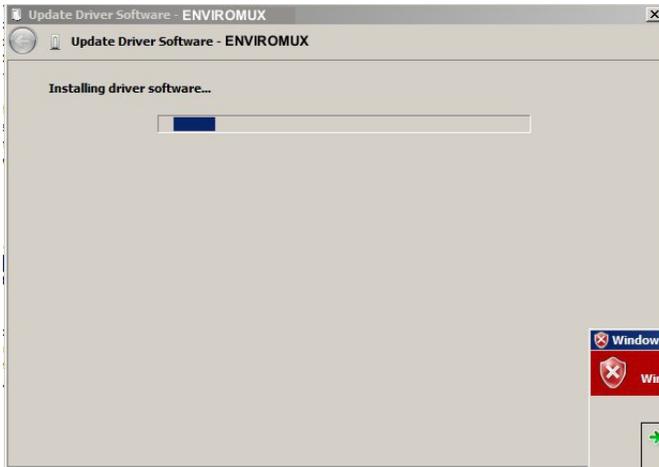

E. You will probably get this warning that Windows can't verify the publisher of the driver software. Select **"Install this driver software anyway."**

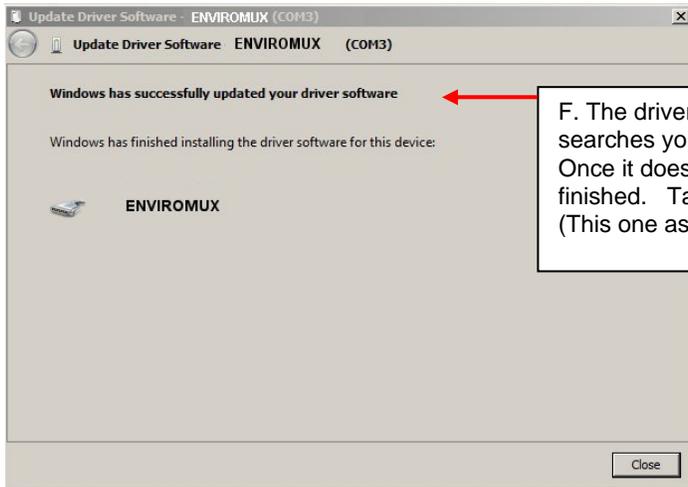

F. The driver will load. This might take a minute while it searches your computer for the `usbser.sys` file it needs. Once it does, you will get a window telling you Windows is finished. Take note of the COM port number it assigned. (This one assigned COM3.)

4. During the installation, your PC will assign a COM port number to the USB port attached to the ENVIROMUX. You will need to identify the COM port number assigned. This information can be viewed in your Device Manager list (below) if you didn't take note of it during installation.

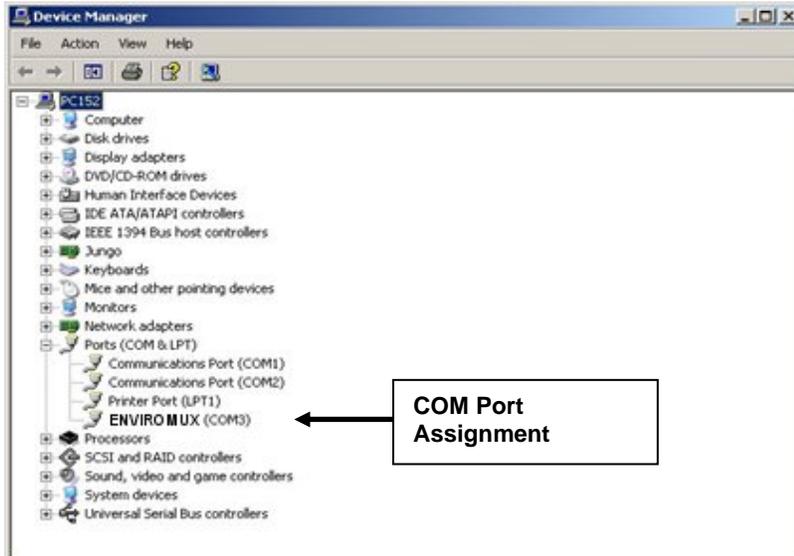


Figure 10- COM port assigned to ENVIROMUX

### Using the USB Console Port

The virtual COM port will be used to enable serial control over the ENVIROMUX (see Operation Via Text Menu on page 62). When you open a terminal program be sure to use the correct COM port (see Figure 10 and Figure 11 ).



Figure 11- Configure COM port in HyperTerminal

## Connect the Power

**Note: Sensors should be connected before supplying power to the ENVIROMUX.**

1. Connect the AC adapter to the connection marked "PWR" on the ENVIROMUX and plug it into an outlet.

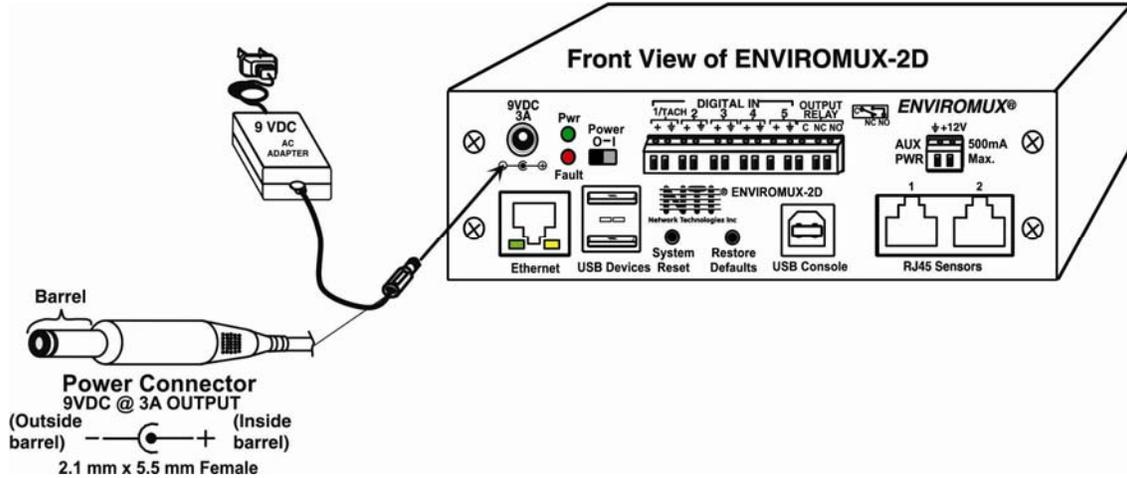


Figure 12- Connect the AC adapter and power-up

2. Use the NTI Discovery Tool (page 18) to configure network settings.

## Front Panel LEDs Indicate Status

With proper connections made, the ENVIROMUX is now ready to power ON. With the power cord attached and plugged into an AC outlet, the "Power" green LED should be illuminated on the front of the ENVIROMUX. The red "Fault" LED will illuminate when power is first applied and while the ENVIROMUX boots up (for up to 60 seconds). Once the red LED goes OFF, the ENVIROMUX is ready for use. After a completed boot-up, the red LED will only illuminate when one of the connected sensors is in alert.

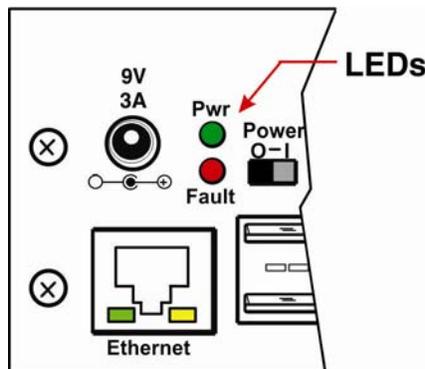


Figure 13- LEDs on front of ENVIROMUX

## Connect a Modem, Flash drive, or LCD Monitor

A USB GSM modem may be connected (ENVIROMUX-3GU) to use to send SMS alert messages to a contact's cell phone. The ENVIROMUX-3GU modem will connect to the ENVIROMUX at the "USB Devices" port (either USB Type A connector, it doesn't matter which one). The remaining USB Type A connector on the ENVIROMUX is available for the connection of a USB Flash Drive for data logging (page 60) or an ENVIROMUX-LCD7U USB LCD monitor (page 37).

When a USB GSM Modem is connected, the phone number to be called for each user is configured under "User Configuration-Contact Settings" (page 44).

**Note: A Mini SIM card (not included) must be installed in the modem for the modem to send messages.**

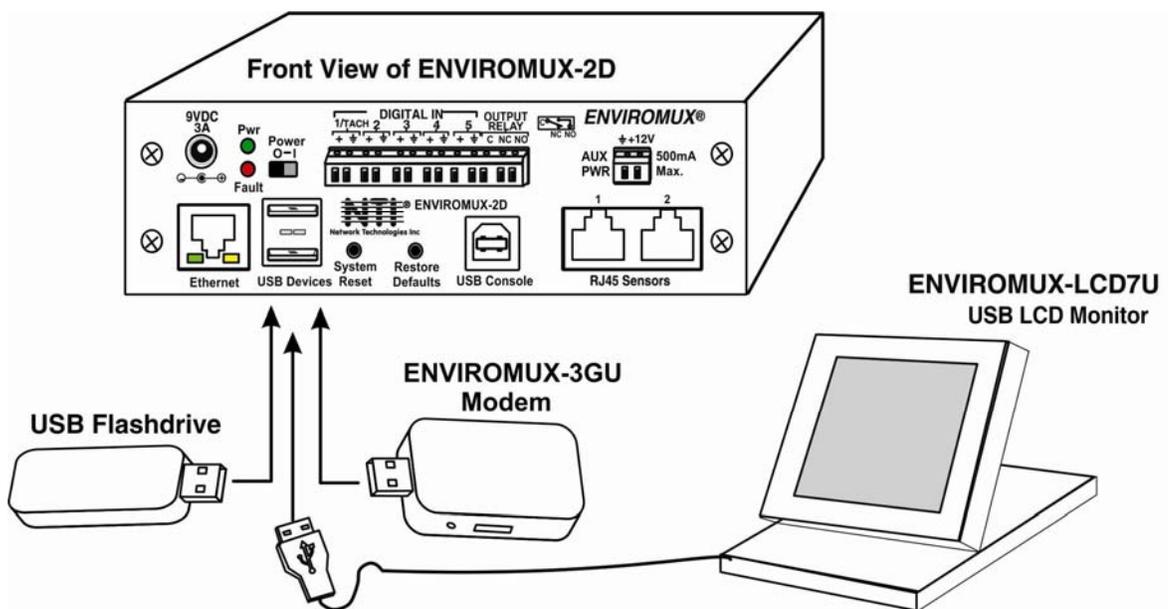


Figure 14- Connect a USB device

### Cell phone Mini SIM card for GSM modem

A SIM card or *Subscriber Identity Module* is a portable memory chip used in some models of cellular telephones. It can be thought of as a mini hard disk that automatically activates the phone (or in this case the GSM modem) into which it is inserted.

SIM cards are available in two standard sizes. The first is the size of a credit card (85.60 mm x 53.98 mm x 0.76 mm). The newer, more popular miniature-version has a width of 25 mm, a height of 15 mm, and a thickness of 0.76 mm.

Some cellular service providers use Mini SIM cards. Verify with your service provider that their Mini SIM card will work with GSM / 3G GSM modems before making a purchase.

**Note: Make sure the SIM card is for GSM communication (not CDMA) and that it is not locked (some SIM cards are "locked" to search for a specific IMEI number of the phone to operate).**

**Note: The ENVIROMUX-3GU will send SMS messages only. No access to the ENVIROMUX is possible through the modem.**

## OVERVIEW

### Administration

The ENVIROMUX can be administered in any one of the following ways:

- Using Telnet or SSH protocol via the Ethernet Port.
- Using a terminal program via the USB Console Port
- Using the web interface (HTTP/HTTPS protocol) via the Ethernet Port.

The following administrative controls are available in the ENVIROMUX, thru the menu.

- View or modify the administrator & user parameters (passwords, sensor alert subscriptions, admin access, etc.)
- View or modify the network parameters (e.g. IP Address, Gateways, DNS, etc.)
- View and clear system event logs
- Clear, import, export and restore configuration parameters
- Firmware upgrades for the ENVIROMUX (over Ethernet)
- View or modify sensor, and IP device configurations

### General Functions

#### **Sensor Alerts**

A high and low threshold limit can be set for each temperature or humidity sensor. When a sensor takes a reading that is outside a threshold, an alert notification is generated. The user can specify the frequency of alert notifications to match his or her schedule. Also, there will be some hysteresis involved with alert notifications. This means if a sensor's readings are moving in and out of the threshold boundaries within a configurable period of time, additional alert notifications will not be sent. After an alert is activated, it remains persistent even if the condition of the sensors returns back to normal, until the user acknowledges or dismisses that alert. The user has the option to set the unit to auto-clear the alert if the sensor's status returns to normal, and the user can be notified if the condition goes back to normal. Alert notifications will be provided through four main methods: visible notification via one of the user interfaces (red "Fault" LED on front panel, alert on webpage, alert in text menu), emails, syslog message and/or SNMP traps.

#### **Smart Alerts**

Sensor conditions (events) can be configured to trigger alerts by themselves, and/or be used in combination with other events to trigger Smart Alerts. Up to 50 events can be configured and up to 20 Smart Alerts can be configured to use different event combinations to send alert messages.

#### **IP Monitoring & Alerts**

Individual IP addresses can be monitored. The ENVIROMUX will ping each address, and if a response is received, the IP address status is considered to be "OK". If no response, the user will have the option to configure the ENVIROMUX for an alert will be logged and sent. The user can configure the timeout for a response and the number of retries before signaling an alert. The ENVIROMUX can also be configured to monitor the IP addresses of the network switches and routers to which these devices are connected, so as to determine if the problem is due to a lack of response from the device or a network failure. Alert notifications will be provided through four main methods: visible notification via one of the user interfaces (red "Fault" LED on front panel, alert on webpage, alert in text menu), emails, syslog messages, SMS messages and/or SNMP traps.

#### **Event Log**

The ENVIROMUX maintains an event log. The event log includes power-ON, system, and alert notifications, as well as user login/logout, and user alert handling. The maximum number of log entries is 1000, and these entries are sorted in chronological order. The log can be viewed at any time through the web interface or text menu, and can be saved as a text file. Log entries can be removed individually or all at once.

#### **Data Log**

The ENVIROMUX maintains a data log. The data log includes readings taken from sensors, IP devices, and connected accessories being monitored. The maximum number of log entries is 1000, and these entries are sorted in chronological order. The log can be viewed at any time through the web interface or text menu, and can be saved as a text file. Log entries can be removed individually or all at once.

### Email

The ENVIROMUX can access an SMTP server to send outgoing email. Outgoing email would contain pre-formatted alert notifications. SMTP server information can be configured using one of the interfaces. Email addresses can be configured through web pages or text menu. Each user (up to 15) can have their own email address.

The email messages sent by the ENVIROMUX have a fixed format. Alert emails contain 6 fields and will have a configurable title. The title is configurable for each sensor, device, or IP address. The title is the "email subject" in all configuration pages. A sample message is shown below:

```
ENTERPRISE: Enterprise name here
LOCATION: Danner Drive
CONTACT: John Smith
DESCRIPTION: Undefined #5
TYPE: Humidity
MESSAGE: Sensor value exceeded thresholds
```

### SNMP

The ENVIROMUX can send alerts as SNMP traps when a sensor or IP device enters/leaves alert mode and for all log events. Using an SNMP MIB browser, a user can monitor all sensor statuses and system IP settings.

The destination for SNMP traps can be configured for each user.

**Note:** The SNMP MIB file (*mini-lx-v1-xx.mib*), for use with an SNMP MIB browser or SNMP trap receiver, can be found on the manual CD. Click on the link to open the file, then save the file to your hard drive to use with the SNMP MIB browser or SNMP trap receiver.

### GSM Modem

An external GSM modem can be connected to allow the system to send alert notifications via SMS messages. When a sensor crosses a threshold or IP device become inactive, an alert notification can be formatted to SMS message (see page 25) and the modem can transmit the message to all users that subscribe to the applicable sensor group.

## Security

### User Settings

In order to configure and operate the ENVIROMUX, each user must login with a unique username and password. The Administrator can configure each user's settings as User or Administrator. An Administrator has access to all configurations and controls. A user can monitor sensors, accessories, and IP devices. A user can edit his/her own account. Users cannot configure the sensor settings.

### IP Filtering

The ENVIROMUX allows the administrator to block access to the device from certain IP addresses. The ENVIROMUX can accept or drop requests based on the IP filter settings. IP Filtering provides an additional mechanism for securing the ENVIROMUX. Access to the ENVIROMUX network services (SNMP, HTTP(S), SSH, Telnet) can be controlled by allowing or disallowing connections from various IP addresses, subnets, or networks.

### Secure Connections

The ENVIROMUX supports secure connections using SSHv2 and HTTPS.

### Authentications

The ENVIROMUX supports local authentication with up to 16 character usernames and passwords, and it also supports LDAPv3.

### Encryption

The ENVIROMUX supports 256-bit AES encryption.

## DEVICE DISCOVERY TOOL

In order to easily locate the ENVIROMUX on a network, the NTI Device Discovery Tool may be used. A link to the Discovery Tool is provided on the web page that appears when you insert the instruction manual CD provided into your CD ROM drive. Click on the link or browse the CD and click on the file *discover.html*. This will open your browser and display the Device Discovery Tool page.

**Note:** The Device Discovery Tool requires the Java Runtime Environment to operate. A link to the web page from which it can be downloaded and installed is provided on the CD.

**Note:** The computer using the Device Discovery Tool and the ENVIROMUX must be connected to the same physical network in order for the Device Discovery Tool to work.

### Network Technologies Inc Device Discovery Tool

- **START**
  - When you load this page, the NTI Device Discovery Applet should load. Accept the Certificate to allow this applet access to your network. Press the button entitled **Detect NTI Devices** to start the discovery process. After a short time, the tool will display all NTI devices on your network, along with their network settings.


**Note:** Do not close this page while the NTI Discovery Tool is running. Close the NTI Device Discovery Application first, **then** this webpage.
- **How To Use the Discovery Tool**
  - **To Change A Device's Settings**, within the row of the device whose setting you wish to change, type in a new setting and press the **Enter** key or the **Submit** button on that row. You can also press the **Submit All** button to submit all changes at once.
  - **To Refresh the list of devices**, press the **Refresh** button.
  - **To Blink the LEDs of the unit**, press the **Blink LED** button (This feature not supported on all products). The **Blink LED** button will change to a **Blinking...** button. The LEDs of the unit will blink until the **Blinking...** button is pressed, or the NTI Device Discovery Application is closed. The LEDs will automatically cease blinking after 2 hours.
  - **To Stop the LEDs of the unit blinking**, press the **Blinking...** button. The **Blinking...** button will change to a **Blink LED** button.

Detect NTI Devices

0%

**Figure 15- Device Discovery Tool page**

Use the Device Discovery Tool to display all NTI ENVIROMUX units on the network, along with their network settings. Follow the instructions on the Device Discovery Tool page to use the tool and to change the device settings if so desired.

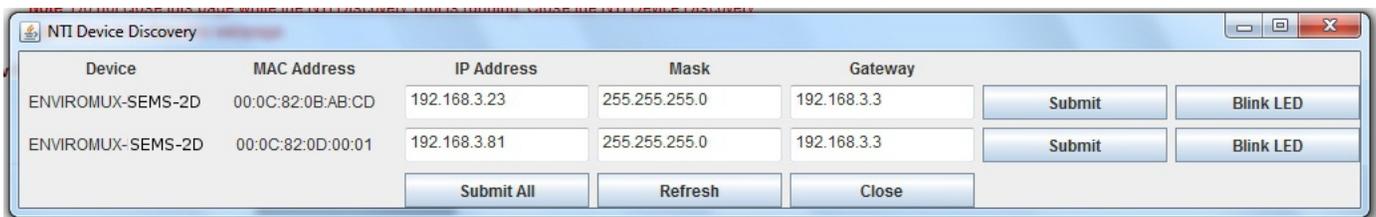

## OPERATION VIA WEB INTERFACE

A user may monitor and configure the settings of the ENVIROMUX and any sensor connected to it using the Web Interface via any web browser (see page 2 for supported web browsers). To access the Web Interface, connect the ENVIROMUX to the Ethernet (page 7). Use the Device Discovery Tool (page 18) to setup the network settings. Then, to access the web interface controls, the user must log in.

### Log In and Enter Password

To access the web interface, type the current IP address into the address bar of the web browser. (The default IP address is shown below):

**Note:** If “Allow HTTP Access” (page 39) is not checked to be enabled (disabled by default), only an SSL-encrypted connection will be possible. The software will automatically redirect to an HTTPS (secure) connection. The user will likely see a warning about the SSL certificate and a prompt to accept the certificate. The ENVIROMUX uses a self-signed NTI certificate. Accept the NTI certificate.

A log in prompt requiring a username and password will appear:

The screenshot displays the web interface for the ENVIROMUX-SEMS-2DB. At the top left is the NTI Network Technologies Incorporated logo. At the top right, system information is shown: Unit: E-SEMS-2DB Unit 2, Model: ENVIROMUX-SEMS-2DB, Uptime: 1 day, 22 hours, 08 mins, and Current Time: 03-30-2012 12:08:24 PM. Below the header, there are navigation links for Home and Login. A 'Support' button is visible on the left. The main content area is titled 'ENVIROMUX-SEMS-2DB' and contains a login form. The form has a section titled 'Enter login credentials' with two input fields: 'Username' (containing 'root') and 'Password' (masked with dots). Below the fields is a 'Login' button. At the bottom of the page, there is a copyright notice: © 2012 Network Technologies Inc. All rights reserved. and a 'WEB SERVER' logo.

Figure 16- Login prompt to access web interface

**Username = root**

**Password = nti**

(lower case letters only)

**Note:** usernames and passwords are case sensitive

With a successful log in, the “Summary” page with a menu at left will appear on the screen:

Home > Summary

**Monitoring**

- Summary
- Sensors
- Digital Inputs
- IP Devices
- Output Relays
- IP Cameras

**Administration**

**Smart Alerts**

**Log**

**Support**

**Logout**

### Summary

**Sensors**

Conn.	Description	Type	Value	Status	Action
1	<a href="#">Temperature 1</a>	Temperature Combo	25.7°C	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
1	<a href="#">Humidity 1</a>	Humidity Combo	34%	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Temperature 2</a>	Temperature Combo	24.5°C	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Humidity 2</a>	Humidity Combo	35%	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

**Digital Inputs**

Conn.	Description	Type	Value	Status	Action
1	<a href="#">Digital Input #1</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
2	<a href="#">Digital Input #2</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
3	<a href="#">Digital Input #3</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
4	<a href="#">Digital Input #4</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
5	<a href="#">Digital Input #5</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>

**IP Devices**

Num.	Description	Type	Value	Status	Action
1	<a href="#">CPU53</a>	IP Device	Responding	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

**Output Relays**

Conn.	Description	Type	Value	Status	Action
1	<a href="#">Output Relay #1</a>	Output Relay	Inactive		<a href="#">View</a> <a href="#">Edit</a>

**DC Power**

Num.	Type	Status	Action
1	DC Power	Normal	<a href="#">Edit</a>

**Smart Alerts**

No.	Smart Alert Description	Status	Action
1	<a href="#">Smart Alert #1</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
2	<a href="#">Smart Alert #2</a>	Triggered	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
3	<a href="#">Smart Alert #3</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
4	<a href="#">Smart Alert #4</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
5	<a href="#">Smart Alert #5</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
6	<a href="#">Smart Alert #6</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
7	<a href="#">Smart Alert #7</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>

[Add New Smart Alert](#)

Figure 17- Summary page

From this initial page, the user can use the menu to the left to manage all the functions of the ENVIROMUX.

Function	Description
MONITORING	Monitor the sensors, accessories, and IP devices of the ENVIROMUX (next page)
ADMINISTRATION	Configure all system, network, multi-user access, and security settings as well as upgrade firmware (page 35)
SMART ALERTS	View and configure the Events used for Smart Alerts and the Smart Alerts themselves (page 51)
LOG	View and configure the Event and Data Logs (page 58)
SUPPORT	Links for downloading a manual, the MIB file, or firmware upgrades
LOGOUT	Log the user out of the ENVIROMUX web interface

## Monitoring

Under Monitoring, there are links to view the status of all sensors and IP Devices being monitored by the ENVIROMUX.

Link	Description
Summary	Lists all items being monitored, including their description, type, value, and status
Sensors	Provides a link to view the status of only the Sensors and a link to add them (page 23)
Digital Inputs	Provides a link to view the status of any sensors connected to the CONTACT terminals (1-5) a link to view or edit their configuration (page 23)
IP Devices	Provides a link to view the status of only the IP Devices and a link to add them (page 29)
Output Relay	Provides a link to view the status of the output relay and a link to edit the configuration (page 31)
IP Cameras	Displays an image from up to 8 webcams with links to connect to each (page 33)
DC Power	Provides status of the external DC power supply (page 34) (only applicable on models with battery-backup feature)
Smart Alerts	Displays the status of each Smart Alert configuration (page 51) and provided link to respond when triggered

### Summary

Sensors					
Conn.	Description	Type	Value	Status	Action
1	<a href="#">Temperature 1</a>	Temperature Combo	23.8°C	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
1	<a href="#">Humidity 1</a>	Humidity Combo	36%	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Temperature 2</a>	Temperature Combo	24.3°C	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Humidity 2</a>	Humidity Combo	37%	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

Digital Inputs					
Conn.	Description	Type	Value	Status	Action
1	<a href="#">Digital Input #1</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
2	<a href="#">Digital Input #2</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
3	<a href="#">Digital Input #3</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
4	<a href="#">Digital Input #4</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
5	<a href="#">Digital Input #5</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>

IP Devices					
Num.	Description	Type	Value	Status	Action
1	<a href="#">CPU53</a>	IP Device	Responding	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

Output Relays					
Conn.	Description	Type	Value	Status	Action
1	<a href="#">Output Relay #1</a>	Output Relay	Inactive		<a href="#">View</a> <a href="#">Edit</a>

DC Power					
Num.	Type			Status	Action
1	DC Power			Normal	<a href="#">Edit</a>

Smart Alerts					
No.	Smart Alert Description			Status	Action
1	<a href="#">Smart Alert #1</a>			Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
2	<a href="#">Smart Alert #2</a>			Triggered	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
3	<a href="#">Smart Alert #3</a>			Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
4	<a href="#">Smart Alert #4</a>			Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
5	<a href="#">Smart Alert #5</a>			Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
6	<a href="#">Smart Alert #6</a>			Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
7	<a href="#">Smart Alert #7</a>			Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>

[Add New Smart Alert](#)

Figure 18- Summary page and the Monitoring menu

From the Summary page, the user can view the status of all sensors and the IP Devices being monitored by the ENVIROMUX. Each item listed has a link that when selected will open the status page for that item.

Undefined #1 Status

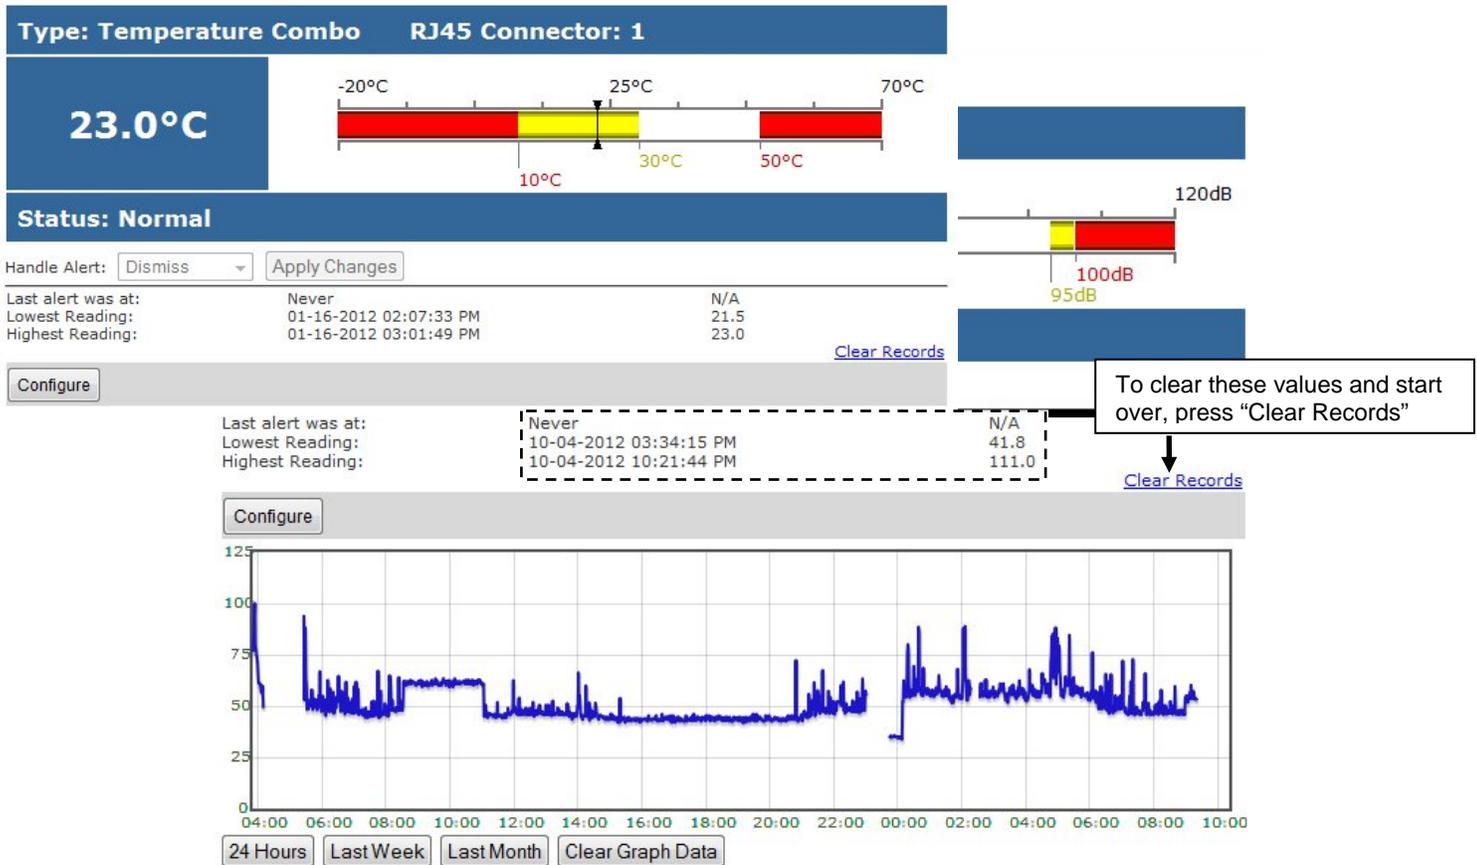


Figure 19- Status page for a temperature sensor with data graph

If the temperature sensor is in alert status, the user has the option to either **acknowledge** the alert or **dismiss** it. If the user acknowledges the alert, no additional alert messages will be sent during that alert status cycle. If the user dismisses the alert, another alert message will be sent once the “notify again after” time designated on the configuration page (page 24) elapses.

After selecting **acknowledge** or **dismiss**, click **Apply Changes**.

The administrative user can open the sensor configuration page by clicking on the **Configure** button at the bottom of the sensor status page (above) or by clicking on **Edit** from the Summary page. From the sensor configuration page the user can apply settings to control how or if alert messages are sent in the event the sensor is in alert status, threshold settings, and data logging settings.

**Sensor Data Graph**

The data graph is only displayed for sensors connected to “RJ45 Sensors”. (Once the status page is opened, allow several seconds for the graph data to be displayed.) The ENVIROMUX records readings taken from the sensor. The graph provides a record of the readings taken over a period of time. The “24 Hours” view provides readings in 1 minute increments. The “Last Week” view displays readings in 15 minute increments. The “Last Month” view displays readings in 30 minute increments.

To zoom in on a particular time period, place your cursor over the desired data record and use the scroll wheel to adjust your view. (You will notice that the graph lines get closer or further apart as you do this.)

To clear the recorded readings (data), click on “Clear Graph Data”. This should be done if the sensor is removed and another installed on the port, as the data will not be cleared unless it is done manually.

Data older than the selected time period will automatically be cleared to make room for new data.

## Configure Sensors

The Sensor Configuration page is broken into three sections; Sensor Settings, Alert Settings and Data Logging. To explore the window to see settings for a section, click on the section heading (Figure 20).

### Undefined #1 Configuration (Type: Temperature Combo)

**Sensor Settings**

**Description** Undefined #1  
Descriptive name for the sensor

**Group** 1  
Select which group the sensor belongs to

**Units** Deg. C  
Select the units for the sensor

**Min. Level** -20.0  
Min. supported value for the sensor

**Max. Level** 70.0  
Max. supported value for the sensor

**Min. Non-Critical Threshold** 30.0  
Min. threshold below which indicates a non-critical alert condition

**Max. Non-Critical Threshold** 70.0  
Max. threshold above which indicates a non-critical alert condition

**Min. Critical Threshold** 10.0  
Min. threshold below which indicates an alert condition

**Max. Critical Threshold** 50.0  
Max. threshold above which indicates an alert condition

**Refresh Rate** 10 Sec  
The refresh rate at which the sensor view is updated

**Non-Critical Alert Settings**

**Critical Alert Settings**

**Data Logging**

Save

**Alert Simulation**

Simulate Alert Clear Alert

Figure 20- Sensor Configuration page

## Threshold Settings

A sensor designed for connection to the RJ45 ports often has a range of reporting values (for example ENVIROMUX-T has a range of 32°-104°F). Two levels of threshold values for each end of that range can be configured (above) to initiate two different alert messages, depending upon the severity of the alert. These levels are identified as “Non-critical” and “Critical”. Use these variations in alert communication as needed to inform users of the severity of sensor reading changes. Each level of alert has its own configuration for how or if the user will be alerted as to a sensor’s status (see Figure 21).

[-] Non-Critical Alert Settings	
<b>Disable Alerts</b>	<input checked="" type="checkbox"/> Disable alert notifications for this sensor
<b>Alert Delay</b>	30 <input type="text"/> Sec <input type="button" value="v"/> Duration the sensor must be out of thresholds before alert is generated
<b>Notify Again Time</b>	30 <input type="text"/> Min <input type="button" value="v"/> Time after which alert notifications will be sent again
<b>Notify on return to normal</b>	<input checked="" type="checkbox"/> Send a notification when this sensor returns to normal status
<b>Enable Syslog Alerts</b>	<input type="checkbox"/> Send alerts for this sensor via syslog
<b>Enable SNMP Traps</b>	<input type="checkbox"/> Send alerts for this sensor via SNMP traps
<b>Enable E-mail Alerts</b>	<input type="checkbox"/> Send alerts for this sensor via e-mail
<b>E-mail Subject</b>	<input type="text"/> Subject of e-mails sent for alerts
<b>Enable SMS Alerts</b>	<input type="checkbox"/> Send alerts for this sensor via SMS
<b>Associated Output Relay</b>	None <input type="button" value="v"/> Name of the output relay that can be controlled by this sensor
<b>Output Relay status on alert</b>	Active <input type="button" value="v"/> Status of the output relay when going to alert
<b>Output Relay status on return from alert</b>	Active <input type="button" value="v"/> Status of the output relay when returning from alert
[-] Critical Alert Settings	
<b>Disable Alerts</b>	<input type="checkbox"/> Disable alert notifications for this sensor
<b>Alert Delay</b>	30 <input type="text"/> Sec <input type="button" value="v"/> Duration the sensor must be out of thresholds before alert is generated
<b>Notify Again Time</b>	30 <input type="text"/> Min <input type="button" value="v"/> Time after which alert notifications will be sent again
<b>Notify on return to normal</b>	<input checked="" type="checkbox"/> Send a notification when this sensor returns to normal status
<b>Auto acknowledge</b>	<input type="checkbox"/> Automatically acknowledge alert when sensor returns to normal status
<b>Enable Syslog Alerts</b>	<input type="checkbox"/> Send alerts for this sensor via syslog
<b>Enable SNMP Traps</b>	<input type="checkbox"/> Send alerts for this sensor via SNMP traps
<b>Enable E-mail Alerts</b>	<input checked="" type="checkbox"/> Send alerts for this sensor via e-mail
<b>E-mail Subject</b>	<input type="text"/> Subject of e-mails sent for alerts
<b>Attach IP camera capture to e-mail</b>	<input type="checkbox"/> Bench Camera <input type="button" value="v"/> Attach captured image from selected IP camera to alert e-mail
<b>Enable SMS Alerts</b>	<input type="checkbox"/> Send alerts for this sensor via SMS
<b>Associated Output Relay</b>	None <input type="button" value="v"/> Name of the output relay that can be controlled by this sensor
<b>Output Relay status on alert</b>	Inactive <input type="button" value="v"/> Status of the output relay when going to alert
<b>Output Relay status on return from alert</b>	Inactive <input type="button" value="v"/> Status of the output relay when returning from alert
[+] Data Logging	

Figure 21- Sensor Configuration- exploded view of additional settings

Sensor Settings	Description
Description	The description of the sensor that will be viewed in the Summary page and in the body of alert messages
Group	Assign the sensor to any group 1 -8 (see also page 42)
Units	This lets the operator choose between Celsius and Fahrenheit as the temperature measurement unit.
Min. Level	Displays the minimum value that this sensor will report
Max. Level	Displays the maximum value that this sensor will report
Minimum Non-Critical - Threshold	<p>The user must define the lowest acceptable value for the sensors. If the sensor measures a value below this threshold, the sensor will move to non-critical alert status. The assigned value should be</p> <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level and</li> <li>➤ lower than the assigned Maximum Threshold value.</li> </ul> <p>If values out of the range are entered, and error message will be shown.</p>
Maximum Non-Critical Threshold	<p>The user must define the highest acceptable value for the sensors. If the sensor measures a value above this threshold, the sensor will move to non-critical alert status. The assigned value should be</p> <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level and</li> <li>➤ higher than the assigned Minimum Threshold value.</li> </ul> <p>If values out of the range are entered, and error message will be shown.</p>
Minimum Critical Threshold	<p>The user must define the lowest acceptable value for the sensors. If the sensor measures a value below this threshold, the sensor will move to alert status. The assigned value should be</p> <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level,</li> <li>➤ lower than the assigned Maximum Threshold value, and</li> <li>➤ lower than the Minimum Non-Critical Threshold value.</li> </ul> <p>If values out of the range are entered, and error message will be shown.</p>
Maximum Critical Threshold	<p>The user must define the highest acceptable value for the sensors. If the sensor measures a value above this threshold, the sensor will move to alert status. The assigned value should be</p> <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level,</li> <li>➤ higher than the assigned Minimum Threshold value, and</li> <li>➤ higher than the Maximum Non-Critical Threshold value.</li> </ul> <p>If values out of the range are entered, and error message will be shown.</p>
Refresh Rate	Determines how often the displayed sensor value is refreshed on the Sensor page. A numeric value and a measurement unit (minimum 1 seconds, maximum 999 minutes) should be entered.
<b>Alert Settings (Applies to Critical and Non-Critical Alerts except where noted)</b>	
Disable Alerts	Place a checkmark in the box to prevent alerts from being sent when this sensor's status changes
Alert Delay	The alert delay is an amount of time the sensor must be in an alert condition before an alert is sent. This provides some protection against false alarms. The Alert Delay value can be set for 0-999 seconds or minutes.
Notify Again Time	Enter the amount of time in seconds, minutes, or hours (1-999) before an alert message will be repeated
Notify on Return to Normal	The user can also be notified when the sensor readings have returned to the normal range by selecting the " <b>Notify when return to normal</b> " box for a sensor.
Auto Acknowledge	<p>Place a checkmark in this box to have alert notifications in the summary page return to normal state automatically when sensor readings return to normal.</p> <p><b>Note:</b> The Non-Critical alert settings do not have this option. Instead, non-critical alert notifications are always auto-acknowledged when sensor readings return to normal</p>
Enable Syslog Alerts	Place a checkmark in this box to have alert notifications sent via Syslog messages
Enable SNMP traps	Place a checkmark in this box to have alert notifications sent via SNMP traps (v2c)
Enable Email Alerts	Place a checkmark in this box to have alert notifications sent via Email
Email Subject	Enter the subject to be viewed when an email alert message is received

Alert Settings (Applies to Critical and Non-Critical Alerts except where noted)	
Attach IP Camera capture to email	Associate a sensor with a IP camera. Select an IP camera from the drop-down box. An image will be captured and sent with the alert message when an alert is sent via e-mail. IP cameras that are monitored by the ENVIROMUX (page 33) will be available for this purpose. <b>Note: To be able to send IP camera captures as e-mail attachments, viewer security (in your camera's configuration) needs to be disabled. Consult your IP camera manual to see if this feature is present and for instructions on how to do this.</b>
Enable SMS Alerts	Place a checkmark in this box to have alert notifications sent via SMS messages (requires a modem)
Associated Output Relay	Associate the sensor with the operation of the output relay, or not <b>Note: Only one sensor should be associated with the Output Relay at a time. Contradicting commands from two or more sensors will result in the output relay responding to the state directed by the last command received.</b> <b>Suggestion: If more than one event needs to control the Output Relay, configure a Smart Alert (page 51) to manage the relay function.</b>
Output Relay Status on Alert	State the output relay will be in when sensor goes to an alert
Output Relay Status on Return from Alert	State the output relay will be in when sensor is no longer in alert
Data Logging	
Add to data log	This is a check-box that lets the user decide if the data sampled should be recorded in the Data Log.
Logging Period	Enter the time period between logged measurements

Be sure to press the **Save** button to save the configuration settings.

**Note: If the Output Relay is associated with a sensor, and configured to change state when a sensor crosses threshold into alert, it will change state even if the alerts are disabled.**

### More about Groups

Groups are used to create a common relationship between sensors, IP devices, etc. and their alert messages. Each item being monitored is assigned to one group of 8 possible. Users (a maximum number of 16 including the root user) can receive alert messages from items in one or more groups (see user configuration on page 42).

### Test Alerts

With all the configuration settings completed, each sensor and how the ENVIROMUX will react to an alert condition can be tested. Press the **Simulate Alert** button at the bottom of the configuration page to test each of the notification methods configured. To cancel the simulation, press the **Clear** button.

**Note: A simulated alert will test all settings including any delay that has been configured (i.e. if a 2 minute delay is configured, it will delay sending the email for 2 minutes)**

To perform a test, the ENVIROMUX must be properly setup for a user to receive alert messages. Use the chart below to make sure the ENVIROMUX is setup properly.

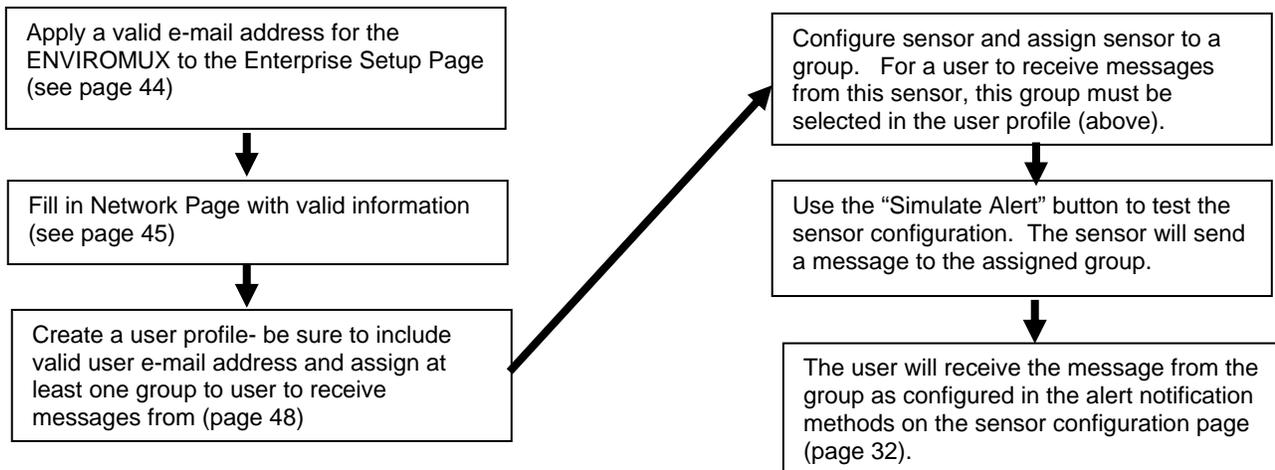


Figure 22- Chart to setup alert notification

## Digital Inputs

The dry-contact sensors connected to the “DIGITAL IN” terminals are monitored and controlled as a separate category on the Summary page.

### Digital Input Sensors

Digital Inputs					
Conn.	Description	Type	Value	Status	Action
1	<a href="#">Lab Smoke Detector</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
2	<a href="#">Lab Door</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
3	<a href="#">Digital Input #3</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
4	<a href="#">Digital Input #4</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
5	<a href="#">Digital Input #5</a>	Digital Input	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>

Figure 23- Digital Input Sensors Summary

Click on the Description link or View to open the Status page for a sensor.

### Lab Smoke Detector Status

Type: Digital Input    Connector: 1

Open

Status: Normal

---

Handle Alert: Dismiss

Last alert was at: Never [Clear Records](#)

Configure

Figure 24- Status of Digital Input #2

If the sensor is in alert status, the user has the option to either **acknowledge** the alert or **dismiss** it. If the user acknowledges the alert, no additional alert messages will be sent during that alert status cycle. If the user dismisses the alert, another alert message will be sent once the “notify again after” time designated on the configuration page (page 24) elapses.

After selecting **acknowledge** or **dismiss**, click **Apply Changes**.

The administrative user can open the sensor configuration page by clicking on the **Configure** button at the bottom of the sensor status page (above) or by clicking on **Edit** from the Summary page. From the sensor configuration page the user can apply settings to control how or if alert messages are sent in the event the sensor is in alert status, threshold settings, and data logging settings.

## Configure Digital Inputs

Click on “Edit” from the Summary page or “Configure” from a sensors Status page to open the Digital Input Configuration for a sensor.

The configuration page for digital inputs is almost the same as that for temperature and humidity sensors, with a few differences. Instead of threshold and minimum/maximum levels settings, digital inputs (water sensors and contact sensors) are either open contact or closed contact sensors. Therefore, the field “Normal Status” is provided to select the status of the sensor when it is not in an alert state. Select between **Open** contacts, or **Close** contacts for the normal status of the sensor. (Water sensors are open contact when not in alert state.)

Alert settings and data logging features are the same as those described on page 25.

### Digital Input Configuration

**Sensor Settings**

**Description**   
Descriptive name for the sensor

**Group**   
Select which group the sensor belongs to

**Normal Status**  ← Select between “Open” or “Closed”  
Select the normal status for the sensor

**Refresh Rate**    
The refresh rate at which the digital input view is updated

**Alert Settings**

**Disable Alerts**   
Disable alert notifications for this sensor

**Alert Delay**    
Duration the sensor must be out of thresholds before alert is generated

**Notify Again Time**    
Time after which alert notifications will be sent again

**Notify on return to normal**   
Send a notification when this sensor returns to normal status

**Auto acknowledge**   
Automatically acknowledge alert when sensor returns to normal status

**Enable Syslog Alerts**   
Send alerts for this sensor via syslog

**Enable SNMP Traps**   
Send alerts for this sensor via SNMP traps

**Enable E-mail Alerts**   
Send alerts for this sensor via e-mail

**E-mail Subject**   
Subject of e-mails sent for alerts

**Attach IP camera capture to e-mail**    
Attach captured image from selected IP camera to alert e-mail

**Enable SMS Alerts**   
Send alerts for this sensor via SMS

**Data Logging**

**Alert Simulation**

Figure 25- Sensor Configuration for Digital Inputs

## Monitor IP Devices

IP devices such as servers, routers, cameras, etc. can be monitored to make sure network connections are open to them. In order to monitor an IP Device the devices must be added to the list of IP Devices being monitored. From the **Monitoring** section of the menu, click on **IP Devices**. A page listing IP Devices being monitored will open, with a link to add IP Devices. Click on **Add New IP Device**.

## IP Devices

IP Devices					
Num.	Description	Type	Value	Status	Action
<a href="#">Add New IP Device</a>					

Figure 26- IP Devices listing-none monitored yet

The page shown below will open. Enter a description for the new IP Device and the IP Address of the device.

## Add New IP Device

☐ Add New IP Device

**Description**   
Descriptive name for the IP Device

---

**IP Address**   
IP Address of the device to ping

---

Figure 27- Add New IP Device page

With the address entered in the block, click on the **“Add”** button.

The IP Device Configuration page will immediately open. Here you can configure the ENVIROMUX to ping the IP Device as often as desired and to react to a lack of response by sending alert messages.

### IP Device Configuration

**[-] IP Device Settings**

**Description**   
Descriptive name for the IP Device

---

**IP Address**   
IP Address of the device to ping

---

**Group**    
Select which group the device belongs to

---

**Ping Period**     
The frequency at which to ping the device

---

**Timeout**   
Duration, in seconds, to wait for a response to a ping

---

**Retries**   
The number of tries before device is considered in alarm

---

**[+] Alert Settings**

**[+] Data Logging**

---

**Alert Simulation**

Figure 28- IP Device Configuration page

IP Device Settings	Description
Description	The description of the IP Device that will be viewed in the Summary page and in the body of alert messages
IP Address	The IP address of the IP Device
Group	Assign the IP Device to any group 1 -8
Ping Period	Enter the frequency in minutes or seconds that the ENVIROMUX should ping the IP Device
Timeout	Enter the length of time in seconds to wait for a response to a ping before considering the attempt a failure
Retries	Enter the number of times the ENVIROMUX should ping a non-responsive IP device before changing its status from normal to alarm and sending an alert

The alert settings and data logging are the same as for sensor configuration, described on page 25.

With a couple of IP devices having been configured for monitoring, the IP Device list will provide links to them for viewing their status, editing their configuration, or deleting them from the list.

### IP Devices

IP Devices					
Num.	Description	Type	Value	Status	Action
1	<a href="#">Web Server</a>	IP Device	Responding	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Backup Server</a>	IP Device	Responding	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

[Add New IP Device](#)

Figure 29- IP Device list with new devices added

To view the graphic image showing the status of an IP address, click on the IP Device description or click **View**. From the IP Device status page, the user can view the current status, either dismiss or acknowledge an alert, or open the IP Device configuration page (if the user has administrative privileges). If you have found the device to be in an alert state and have either dismissed or acknowledged it, be sure to click the **Apply Changes** button.

### Web Server Status

Type: IP Device

Responding

Status: Normal

---

Handle Alert: Dismiss

Last alert was at: Never

Figure 30- IP Device Status page

### Monitor Output Relay

An output relay is provided to control an external device with a rating of up to 1A, 30VDC or 0.5A, 125VAC. The relay state is monitored to be either inactive (relay is at rest; contacts as indicated by product markings) or active (relay is energized; contacts are opposite that of product markings). The status of the relay can be changed either manually through the web interface, or as a result of an alert (page 23).

Output Relays					
Conn.	Description	Type	Value	Status	Action
1	<a href="#">Output Relay #1</a>	Output Relay	Inactive		<a href="#">View</a> <a href="#">Edit</a>

Figure 31- Output Relay on Summary Page



Figure 32- Output Relay Status

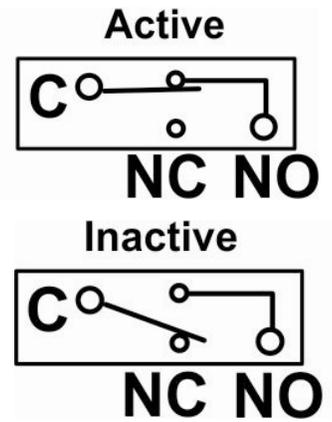


Figure 33- Output Relay Contact State

The set the state of the relay manually, from the relay status page (Figure 32), select the arrow next to Set Output to drop down the window and select either “Deactivate” or “Activate”. Then click the “Apply Changes” button.

To change settings for the output relay and whether or not a state change should generate an alert message, click the “Configure” button.

### Output Relay Configuration

Figure 34- Configure Output Relay

From the configuration page, the user can apply a description of the relay that will be used on the summary page and in any alert messages sent, if so configured.

To have messages sent to specific members, select the monitoring group the relay will belong to.

Choose the Normal Status for the relay, between Inactive or Active. When the status changes from what is defined as “normal”, an alert will be sent if so configured.

When the relay is an alert state, the ENVIROMUX can be configured to send an email, syslog and SMS alerts, as well as an SNMP trap to the users subscribing to alerts in the selected group. Place a checkmark in the box for those features you wish to enable.

If email alerts is enabled, enter an e-mail subject line that will get the attention of the recipient(s).

## Monitor IP Cameras

The IP Cameras page displays the video snapshots of up to 8 monitored IP cameras. ENVIROMUX will display the video from specified IP addresses and provide images at 320 x 240 resolution. To configure the IP cameras to be monitored, click on the "Configure IP Cameras" link.

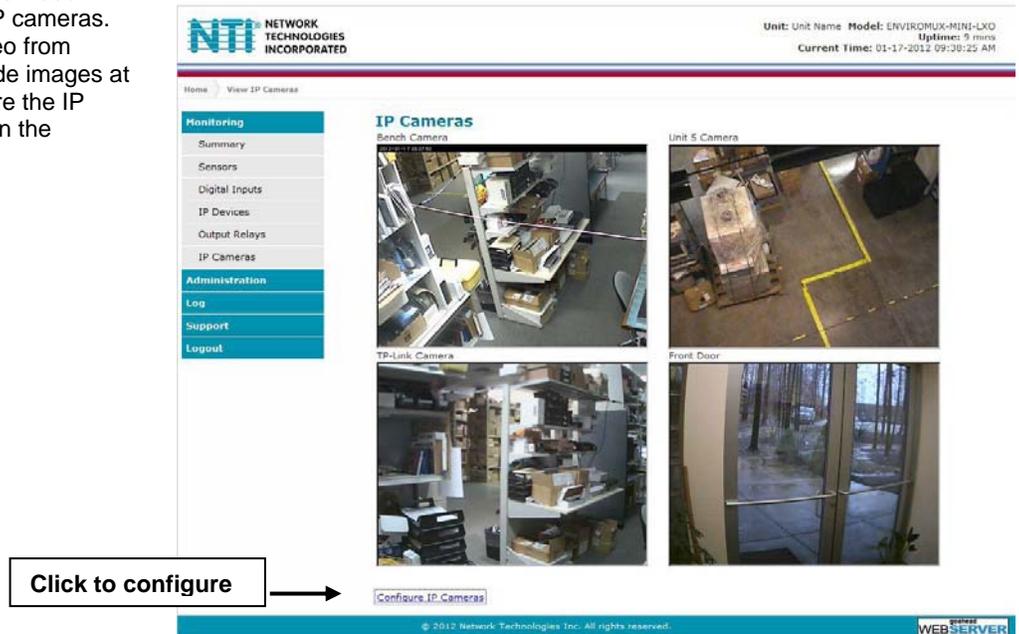


Figure 35- IP Camera Monitoring

### Configure IP Cameras

[-] IP Camera #1	
<b>Add to View</b>	<input type="checkbox"/> Enable this camera in the View page
<b>Name</b>	<input type="text"/> Name of the IP camera
<b>Image URL</b>	<input type="text"/> Full path of the image file of the IP camera
<b>IP Address</b>	<input type="text"/> IP address of the IP camera
<b>Refresh Rate (x100 msec)</b>	<input type="text" value="0"/> Refresh rate of the image in hundreds of milliseconds
[+] IP Camera #2	
[+] IP Camera #3	
[+] IP Camera #4	
[+] IP Camera #5	
[+] IP Camera #6	
[+] IP Camera #7	
[+] IP Camera #8	
<input type="button" value="Save"/>	

Figure 36- Configure IP Cameras

Place a name, the URL or IP address of the link, and the full path including name of the image taken by the camera in the blocks provided, click the "Add to view" checkbox, and click SAVE at the bottom of the page. Then click on **Monitoring->IP Cameras** to see the images taken by those cameras. The images can be set to be refreshed every 100 msec (.1 second) up to 99,900 msec (almost 100 seconds). The user can click on any image and be connected to the site defined by the URL or IP Address.

The images from IP cameras can also be associated with alert messages. When configured (page 23), an image from a IP camera can be taken and sent along with a sensor alert message via email.

**Note: To be able to send IP camera captures as e-mail attachments, viewer security (in your camera's configuration) needs to be disabled. Consult your IP camera manual to see if this feature is present and for instructions on how to do this.**

## DC Power

On the Summary Page (under Monitoring), the status of the DC power supply can be found (only applicable for models with battery backup). The ENVIROMUX will monitor the power coming into the ENVIROMUX and can be configured to send an alert in the event that power supply fails. Click on "Edit" to configure how the ENVIROMUX should respond.

DC Power				
Num.	Type		Status	Action
1	DC Power		Normal	<a href="#">Edit</a>

Figure 37- Excerpt from the Summary Page showing DC Power monitoring

### DC Power Alerts Configuration

DC Power Alert Settings

**Group** 1 ▾  
Select which group the digital input belongs to

**Disable Alerts**   
Disable alert notifications for DC powerc

**Notify Again Time**  Hr ▾  
Time after which alert notifications will be sent again

**Notify on return to normal**   
Send a notification when this DC power returns to normal status

**Enable Syslog Alerts**   
Send alerts for DC power input via syslog

**Enable SNMP Traps**   
Send alerts for DC power input via SNMP traps

**Enable E-mail Alerts**   
Send alerts for DC power input via e-mail

**E-mail Subject**   
Subject of e-mails sent for alerts

**Enable SMS Alerts**   
Send alerts for this DC power via SMS

**Associated Output Relay** None ▾  
Name of the output relay that can be controlled by this DC power

**Output Relay status on alert** Active ▾  
Status of the output relay when going to alert

**Output Relay status on return from alert** Active ▾  
Status of the output relay when returning from alert

Figure 38- DC Power Alert Configuration

Many of the same options that apply to sensor alerts (page 23) can be configured for DC Power alerts. The battery backup will keep the ENVIROMUX on line for up to 2.3 hours in the event of a power failure.

## Administration

From the Administration section there are several sub sections for configuring the ENVIROMUX:

<b>Administration</b>	System	Fields for applying time zone, date, time, NTP server, and backup and restore configuration settings
System	Enterprise	Fields for assigning the unit name, address, contact person, the ENVIROMUX e-mail address, and phone number of a contact person
Enterprise	Network	Fields for providing all the network settings the ENVIROMUX including IP address, DNS, SMTP and SNMP settings
Network	Users	Fields for assigning users, access privileges, passwords, contact settings, and schedule settings
Users	Security	Fields for setting authentication method and IP Filtering
Security	System Information	For viewing ENVIROMUX system information
System Information	Firmware	For updating the firmware of the ENVIROMUX when improved software becomes available.
Firmware	Reboot	Enables user to reboot the ENVIROMUX using the web interface
Reboot		

## System Configuration

The System Configuration section is where all the settings necessary for proper time reporting within alert messages and log records are configured. Configuration for language selection and the viewing mode for a connected USB LCD monitor are also accessed on this page. To view the System Configuration page, click on **System** from the **Administration** section of the menu.

### System Configuration

[-] Time Settings

**Time zone** (GMT-05:00) Eastern Time (US & Canada) ▼  
Select your time zone

**Enable Daylight Saving**  Automatically adjust clock for daylight saving changes

**Set Date**  MM-DD-YYYY ▼  
Manually set the system date

**Set Time**  AM ▼  
Manually set the system time (format hh:mm:ss)

**Enable NTP**  Get system time via Network Time Protocol

**NTP server**   
Address of the NTP server

**NTP Frequency**   
Frequency, in minutes, at which to query NTP server (minimum 5 minutes)

**E-mail Time Stamp**  Add time stamp to e-mail alerts

**SMS Time Stamp**  Add time stamp to SMS alerts

---

[-] Configuration Backup & Restore

**Choose File**    
Choose configuration file to restore.  
 Note: system will reboot to apply the configuration.

---

[-] Language

[-] USB LCD Display

Figure 39- System Configuration page

The Date and Time of the ENVIROMUX can be either manually setup to use an onboard clock or set to be synchronized with an NTP server. The configuration of the ENVIROMUX can also be easily backed up to a file on your PC and restored from that file as needed.

### System Configuration Settings

Time Settings	Description
Time Zone	Enter the appropriate time zone
Enable Daylight Saving	Apply a checkmark to have the time change according to Daylight Saving Time rules
Set Date	Enter the system date in MM-DD-YYYY format
Set Time	Enter the system time of day in hh:mm:ss format
Enable NTP	Place a checkmark to enable the ENVIROMUX to automatically sync up with a time server via NTP
NTP server	If the NTP is enabled, enter the Domain Name or IP address of the NTP server
NTP Frequency	Enter the frequency (in minutes) for the ENVIROMUX to query the NTP server (minimum is 5 minutes)
E-mail Time Stamp	Place a checkmark to have the ENVIROMUX apply a time of day stamp in the alert message sent via email
SMS Time Stamp	Place a checkmark to have the ENVIROMUX apply a time of day stamp in the alert message sent via SMS
Configuration Backup & Restore	
Choose file	Browse for a saved configuration file to be restored to the ENVIROMUX. Upon selection, the ENVIROMUX will restore the configuration settings and reboot. Allow 1 minute before trying to reconnect and log in again.  <b>Note: The IP address will be set to the IP address in the file and may be different</b>
Download Configuration File	Click this button to save the configuration of the ENVIROMUX to a location on your PC. This file can be restored using the "Choose file" field in the event you wish to return the ENVIROMUX to a former state
Restore Defaults	Click this button to restore the ENVIROMUX to the configuration settings it had upon receipt from the factory. <b>Be careful!</b> This will erase <u>all</u> user configuration settings. Upon restoration, the ENVIROMUX will reboot. Allow 1 minute before trying to reconnect and log in again.  <b>Confirmation is required.</b>

**Note: If "Restore Defaults" is used, the IP address will also be restored to its default address of 192.168.1.23 with a login name "root" and password "nti". To restore the root password to "nti" without having to restore all default settings, contact NTI for assistance.**

You can also restore settings to defaults from a button on the front of the ENVIROMUX (page 104).

To identify the IP address of the ENVIROMUX without restoring defaults, use the Discovery Tool (page 18).

(More System Configuration Settings)

Language Selection	
Select Language	Select between English, German, Indonesian and Japanese for the language to read the ENVIROMUX menus in.
USB LCD Display	
Select Screen	Select what should be displayed on the ENVIROMUX-LCD7U when plugged into a USB port on the ENVIROMUX (see Figure 41)  An ENVIROMUX-LCD7U USB LCD monitor can be connected to either of the USB Type A ports (page 3). The ENVIROMUX will automatically sense the monitor and send the selected images to the screen.
RJ45 Connector	When RJ45 Connector is selected for display on the LCD monitor, choose between RJ45 connector 1 or 2 as the sensor status page to be viewed on the monitor.

System Configuration

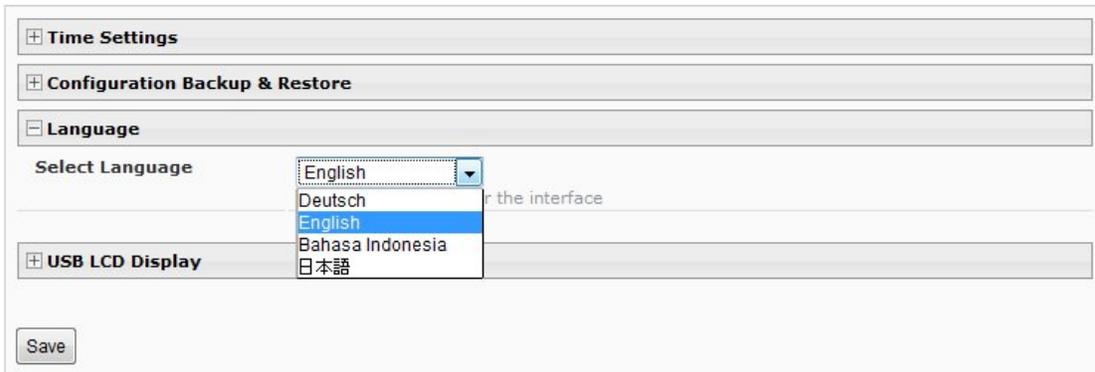


Figure 40- Select language setting for menus

System Configuration

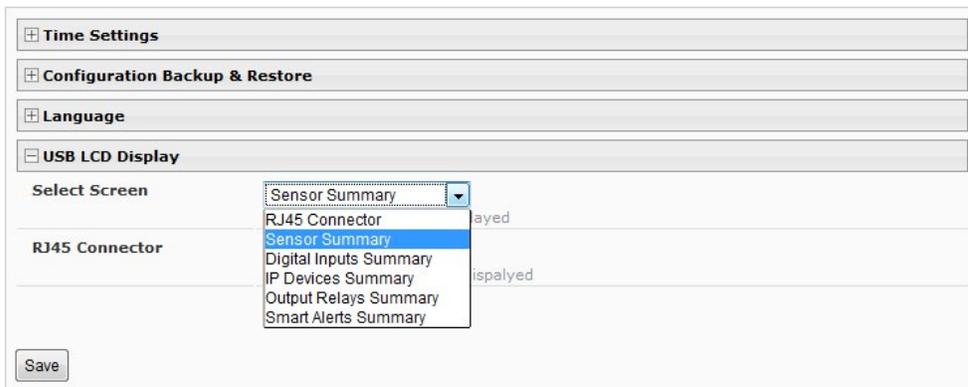


Figure 41- Select what will be displayed on connected USB LCD Monitor

Click on **Save** when finished with any changes that are made.

## Enterprise Configuration

The Enterprise Configuration page is used to enter basic company information to be applied to the body of alerts. To view the Enterprise Configuration, click on **Enterprise** from the **Administration** section of the menu. Enter in the blocks your unit name, location, the contact person that alert e-mails should refer to, the phone number to reach them, and the e-mail address assigned to the ENVIROMUX.

If a GSM modem is properly installed (page 15), the “Modem Status” found in the GSM Modem Status section will indicate “Connected” and the IMEI number for the modem will be indicated. Once the modem makes connection with the cell tower, “Connected” will change to “Ready” (as seen below).

**Note: It may take several minutes for the GSM modem to be detected by the ENVIROMUX.**

### Enterprise Configuration

The screenshot shows the 'Enterprise Configuration' page. It has two main sections: 'Enterprise Settings' and 'GSM Modem Status'. The 'Enterprise Settings' section contains five input fields: 'Enterprise Name' (with a placeholder 'Name to identify this unit'), 'Location' (with a placeholder 'Location/Address'), 'Contact' (with a placeholder 'Contact person'), 'Phone' (with a placeholder 'Phone number of contact person'), and 'E-mail' (with a placeholder 'E-mail address for messages sent from this unit'). The 'GSM Modem Status' section displays the following information: Modem Type: USB Modem; IMEI: 353254030124511,PZ2996N2VN; Modem Status: Ready; Signal Power: -103 dBm. Below this information is a signal strength indicator consisting of five vertical bars of increasing height, with the first two bars filled with green. A callout box with an arrow points to the 'Ready' status, containing the text 'GSM modem is properly installed'. A 'Save' button is located at the bottom left of the form.

Figure 42- Enterprise Configuration- Modem Status “Ready”

If no modem is installed, the modem type will be “Not Available” and the status will be “Not Connected”.

The screenshot shows the 'GSM Modem Status' section of the configuration page. It displays the following information: Modem Type: Not Available; IMEI: (blank); Modem Status: Not Connected; Signal Power: No Signal. Below this information is a signal strength indicator consisting of five vertical bars of increasing height, all of which are empty. A 'Save' button is located at the bottom left of the form.

Figure 43- No Modem Installed

## Network Configuration

From the Network Setup page the administrator can either choose to have the IP address and DNS information filled in automatically by the DHCP server, or manually fill in the fields (use a static address). Settings can be entered for either the IPv4 or IPv6 protocols. To view the Network Configuration page, click on **Network** from the **Administration** section of the menu.

**Note: If you select “DHCP”, make sure a DHCP server is running on the network the ENVIROMUX is connected to.**

### Network Configuration

The screenshot shows the Network Configuration page with the following settings:

- IPv4 Settings:**
  - IPv4 Mode: Static (dropdown)
  - IPv4 Address: 192.168.1.21
  - IPv4 Subnet Mask: 255.255.255.0
  - IPv4 Default Gateway: 192.168.1.1
  - Preferred DNS: (empty)
  - Alternate DNS: (empty)
- IPv6 Settings:**
  - IPv6 Mode: Disabled (dropdown)
  - IPv6 Address: (empty)
  - IPv6 Default Gateway: (empty)
  - Enable 6to4 tunnel: Disabled (dropdown)
  - Local IPv4 Address: (empty)
  - Remote IPv4 Address: (empty)
- SMTP Settings:** (collapsed)
- SNMP Settings:** (collapsed)
- Server Settings:** (collapsed)

**Note:** The values shown here are for local (static) address configuration only. Address values for DHCP configuration will only be displayed in the System Information page (page 46).

Figure 44- Network Configuration page

IPv4 Settings	Description
Mode	Select between Static (manual) , or DHCP (automatic IP and DNS) settings
IP Address	Enter a valid IP address (default address shown above)
Subnet Mask	Enter a valid subnet mask (default value shown above)
Default Gateway	Enter a valid gateway (default gateway shown above)
Preferred DNS	Enter a preferred domain name server address
Alternate DNS	Enter an alternate domain name server address

Enter IPv6 settings as applicable.

For descriptions of SMTP, SNMP, and Server Settings, see page 41.

The Network Configuration page is broken into four sections; IP Settings, SMTP Settings, SNMP Settings, and Server Settings. To explode the window to see settings for a section, click on the section heading.

SMTP Settings	
SMTP Server	smtp.gmail.com <small>SMTP server used when sending e-mails</small>
Port	587 <small>SMTP server port</small>
Use SSL	<input type="checkbox"/> <small>SMTP server requires the use of SSL</small>
Use STARTTLS	<input checked="" type="checkbox"/> <small>SMTP server requires the use of STARTTLS</small>
Use Authentication	<input checked="" type="checkbox"/> <small>SMTP server requires authentication to send e-mail</small>
Username	user@gmail.com <small>Username for sending e-mails</small>
Password	•••••••• <small>Password for sending e-mails</small>
SNMP Settings	
Enable SNMP Agent	SNMPv1v2cv3 <input type="button" value="v"/> <small>Allow access to SNMP agent on this device</small>
Enable SNMP Traps	<input type="checkbox"/> <small>Enable sending of SNMP traps from this device</small>
Read-write community name	private <small>Read-write community name for SNMP agent</small>
Read-only community name	public <small>Read-only community name for SNMP agent</small>
Server Settings	
Enable Telnet	<input checked="" type="checkbox"/> <small>Enable access to this device via telnet</small>
Enable SSH	<input checked="" type="checkbox"/> <small>Enable access to this device via ssh</small>
Enable HTTP Access	<input checked="" type="checkbox"/> <small>Enable access to this device via standard (non-secure) HTTP requests. HTTPS is always enabled.</small>
HTTP Port	80 <small>Port for standard HTTP requests</small>
HTTPS Port	443 <small>Port for HTTPS requests</small>
Web Timeout	0 <small>Minutes after which idle web users will be logged out (0 disables idle logout)</small>
<input type="button" value="Save"/>	

**Common Port numbers:**  
 Default: 25 (Not secure)  
 SSL: 465 (Secure)  
 TLS: 587 (Secure)  
 Contact your network administrator for required settings.

Figure 45- Network Configuration- more settings

**More Network Settings (see Figure 45)**

SMTP Settings	Description
SMTP Server	Enter a valid SMTP server name (e.g. yourcompany.com)
Port	Enter a valid port number (default port is 25, for SSL most use 465, for STARTTLS most use 587)
Use SSL	Place a checkmark in the box if the SMTP server supports SSL
Use STARTLS	Place a checkmark in the box if the SMTP server supports TLS
Use Authentication	Place a checkmark in the box if the SMTP server requires authentication to send email
Username	Enter a valid username to be used by the ENVIROMUX to send emails
Password	Enter a valid password assigned to the ENVIROMUX username
SNMP Settings	
Enable SNMP agent	Place a checkmark in the box to enable access to the SNMP agent
Enable SNMP traps	Place a checkmark in the box to allow SNMP traps to be sent
Read-write community name	Enter applicable name (commonly used- "private") <b>Not applicable as of this printing</b>
Read-only community name	Enter applicable name (commonly used- "public")
Server Settings	
Enable Telnet	Place a checkmark in the box to enable access to the ENVIROMUX via Telnet <b>The default is disabled.</b>
Enable SSH	Place a checkmark in the box to enable access to the ENVIROMUX via SSH
Enable HTTP access	Place a checkmark in the box to enable access to the ENVIROMUX via standard (non-secure) HTTP requests
HTTP Port	Port to be used for standard HTTP requests
HTTPS Port	Port to be used for HTTPS requests
Web Timeout	Number of minutes after which idle web uses will be logged-out (enter 0 to disable this feature)

If the administrator chooses to have the IP and DNS information filled in automatically via DHCP, the SMTP server and port number still need to be entered for email alerts to work. If the SMTP server requires a password in order for users to send emails, the network administrator must first assign a user name and password to the ENVIROMUX.

**Note: The SMTP server port number is shown in Figure 45 as "25". This is a common port number assigned, but not necessarily the port number assigned to your SMTP server. For SMTP servers that support SSL, the common port number is 465, and for those that support TLS, the common port number is 587.**

The administrator may assign a different HTTP Server Port than is used by most servers (80).

**Note: If the port number is changed and forgotten, to determine what it has been changed to connect the ENVIROMUX for control using the text menu (page 62) and review the Miscellaneous Service Settings (page 85).**

**Read-Only Community Name**

The SNMP Read-only community name enables a user to retrieve "read-only" information from the ENVIROMUX using the SNMP browser and MIB file. This name must be present in the ENVIROMUX and in the proper field in the SNMP browser.

**Read-Write Community Name  
(not applicable as of this printing)**

The SNMP Read-Write community name enables a user to read information from the ENVIROMUX and to modify settings on the ENVIROMUX using the SNMP browser and MIB file. This name must be present in the ENVIROMUX and in the proper field in the SNMP browser.

## User Configuration

The Users page is a list of all configured users of the ENVIROMUX. A maximum of 15 users (other than root) can be configured. From this page the user can choose to add more users, go to the user configuration page to edit a user's access to the ENVIROMUX, or delete a user from the list. To view the Users page, click on **Users** from the **Administration** section of the menu.

## Users

Users					
Num.	Username	Enabled	Admin	Last Login	Action
1	<a href="#">root</a>	yes	yes	09-06-2009 11:58:56 PM	<a href="#">Edit</a>
2	<a href="#">user1</a>	no	no	Never	<a href="#">Edit</a> <a href="#">Delete</a>

[Add New User](#)

Figure 46- Users page

To add a user, click on the “Add New User” link.  
 To edit a user's configuration, either click on the listed username, or on the “Edit” link.  
 To delete a user and their configuration, click on “Delete” link.

When adding a new user, the Configure User page will open with the username “userx” assigned, where x = the next consecutive number (up to 15) based on the quantity of users in the list (other than the root user). You can either leave the name as “userx”, or change it to what you would like to see listed. With the name assigned, fill in the remaining information as needed.

### Configure User

[-] Account Settings

<b>Username</b>	<input type="text" value="user2"/> <small>The username for this user</small>
<b>Admin</b>	<input type="checkbox"/> Grant this user administrative privileges
<b>Enabled</b>	<input type="checkbox"/> Users can only access the system if their account is enabled
<b>Password</b>	<input type="password" value="....."/> <small>The user's password to login to the system (for local authentication)</small>
<b>Confirm</b>	<input type="password" value="....."/> <small>Confirm the entered password</small>
<b>Title</b>	<input type="text"/> <small>The user's title within the company</small>
<b>Department</b>	<input type="text"/> <small>The user's department within the company</small>
<b>Company</b>	<input type="text"/> <small>The name of the user's company</small>

[+] Group Settings

[+] Contact Settings

[+] Schedule Settings

Figure 47- Configure Users page

Group Settings	
Group 1	<input type="checkbox"/> User receives notifications for Group 1
Group 2	<input type="checkbox"/> User receives notifications for Group 2
Group 3	<input type="checkbox"/> User receives notifications for Group 3
Group 4	<input type="checkbox"/> User receives notifications for Group 4
Group 5	<input type="checkbox"/> User receives notifications for Group 5
Group 6	<input type="checkbox"/> User receives notifications for Group 6
Group 7	<input type="checkbox"/> User receives notifications for Group 7
Group 8	<input type="checkbox"/> User receives notifications for Group 8

Contact Settings	
E-mail Alerts	<input type="checkbox"/> User receives alerts via e-mail
E-mail Address	<input type="text"/> E-mail address for the user
Syslog Alerts	<input type="checkbox"/> User receives alerts via syslog
SNMP Traps	<input type="checkbox"/> User receives alerts via SNMP traps
Syslog/SNMP IP Address	<input type="text"/> IP address where syslog messages/SNMP traps are sent for this user
SMS Alerts	<input type="checkbox"/> User receives alerts via SMS
SMS Number	<input type="text"/> Phone number where SMS messages are sent for this user

Schedule Settings	
Schedule Type	Always active <input type="button" value="v"/> Configure the user's schedule type
Start Day	Sun <input type="button" value="v"/> First day of the week when the user active
End Day	Sun <input type="button" value="v"/> Last day of the week when the user active
Start Hour	00:00 <input type="button" value="v"/> Starting hour for the user's daily schedule
End Hour	00:00 <input type="button" value="v"/> Ending hour for the user's daily schedule

SNMP Settings	
Authentication Protocol	None <input type="button" value="v"/> Select authentication protocol
Authentication Passphrase	12345678 The authentication passphrase
Privacy Protocol	None <input type="button" value="v"/> Select privacy protocol
Privacy Passphrase	12345678 The privacy passphrase
Traps Type	SNMPv1 <input type="button" value="v"/> Select type of traps accepted by user

Figure 48- Configure User- more options

Account Settings	Description
Username	Enter the desired username for this user
Admin	Place a checkmark here if this user should have administrative privileges
Enabled	Place a checkmark here to enable this user to access the ENVIROMUX
Password	Enter a password that a user must use to login to the system <b>A password must be assigned for the user's login to be valid</b> <b>Passwords must be at least 1 keyboard character.</b>
Confirm	Re-enter a password that a user must use to login to the system
Title	Enter information as applicable
Department	Enter information as applicable
Company	Enter information as applicable
Group Settings	
Group 1-8	Place a checkmark if the user should receive messages from sensors, accessories, or IP devices in Group 1, 2, 3... thru 8 (see also pages 25 and 30 for group assignments)
Contact Settings	
Email alerts	Place a checkmark if the user should receive messages via email
Email address	Enter a valid email address if this user should receive email alert messages
Syslog alerts	Place a checkmark if the user should receive alerts via syslog messages
SNMP traps	Place a checkmark if the user should receive alerts via SNMP traps
Syslog/SNMP IP address	Enter a valid syslog/SNMP IP address for the user to receive syslog/SNMP messages
SMS Alerts	Place a checkmark if the user should receive alerts via SMS messages
SMS Number	Enter a phone number for the GSM modem to call to alert the user via SMS message
Schedule Settings	
Schedule Type	<b>Always active</b> - user will receive messages at all hours of each day <b>Active during defined times</b> - user will only receive alert messages during times as outlined below
Start Day	First day of the week the user should begin receiving messages
End Day	Last day of the week the user should receive messages
Start Hour	First hour of the day the user should begin receiving messages
End Hour	Last hour of the day the user should receive messages
SNMP Settings	
Authentication Protocol	Choose between MD5 or SHA to require authentication, or none to disable it
Authentication Passphrase	Assign the passphrase to be used to enable the receipt of SNMP v3 messages
Privacy Protocol	Choose between DES or AES to encrypt SNMP readings or traps or none to disable encryption. If encryption is enabled, then the Authentication Protocol must also be set at "MD5" or "SHA".
Privacy Passphrase	Assign the passphrase to be used to open and read readings or alert messages received via SNMP v3
Traps Type	Choose between SNMPv1, SNMPv2C, or SNMPv3

After changing any settings in the user profile, press "Apply".

## More about User Privileges

The root user (or any user with administrator rights) can change the root password and configure how the root user will receive alert messages. Users with administrative rights can change all configuration settings except for the root user name.

Users with user rights can only see the current readings of monitored items and change their own passwords.

Home > Summary

**Monitoring**  
Administration  
Log  
Support  
Logout

### Summary

**Sensors**

Conn.	Description	Type	Value	Status	Action
1	<a href="#">Server Rack Temperature</a>	Temperature Combo	86.9F	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
1	<a href="#">Server Rack Humidity</a>	Humidity Combo	26.6%	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Server Room Temperature</a>	Temperature Combo	76.8F	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Server Room Humidity</a>	Humidity Combo	34.1%	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

**Water Sensors**

Conn.	Description	Type	Value	Status	Action
1	<a href="#">Server Room Water Detection</a>	Water Sensor	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>

**Dry Contacts**

Conn.	Description	Type	Value	Status	Action
1	<a href="#">Server Room Smoke Detector</a>	Dry Contact	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
2	<a href="#">Server Room Door</a>	Dry Contact	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
3	<a href="#">Not Used</a>	Dry Contact	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>
4	<a href="#">Not Used</a>	Dry Contact	Open	Normal	<a href="#">View</a> <a href="#">Edit</a>

**IP Devices**

Num.	Description	Type	Value	Status	Action
1	<a href="#">Web Server</a>	IP Device	Responding	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>
2	<a href="#">Backup Server</a>	IP Device	Responding	Normal	<a href="#">View</a> <a href="#">Edit</a> <a href="#">Delete</a>

Copyright © 2011 Network Technologies Inc. All rights reserved.

Figure 49-Summary page for User without Admin privileges

## Security

Security in the ENVIROMUX can be managed one of two ways; through the local settings (passwords assigned in user settings on page 44) or through an LDAP server. If security is configured to use LDAP mode, then the passwords for users must be those found on a configured LDAP server. To view the Security Configuration page, select **Security** in the **Administration** section of the menu.

### Security Configuration

[-] **User Authentication**

<b>Mode</b>	<input type="text" value="Local"/>	<small>Authentication method for logging into the system</small>
<b>LDAP Primary Server</b>	<input type="text"/>	<small>Primary LDAP server</small>
<b>LDAP Secondary Server</b>	<input type="text"/>	<small>Secondary LDAP server</small>
<b>LDAP Server Type</b>	<input type="text" value="Generic LDAP server"/>	<small>The type of LDAP server being connected to</small>
<b>LDAP User Base DN</b>	<input type="text"/>	<small>Base DN for users (ex: ou=People,dc=mycompany,dc=com)</small>

[+] **IP Filtering**

Figure 50- Security Configuration page

When in LDAP mode, usernames on the LDAP server must match those in the user settings of the ENVIROMUX or access will be denied.

**Note:** When in LDAP mode, if the LDAP server is not responding, local authentication will be tried.

User Authentication	
Mode	Select Local to use authentication based on passwords in the ENVIROMUX user configuration Select LDAP to use authentication based on passwords in an LDAP server
LDAP Primary Server	Enter Hostname or IP address of Primary LDAP Server
LDAP Secondary Server	Enter Hostname or IP address of Secondary LDAP Server (optional)
LDAP Server Type	Choose from drop down list: Generic LDAP server Novell Directory server Microsoft Active Directory
LDAP User Base DN	Enter the Base DN for users (ex: ou=People,dc=mycompany,dc=com)

Even though LDAP authentication is being used, each user must also have a local account. User permission level is established by the local account.

Included in the Security Configuration options is IP Filtering. IP Filtering provides an additional mechanism for securing the ENVIROMUX. Access to the ENVIROMUX network services (SNMP, HTTP(S), SSH, Telnet) can be controlled by allowing or disallowing connections from various IP addresses, subnets, or networks.

Up to 16 IP Filtering rules can be defined to protect the ENVIROMUX from unwanted access from intruders. Each rule can be set as Enabled or Disabled. Rules can be set to explicitly drop attempts to connect, or to accept them.

Be sure to press **Save** after changes are made.

☰ **IP Filtering**

Num.	Enabled	Mode	Filter Rule
1	Disabled ▾	DROP ▾	192.168.1.0/24
2	Disabled ▾	DROP ▾	192.168.1.0/24
3	Disabled ▾	DROP ▾	192.168.1.0/24
4	Disabled ▾	DROP ▾	192.168.1.0/24
5	Disabled ▾	DROP ▾	192.168.1.0/24
6	Disabled ▾	DROP ▾	192.168.1.0/24
7	Disabled ▾	DROP ▾	192.168.1.0/24
8	Disabled ▾	DROP ▾	192.168.1.0/24
9	Disabled ▾	DROP ▾	192.168.1.0/24
10	Disabled ▾	DROP ▾	192.168.1.0/24
11	Disabled ▾	DROP ▾	192.168.1.0/24
12	Disabled ▾	DROP ▾	192.168.1.0/24
13	Disabled ▾	DROP ▾	192.168.1.0/24
14	Disabled ▾	DROP ▾	192.168.1.0/24
15	Disabled ▾	DROP ▾	192.168.1.0/24
16	Disabled ▾	DROP ▾	192.168.1.0/24

DROP  
ACCEPT

Figure 51- Security Configuration- IP Filtering Rules

### More on IP Filtering

The most common approach is to only allow “white-listed” IP addresses, subnets, or networks to access the device while blocking all others. The IP Filters are processed sequentially from top to bottom, so it is important to place the most precise rules at the top of the list and the most generic rules at the bottom of the list.

As an example, assume we wish to block all connections except those which come from the IP address 192.168.1.100. To allow connections from 192.168.1.100, we need to configure and enable an ACCEPT rule at the top of the list:

1       Enabled       ACCEPT     

Then, to block all other IP addresses from connecting to the ENVIROMUX, we add a rule to drop all other connections.

16       Enabled       DROP     

If the preceding “drop all connections” rule was placed in position one, no connections at all would be allowed to the unit. Remember: rules are processed from top to bottom. As soon as a rule matches, the processing stops and the matching rule is executed.

To match a particular IP address, simply enter in the desired IP address (e.g. 192.168.1.100).

To match a subnet, enter in the subnet with the associated mask (e.g. 192.168.1.0/24).

To match all IP address, specify a mask of 0 (e.g. 0.0.0.0/0).

### System Information

The system information page displays the model name of the ENVIROMUX, the firmware version in the ENVIROMUX, the MAC address of the Ethernet port, the IP mode, and the network configuration. To view the System Information, select **System Information** in the **Administration** section of the main menu.

#### System Information

System Information	
<b>Product:</b>	ENVIROMUX-SEMS-2DB Server Environment Monitoring System
<b>Revision:</b>	1.2
<b>Build Date:</b>	03-27-2012 11:32:12 AM
<b>MAC Address:</b>	00:0C:82:0E:00:02
<b>IP Mode:</b>	Static
<b>IP Address:</b>	192.168.3.81
<b>Subnet Mask:</b>	255.255.255.0
<b>Default Gateway:</b>	192.168.3.3
<b>Primary DNS:</b>	166.102.165.11
<b>Secondary DNS:</b>	166.102.165.13
<b>SNMPv3 Engine ID:</b>	0x80001F8803000C820E0002

Figure 52- System Information page

## Update Firmware

The Update Firmware page is used to change the firmware of the ENVIROMUX. Occasionally new features or changes to existing features will be introduced and new firmware with these changes will be made available on the NTI website (<http://www.networktechinc.com/download/d-environment-monitor-2d.html>). To view the Update Firmware page, select **Firmware** in the **Administration** section of the main menu. Once a user has downloaded the required file for firmware upgrade, this page will be used to upload it to the ENVIROMUX.

### Update Firmware

**Firmware Update**

**Caution!** You have asked to update the firmware. Failure to update firmware properly can permanently damage the product.

**Update file**

**Browse...**

Choose the firmware update file.  
Current firmware version is **1.2**.  
Build date: **03-27-2012 11:32:12 AM**

**Update**

Figure 53- Update Firmware page

1. Download the most current firmware file from <http://www.networktechinc.com/download/d-environment-monitor-2d.html> to a location on your PC.
2. Click on the “Browse” button and locate and select the firmware file for the ENVIROMUX (*enviromux-1xo-2d-vx-x.bin*, for example).
3. Click on the “Update” button to perform the firmware update. The firmware update process will take approximately 5 minutes while the ENVIROMUX installs the firmware. Once the update file has been installed, the unit will automatically reboot and the login screen will appear.

## Reboot the System

The ENVIROMUX can be remotely rebooted by anyone with administrative privileges. To view the Reboot System page, select **Reboot** in the **Administration** section of the main menu. Click the **Reboot Now** button to cause the ENVIROMUX to reboot. This will disconnect any user and shut down all activity.

### Reboot System



Figure 54- Reboot System page

The message "System is rebooting, please wait..... " will appear and after approximately 45 seconds the login screen will appear. Log in to resume activity.

### System Reboot

System is rebooting, please wait...

Figure 55- System is rebooting

## Smart Alerts

Smart Alerts enable the ENVIROMUX to contact users when specially configured circumstances exist for defined sensors. Smart Alerts will respond to 1 or more alert conditions independent of the alert configurations for each sensor configured on page 23. Assorted conditions can produce configurable events that can then be used in numerous scenarios to produce Smart Alert messages that are sent to users.

To begin, Events must be defined and configured. Events are sensor conditions to be notified of. Events logged based on the sensor configurations described on page 23 will be managed separately from events logged by these pre-defined Events. Sensor configuration for these Events will have no impact on the general configuration of your sensors. Pre-defined Events provide more control over what you want to be notified of.

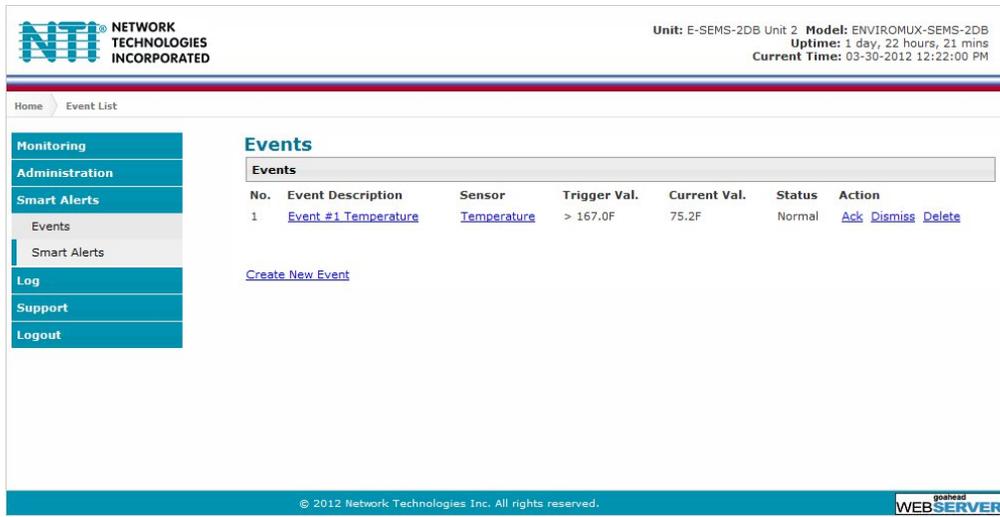


Figure 56- Events used for Smart Alerts

From the side menu, select “Smart Alerts”, and “Events”. On the Events page, click on “Create New Event”.

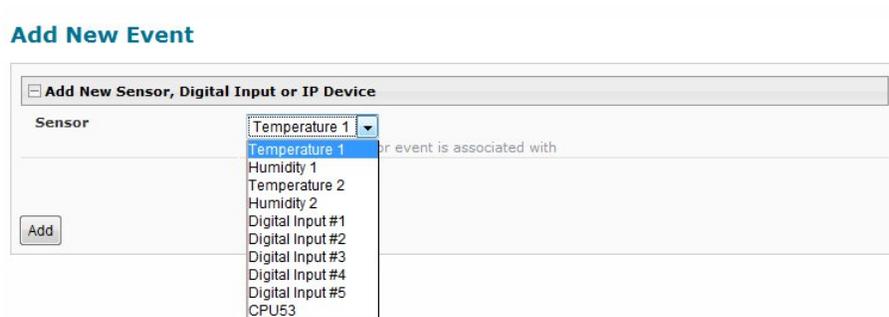


Figure 57- Sensor to be used for a predefined event

You will be prompted to select which connected sensor to associate the event with. Which sensor’s data do you want to trigger this event? Once selected, click “Add”.

**New Event Configuration**

**Event Settings**

**Description**   
Descriptive name for the event

**Threshold**  °C  
Threshold which indicates an alert condition

**Threshold Type**   
Select the threshold type

**Event Delay**    
Duration the sensor must be out of thresholds before the event is triggered

---

**Event Notifications**

**Group**   
Select which group the event belongs to

**Notify Again Time**    
Time after which alert notifications will be sent again

**Notify on return to normal**   
Send a notification when this sensor returns to normal status

**Auto acknowledge**   
Automatically acknowledge alert when sensor returns to normal status

**Enable Syslog Alerts**   
Send alerts for this event via syslog

**Enable SNMP Traps**   
Send alerts for this event via SNMP traps

**Enable E-mail Alerts**   
Send alerts for this event via e-mail

**E-mail Subject**   
Subject of e-mails sent for alerts

**Attach IP camera capture to e-mail**    
Attach captured image from selected IP camera to alert e-mail

**Enable SMS Alerts**   
Send alerts for this event via SMS

**Figure 58- Configuration options for new event**

Depending upon the type of sensor chosen, various event settings can be configured that will cause an event to be logged. In the example above, if the temperature sensor sees a temperature greater than 75.0 degrees C for more than 30 seconds, and event will be logged.

Event Notifications can then be configured to be sent, with the options described in the following table.

Event Settings	
Description	The description of the sensor that will be viewed in the Summary page and in the body of alert messages
Threshold (for RJ45 sensors)	The threshold value of the measured unit that will trigger an event <b>Note: The trigger value can be a value that is considered a sensor's "normal" state, or its "alert" state.</b>
Threshold Type	The type of variation from the threshold value that indicates a condition (greater than or less than)
Trigger Status (for digital inputs)	The condition of the sensor that indicates a triggered state (open or closed)
Event Delay	The amount of time the event must be triggered before an event is logged. This provides some protection against false alarms. The Event Delay value can be set for 0-999 seconds or minutes.
Event Notification Settings	
Group	Assign the Event to any group 1 -8 (see also page 42)
Notify Again Time	Enter the amount of time in seconds, minutes, or hours (1-999) before an alert message will be repeated
Notify on Return to Normal	The user can also be notified when the Event has returned to a non-triggered state by selecting the " <b>Notify when return to normal</b> " box for an Event.

Event Notification Settings (Continued)	
Auto Acknowledge	Place a checkmark in this box to have alert notifications in the summary page return to normal state automatically when an Event is no longer being triggered.
Enable Syslog Alerts	Place a checkmark in this box to have alert notifications sent via Syslog messages
Enable SNMP traps	Place a checkmark in this box to have alert notifications sent via SNMP traps (v2c)
Enable Email Alerts	Place a checkmark in this box to have alert notifications sent via Email
Email Subject	Enter the subject to be viewed when an email alert message is received
Attach IP Camera capture to email	Associate an Event with an IP camera. Select an IP camera from the drop-down box. An image will be captured and sent with the alert message when an alert is sent via e-mail. IP cameras that are monitored by the ENVIROMUX (page 33) will be available for this purpose.  <b>Note: To be able to send IP camera captures as e-mail attachments, viewer security (in your camera's configuration) needs to be disabled. Consult your IP camera manual to see if this feature is present and for instructions on how to do this.</b>
Enable SMS Alerts	Place a checkmark in this box to have alert notifications sent via SMS messages (requires a modem)

After all options are selected, click the “Save” button. This Event will now be added to the Events page (Figure 56). Up to 50 events can be defined. Events can be configured to trigger alerts by themselves, and/or be used in combination with other events to trigger Smart Alerts.

With Events defined, Smart Alerts (up to 20) can be configured to use Event combinations to send alert messages.

Smart Alerts			
No.	Smart Alert Description	Status	Action
1	<a href="#">Smart Alert #1</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
2	<a href="#">Smart Alert #2</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
3	<a href="#">Smart Alert #3</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
4	<a href="#">Smart Alert #4</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
5	<a href="#">Smart Alert #5</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
6	<a href="#">Smart Alert #6</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>
7	<a href="#">Smart Alert #7</a>	Normal	<a href="#">Ack</a> <a href="#">Dismiss</a> <a href="#">Delete</a>

[Add New Smart Alert](#)

Figure 59- Smart Alert summary page

From the side menu, select “Smart Alerts”, and “Smart Alerts” again. On the Smart Alerts page, click on “Add New Smart Alert”. A new numbered Smart Alert will be added to the summary page (above). To configure the Smart Alert, click on it.

A menu will open with many options to choose to make the best use of the information provided by the events.

### Smart Alert #8 Configuration

<b>Description</b>	
Description	Smart Alert #8 <small>Descriptive name for the Smart Alert</small>
<b>OR Events</b>	
None	
Available events:	None <a href="#">Add</a>
<b>AND Events</b>	
None	
Available events:	None <a href="#">Add</a>
<b>Smart Alert Configuration</b>	
Logical Function	OR <small>Logical function to be applied to OR and AND lists above</small>
Delay	30 Sec <small>Duration the logical fuction should be active before the Smart Alert is triggered</small>
<b>Smart Alert Notifications</b>	
Group	1 <small>Select which group the event belongs to</small>
Notify Again Time	30 Min <small>Time after which alert notifications will be sent again</small>
Notify on return to normal	<input checked="" type="checkbox"/> <small>Send a notification when this sensor returns to normal status</small>
Auto acknowledge	<input type="checkbox"/> <small>Automatically acknowledge alert when sensor returns to normal status</small>
Enable Syslog Alerts	<input type="checkbox"/> <small>Send alerts for this Smart Alert via syslog</small>
Enable SNMP Traps	<input type="checkbox"/> <small>Send alerts for this Smart Alert via SNMP traps</small>
Enable E-mail Alerts	<input checked="" type="checkbox"/> <small>Send alerts for this Smart Alert via e-mail</small>
E-mail Subject	Smart Alert #8 <small>Subject of e-mails sent for alerts</small>
Attach IP camera capture to e-mail	<input type="checkbox"/> Bench Camera <small>Attach captured image from selected IP camera to alert e-mail</small>
Enable SMS Alerts	<input type="checkbox"/> <small>Send alerts for this Smart Alert via sms</small>
<b>Smart Alert Command</b>	
Associated Output Relay	None <small>Which Output Relay should be associated with this smart alert</small>
Output Relay status on alert	Inactive <small>On alert, set the Output Relay state to this</small>
Output Relay status on return from alert	Inactive <small>On return to normal, set the Output Relay state to this</small>
<input type="button" value="Save"/>	

Figure 60- Smart Alert configuration

DESCRIPTION	
Description	Use the default description provided or enter the description you want to see on notifications received.
OR Events	
Available Events	Select from the predefined available Events (Figure 56) to have OR logic applied to a triggered Event
AND Events	
Available Events	Select from the predefined available Events (Figure 56) to have AND logic applied to a triggered Event
Smart Alert Configuration	
Logical Function	Logical function to be applied to the output of the logical status of the OR and AND lists to determine when a Smart Alert should be generated. Options include OR, AND, XOR, NOR and NAND
Delay	The amount of time the Smart Alert Event status must be in an alert condition before a Smart Alert message is triggered. This provides some protection against false alarms. The Delay value can be set for 0-999 seconds or minutes.
Smart Alert Notifications	
Group	Assign the Smart Alert to any group 1 -8 (see also page 42)
Notify Again Time	Enter the amount of time in seconds, minutes, or hours (1-999) before an alert message will be repeated
Notify on Return to Normal	The user can also be notified when the Smart Alert conditions have returned to the normal (non-triggered state) by selecting the " <b>Notify when return to normal</b> " box.
Auto Acknowledge	Place a checkmark in this box to have alert notifications in the summary page return to normal state automatically when Smart Alert conditions return to normal.
Enable Syslog Alerts	Place a checkmark in this box to have alert notifications sent via Syslog messages
Enable SNMP traps	Place a checkmark in this box to have alert notifications sent via SNMP traps (v2c)
Enable Email Alerts	Place a checkmark in this box to have alert notifications sent via Email
Email Subject	Enter the subject to be viewed when an email alert message is received
Attach IP Camera capture to email	Associate a Smart Alert with an IP camera. Select an IP camera from the drop-down box. An image will be captured and sent with the alert message when an alert is sent via e-mail. IP cameras that are monitored by the ENVIROMUX (page 33) will be available for this purpose.  <b>Note: To be able to send IP camera captures as e-mail attachments, viewer security (in your camera's configuration) needs to be disabled. Consult your IP camera manual to see if this feature is present and for instructions on how to do this.</b>
Enable SMS Alerts	Place a checkmark in this box to have alert notifications sent via SMS messages (requires a modem)
Smart Alert Command	
Associated Output Relay	Associate the Smart Alert with the operation of the output relay, or not <b>Note: Only one sensor or Smart Alert should be associated with the Output Relay at a time. Contradicting commands from two or more sensors or Smart Alerts will result in the output relay responding to the state directed by the last command received.</b>
Output Relay Status on Alert	State the output relay will be in when a Smart Alert is triggered
Output Relay Status on Return from Alert	State the output relay will be in when a Smart Alert is no longer being triggered

## More on Logical Functions

Using Logical Functions, you can select how to use or not use the reported state of an Event. You can combine the information from multiple Events to achieve an end result.

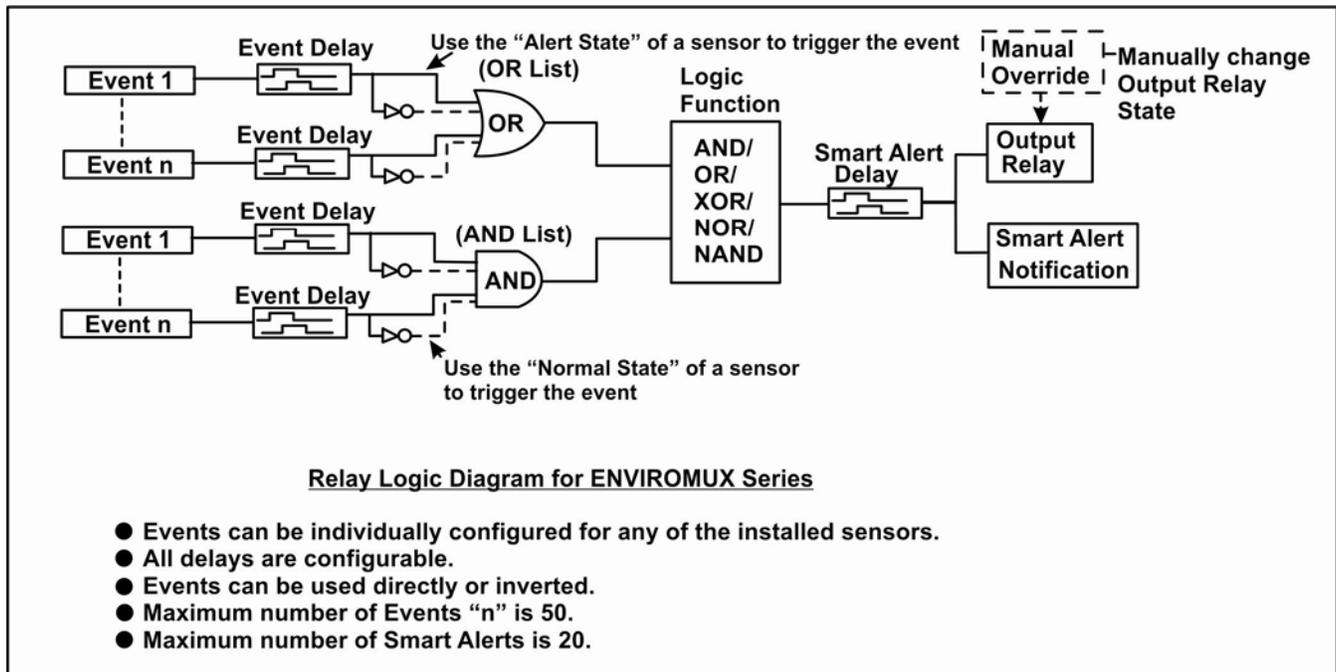


Figure 61- Event Logical Function Diagram

**Smart Alert Rules:**

- Any configured Event can be applied to either the OR Events list or the AND Events list, or both lists.
- Events can be configured to be triggered by a sensor or monitored device in alert state or in normal state.
- Each list will generate an output value, the value to either send an alert (1), or not (0).
  - If **any** Event in the OR list is triggered, the output value of the OR list will be 1.
  - **All** Events in the AND list must be triggered for the output value of the AND list to be 1.

The Logical Function combines the two values to determine if a Smart Alert should be sent, as detailed in the table below:

OR List	AND List	Logical Function	Smart Alert Generated
0	0	OR	No
1	0		Yes
0	1		Yes
1	1		Yes
0	0	XOR	No
1	0		Yes
0	1		Yes
1	1		No
0	0	AND	No
1	0		No
0	1		No
1	1		Yes

OR List	AND List	Logical Function	Smart Alert Generated
0	0	NOR	Yes
1	0		No
0	1		No
1	1		No
0	0	NAND	Yes
1	0		Yes
0	1		Yes
1	1		No

**Example:** If the OR list value is at 0, and AND list value is at 0, when the Logical Function is set to OR a Smart Alert will NOT be generated.

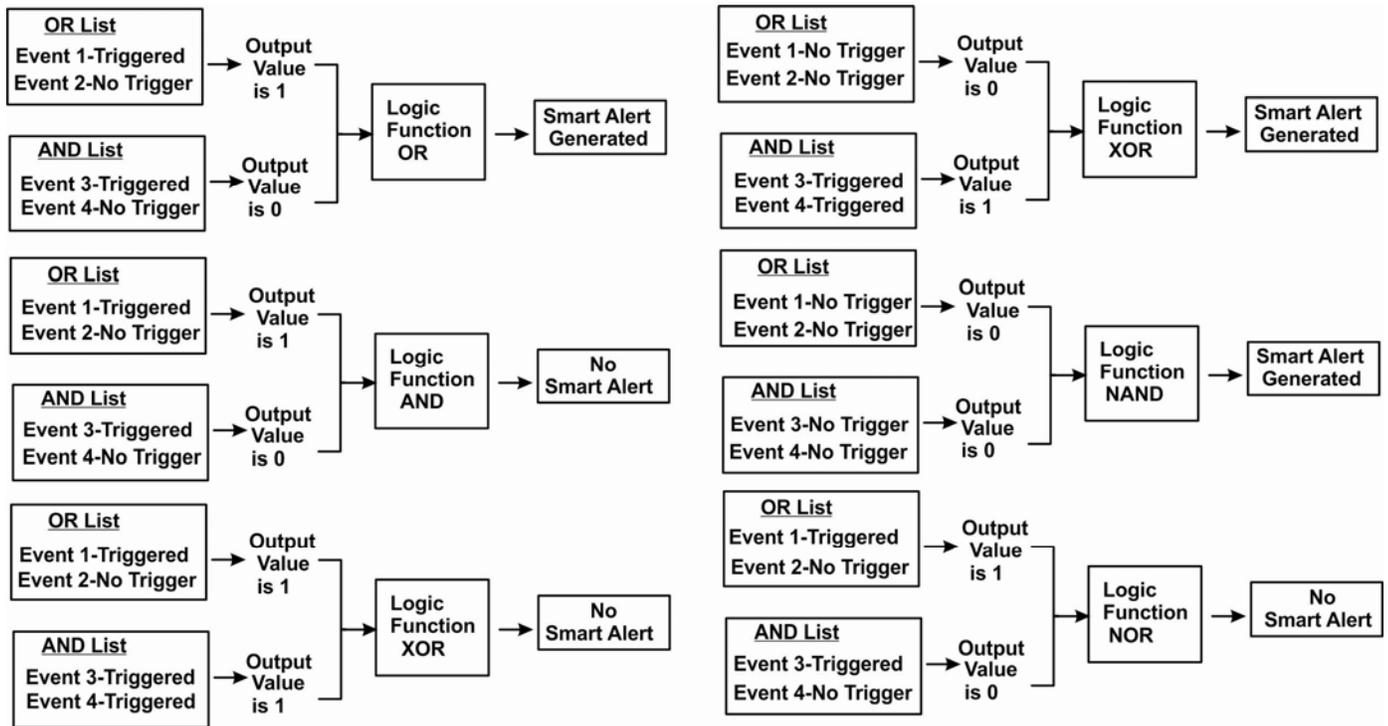


Figure 62- Examples of Smart Alert conditions

## Log

From the Log section there are three sub sections for configuring the ENVIROMUX:

<b>Monitoring</b>	View Event Log	View a log listing the date and time of events such as startups, shut downs, user logins
<b>Administration</b>	View Data Log	View data readings from sensors and IP addresses
<b>Log</b>	Log Settings	Configure how the logs are sent to users, how they handle reaching capacity, which users will be notified that it has reached capacity, and how they will be notified
View Event Log		
View Data Log		
Log Settings		
<b>Support</b>		
<b>Logout</b>		

### View Event Log

The Event Log provides the administrative user with a listing of many events that occur within the ENVIROMUX. The event log will record the date and time of:

- each ENVIROMUX startup,
- each user login and logout time,
- any time an unknown user tries to login,
- sensor and IP device alerts
- an alert handled by a user

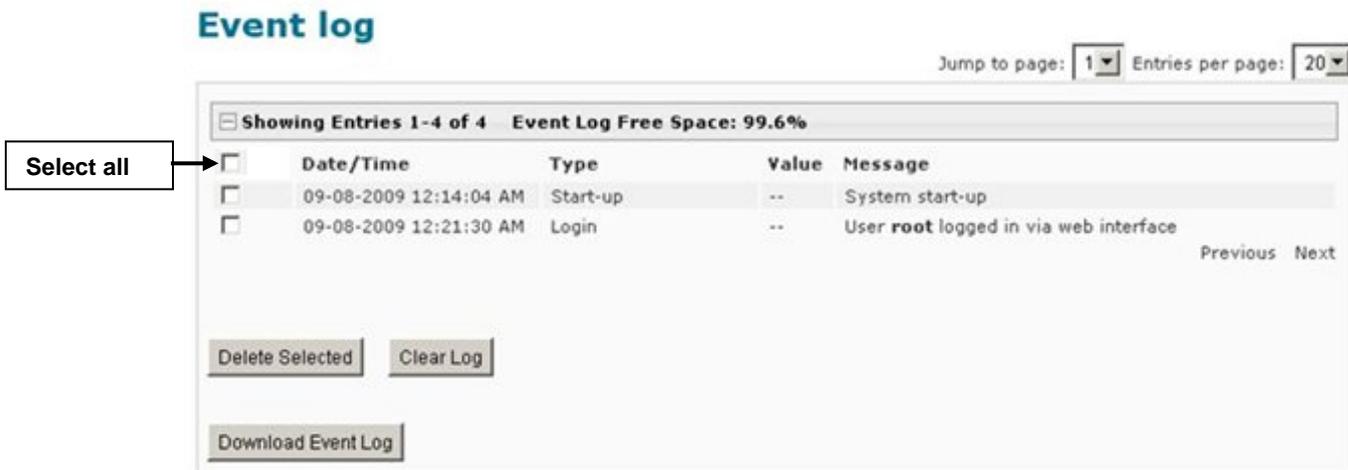


Figure 63- Event Log page

From the Event Log page the administrative user can view the logs, select specific logs to be deleted or press **Clear Log** to delete them all. The number of entries per page can be changed for the user's reading preference. Navigating between pages is as easy as clicking **Previous** or **Next** buttons, or jumping to a specific page if you know where the log entry you are interested in is listed.

To clear only specific log entries, place a checkmark in each line item to be deleted, and press **Delete Selected**. To select all entries at once, place a checkmark in the uppermost box. Before deleting, the user may want to save the log for future reference and to make space for more logs by downloading the event log to a file on a PC. Press **Download Event Log** to save the log file before clearing it.

## View Data Log

The Data Log provides the administrative user with a listing of all the readings taken by the ENVIROMUX pertaining to the sensors and IP Devices being monitored. The event log will record the date and time of each reading.

The screenshot shows the 'Data log' interface. At the top right, there are dropdown menus for 'Jump to page: 1' and 'Entries per page: 20'. Below this is a header bar that says 'Showing Entries 1-4 of 4 Data Log Free Space: 99.6%'. The main content is a table with the following data:

<input type="checkbox"/>	Date/Time	Type	Value	Description
<input type="checkbox"/>	09-08-2009 12:41:13 AM	Temperature Combo	29.2C	Undefined #1
<input type="checkbox"/>	09-08-2009 12:41:30 AM	Humidity Combo	30.6%	Undefined #1
<input type="checkbox"/>	09-08-2009 12:41:54 AM	IP Device	Responding	ENVIROMUX-MINI-no.1
<input type="checkbox"/>	09-08-2009 12:42:13 AM	IP Device	Responding	ENVIROMUX-MINI-no.2

Below the table are buttons for 'Delete Selected', 'Clear Log', and 'Download Data Log'. There are also 'Previous' and 'Next' navigation links at the bottom right of the table area. A callout box labeled 'Select all' points to the first checkbox in the table.

Figure 64- Data Log page

From the Data Log page the administrative user can view the logs, select specific logs to be deleted or press **Clear Log** to delete them all. The number of entries per page can be changed for the user's reading preference. Navigating between pages is as easy as clicking **Previous** or **Next** buttons, or jumping to a specific page if you know where the log entry you are interested in is listed.

To clear only specific log entries, place a checkmark in each line item to be deleted, and press **Delete Selected**. To select all entries at once, place a checkmark in the uppermost box. Before deleting, the user may want to save the log for future reference and to make space for more logs by downloading the event log to a file on a PC. Press **Download Data Log** to save the log file before clearing it.

## Log Settings

The Log Settings page (Figure 65) provides settings for how the ENVIROMUX will react when its Data and Event logs reach capacity.

The Event Log settings include a logging level that can be configured to log different amounts of information:

- Error : shows only system errors (like sending e-mail failures or SMS)
- Alerts: shows recorded system errors and alert messages
- Info: In addition to all of the above, the log will show less relevant information: user login/logout for example

Each log can be assigned to a group and any user that receives messages from that group can be notified when capacity is being reached.

The log can be set to either :

- Discontinue- stop logging information
- Clear and restart- delete all log entries and restart with new entries
- Wrap- continue logging but delete the oldest entries so new ones can be recorded

The Data and/or Event log can be set to send alerts to users via email, syslog, and/or SNMP traps once it has reached 90% of capacity, allowing them time to react.

The Data log can also be set to send log entries via email, syslog, or SNMP traps to users in addition to the entries it records internally. Enable Remote Logging for email, syslog, of SNMP as desired.

### Log Settings

**Event Log Settings**

**Logging Level** Info  
Select logging level

**Group** 2  
Select which group the event log belongs to

**Overflow Action** Discontinue Log  
Choose the action to take when the event log overflows

**Enable Syslog Alerts**   
When event log reaches 90% of capacity, send alerts via syslog

**Enable SNMP Traps**   
When event log reaches 90% of capacity, send alerts via SNMP traps

**Enable E-mail Alerts**   
When event log reaches 90% of capacity, send alerts via e-mail

---

**Data Log Settings**

**Group** 2  
Select which group the data log belongs to

**Overflow Action** Wrap  
Choose the action to take when the data log overflows

**Enable Syslog Alerts**   
When data log reaches 90% of capacity, send alerts via syslog

**Enable SNMP Traps**   
When data log reaches 90% of capacity, send alerts via SNMP traps

**Enable E-mail Alerts**   
When data log reaches 90% of capacity, send alerts via e-mail

**Enable Syslog Remote Logging**   
Send data log entries via Syslog messages

**Enable SNMP Remote Logging**   
Send data log entries via SNMP Traps

**Enable E-mail Remote Logging**   
Send data log entries via e-mail

---

**Log To Usb Flash Settings**

**Enable Log to Flash drive**   
Enable log to USB flash drive. Disable this before removing the flash drive

Apply a checkmark in this box to enable the recording of logs to the flash drive.

**Note: Be sure to remove the checkmark before removing a flash drive from the ENVIROMUX. Otherwise data on the drive may be lost.**

Figure 65- Log Settings page

### Log to USB Flash Settings

Event and Data log messages are automatically sent to users as configured above in addition to being recorded in the logs. The logs can also be downloaded as a tab-delimited plain text file. If a USB flash drive is present, logs will also be recorded on the flash drive to make them portable provided the feature is enabled.

The number of logs that can be recorded depends on the capacity of the flash drive installed. To begin recording to the flash drive, place a checkmark in the "Enable Log to Flash drive" box. Be sure to remove the checkmark before removing the flash drive from the ENVIROMUX or the data on the drive may be lost.

## Support

The Support section of the menu includes two links, Manual and Downloads.

The Manual link will open the pdf manual for the ENVIROMUX on the NTI website. You must have Adobe Reader installed on your PC to open this.

The Downloads link will take you to the Firmware Downloads page for the ENVIROMUX on the NTI website. All versions of firmware and MIB files for the ENVIROMUX will be found there, available for immediate download to your PC.



Figure 66- Support

## Logout

To logout of the ENVIROMUX user interface, click on the “Logout” section in the menu. A gray menu label will drop down. Click on the gray label to be immediately logged out. The login screen will appear, at which you can close your browser or log back in.

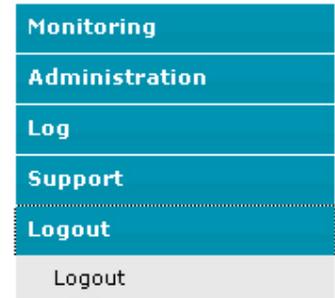


Figure 67- Logout

## OPERATION VIA TEXT MENU- ENVIROMUX

The ENVIROMUX can be controlled through a text menu using a terminal program (e.g. HyperTerminal) connected to the USB Console Port (page 8), or using the Telnet or the SSH protocol provided a connection has been made to the Ethernet Port (page 7). Either of these methods will work to access the ENVIROMUX text menu. The text menu can be used to control all functions of the ENVIROMUX as an alternative to the Web Interface (page 19).

### Connect to ENVIROMUX from a Terminal Program

*The following instruction will enable the user to quickly make connections using a terminal connected to the "USB CONSOLE" port after the drivers have been loaded (page 8). For instruction to make quick connection using the Ethernet port and Web Interface, see page 19.*

**Note: Drivers must first be installed on the PC (page 8) before the terminal program and USB CONSOLE port can be used.**

1. Make sure the ENVIROMUX is powered ON.
2. Using the serial console device connected to the port labeled "USB CONSOLE", start the terminal program (e.g. Windows HyperTerminal) and configure it as follows:
  - direct connection (using the appropriate CPU local serial Com port)
  - 115200 bps
  - 8 bits
  - no parity
  - 1 stop bit
  - no flow control
  - VT100 terminal mode.

**Note: To display special characters (German, Japanese, etc.) correctly in the Text Menu, use a terminal program that supports UTF8 character encoding (such as putty or TeraTerm). Also, the script may need to be set specific to your location."**

3. Press <Enter> and a login prompt will appear- "sems2d login:" , type <root> (all lowercase letters) and press <Enter>.
4. At "Username: " type <root> (all lowercase letters) and press <Enter>.
5. At "Password" type <nti> (all lowercase letters) and press <Enter>.

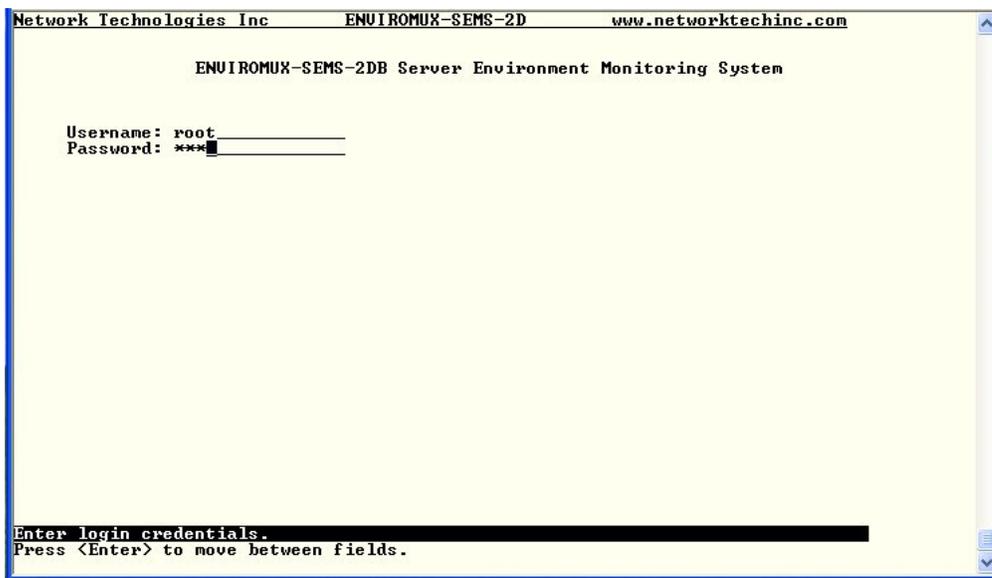


Figure 68- Text Menu Login screen

**Note: User names and passwords are case sensitive. It is important to know what characters must be capitalized and what characters must not.**

**Note: Only the user "root" can access the text menu when connected through the "USB CONSOLE" port.**

## Connect to ENVIROMUX from Command Line

To access the Text Menu from the command line, the ENVIROMUX must first be connected to the Ethernet (page 7).

### Connect Via Telnet

**Note: Telnet must be enabled for a connection via Telnet to be possible (page 40)**

To open a telnet session to the ENVIROMUX, Issue the following command from the command line:

```
telnet <ENVIROMUX hostname or IP address>
```

<ENVIROMUX hostname> is the hostname configured in the workstation where the telnet client will run (through /etc/hosts or DNS table). It can also be just the IP address of the ENVIROMUX (default is 192.168.1.23).

The user will be prompted for username and password to connect to the ENVIROMUX.

### Connect Via SSH

To open an SSH session to a serial port, issue the following command from the command line:

```
ssh -l <Username> <ENVIROMUX hostname or IP address>
```

<Username> is any user configured to access the ENVIROMUX (as defined in the list of users (page 42).

<ENVIROMUX hostname> is the hostname configured in the workstation where the SSH client will run (through /etc/hosts or DNS table). It can also be just the IP address of the ENVIROMUX (default is 192.168.1.23).

The user will be prompted for a password to connect to the ENVIROMUX.

The main menu of the Text Menu will be displayed whether you are connecting via USB Console, Telnet, or SSH.

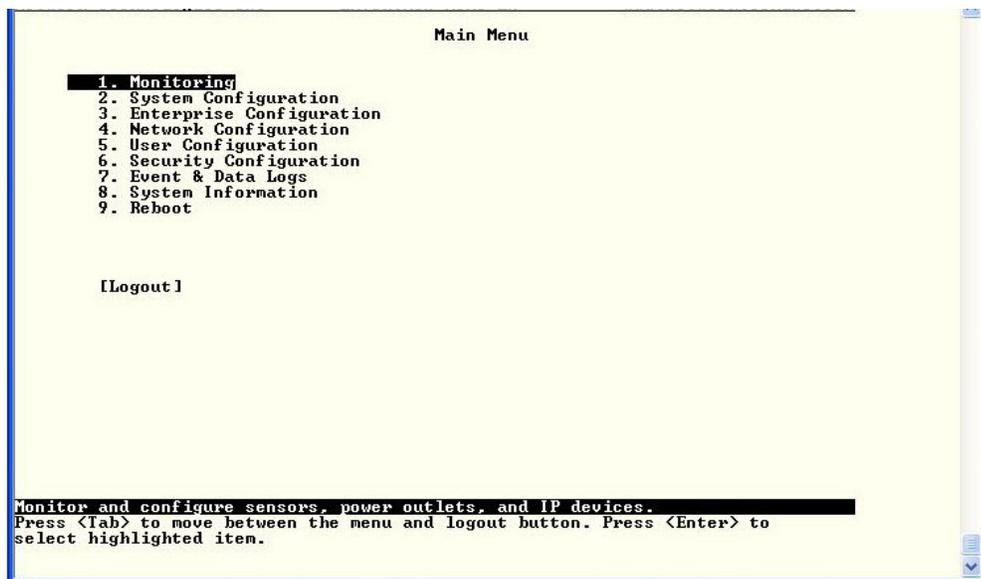


Figure 69- Text Menu- Administrator Main Menu

If you are a user with only user privileges (no administrative privileges), the text menu will have more limited options.

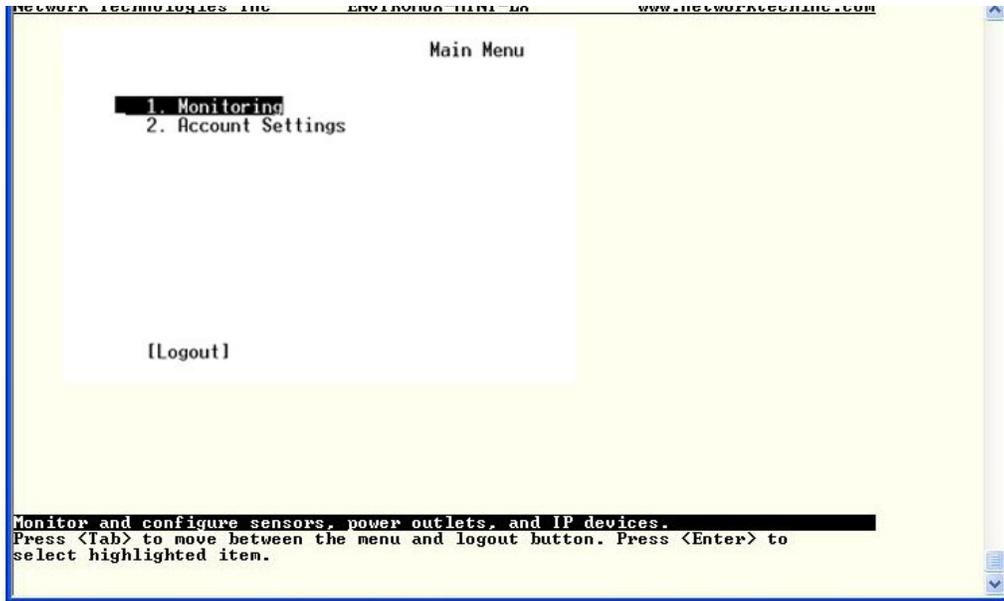


Figure 70- Text Menu- User Main Menu

For more on the Text Menu options for non-administrative users, see page 98.

## Using the Text Menu

### Text Menu Navigation

- To move up and down the numbered menu items or toggle through field options, use the arrow keys.
- To jump from menu item to another quickly, press the numbered key above the QWERTY keys (**the numberpad number keys are not used**).
- To move from menu list to action key (such as “Logout” in Figure 70 above), press <Tab>.
- To exit an action or menu, press <Esc>.
- To select a highlighted item or move to another field in a configuration page, press <Enter>.
- Be sure to Tab to “Save” and press <Enter> when configuration changes are made.
- To return from “Save” back to a field on the configuration page, press <Tab>.

The Administrators Main Menu is broken into 9 categories:

Function	Description
Monitoring	Monitor and configure the sensors, accessories and IP devices
System Configuration	Set the ENVIROMUX time settings or reset the unit to factory default settings
Enterprise Configuration	Configure system settings
Network Configuration	Configure network settings
User Configuration	Configure user access settings
Security Configuration	Configure security settings
Event and Data Logs	View and configure the Event and Data Logs (page 94)
System Information	View system and network settings
Reboot	Enables the user to reboot the ENVIROMUX

## Monitoring

The Monitoring menu lists choices for viewing the status of items monitored by the ENVIROMUX as well as for configuring how they are monitored and how or if alert messages will be sent.

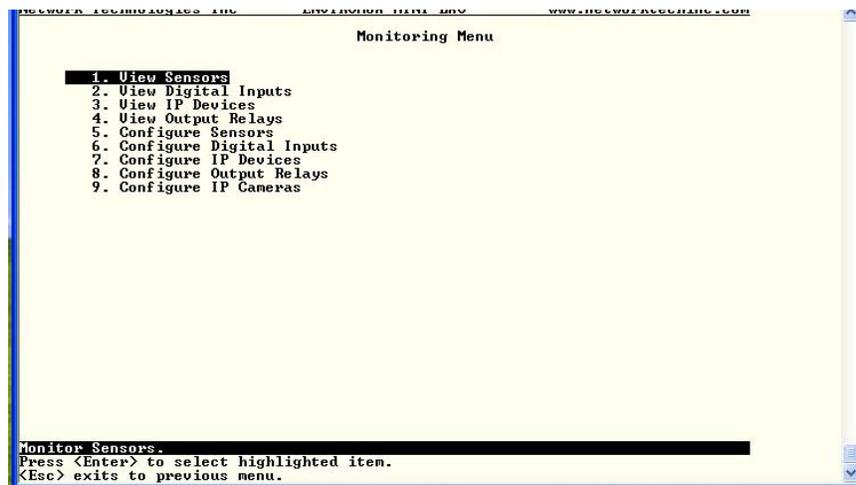


Figure 71- Text Menu-Monitoring Menu

### View Sensors

The View Sensors selection will show the present status of each analog sensor connected to the ENVIROMUX.

The current value being reported by the sensor and the state (whether Normal or Alert) will be shown. If the sensor is in alert status, pressing the <Enter> key would provide the option to either **acknowledge** the alert or **dismiss** it.

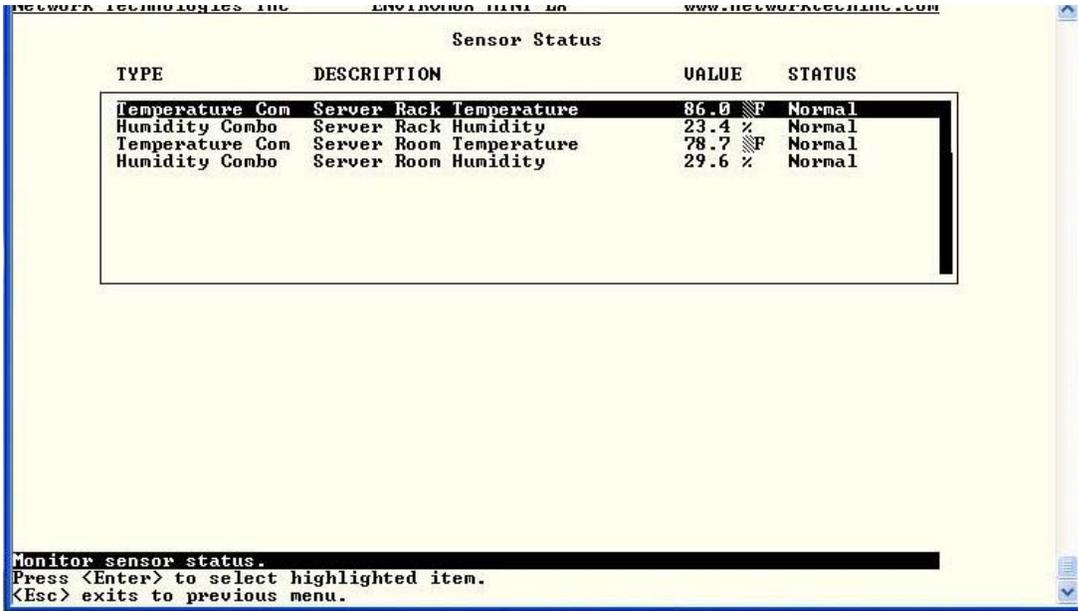


Figure 72- Text Menu-Sensor Status

### View Digital Inputs

The View Digital Inputs selection will show the present status of each dry contact sensor connected to the ENVIROMUX.

The current value being reported by the sensor and the state (whether Normal or Alert) will be shown. If the sensor is in alert status, pressing the <Enter> key would provide the option to either **acknowledge** the alert or **dismiss** it.

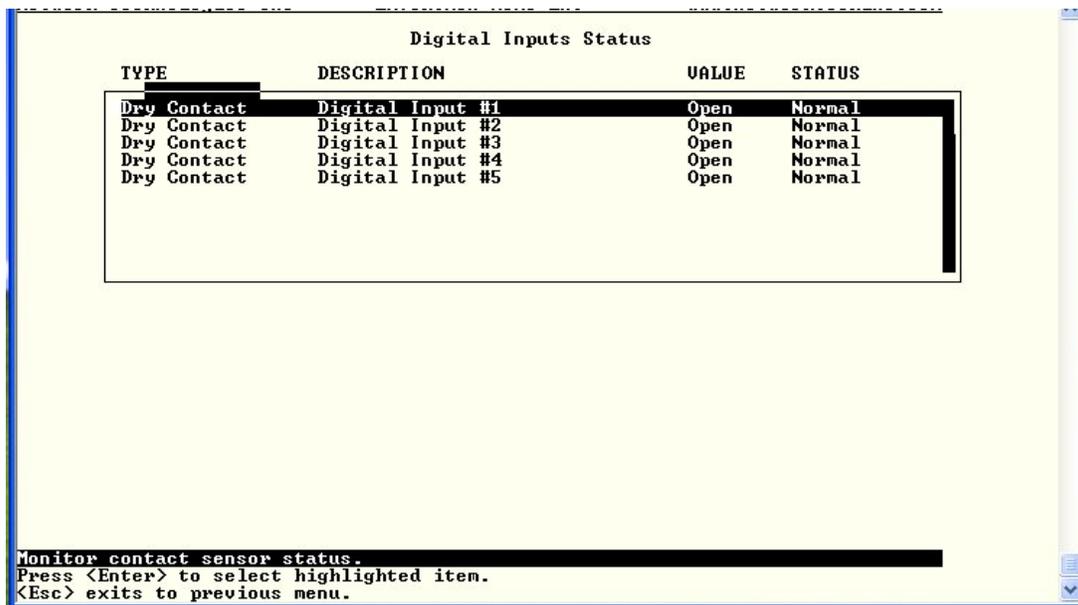


Figure 73- Text Menu- Digital Input Status

### View IP Devices

The View IP Devices selection will show the present status of each IP Device monitored by the ENVIROMUX. The current value being reported by the IP Device and the state (whether Normal or Alert) will be shown. If the IP Device is in alert status, pressing the <Enter> key would provide the option to either **acknowledge** the alert or **dismiss** it.

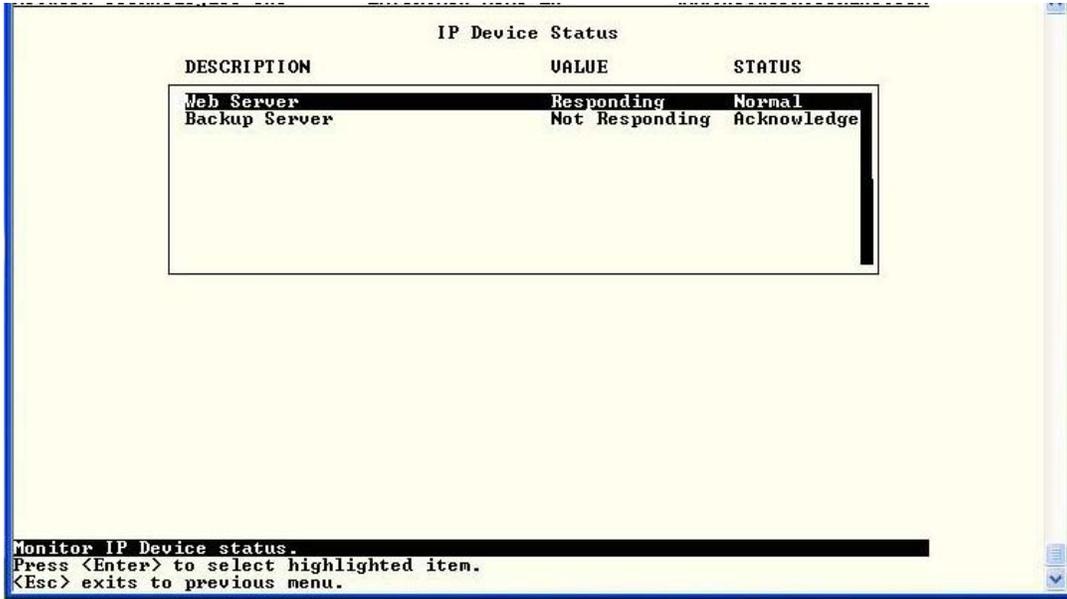


Figure 74- Text Menu-View IP Devices

### View Output Relay

The View Output Relay selection will show the present state of the Output Relay on the ENVIROMUX. To manually change its state, press <Enter> and select between Inactive and Active.

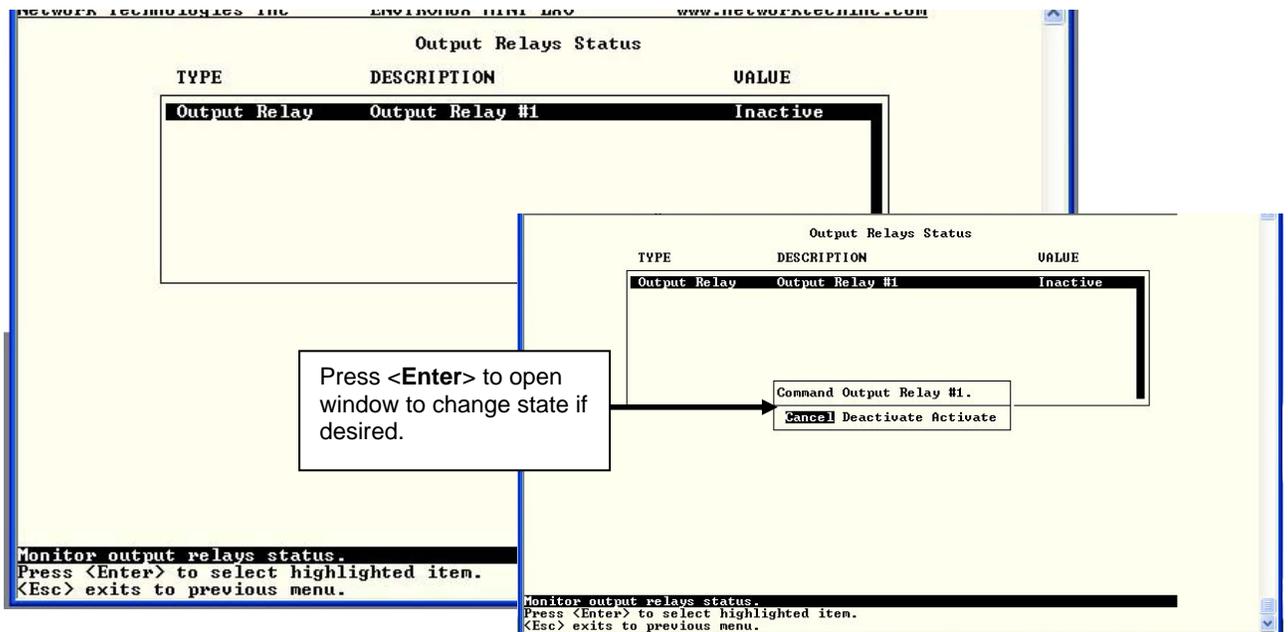


Figure 75- Text Menu- View Output Relay Status

### Configure Sensors

The Configure Sensors menu lists the temperature and humidity sensors connected to the ENVIROMUX. Press <Enter> to open the configuration menu for the selected sensor.

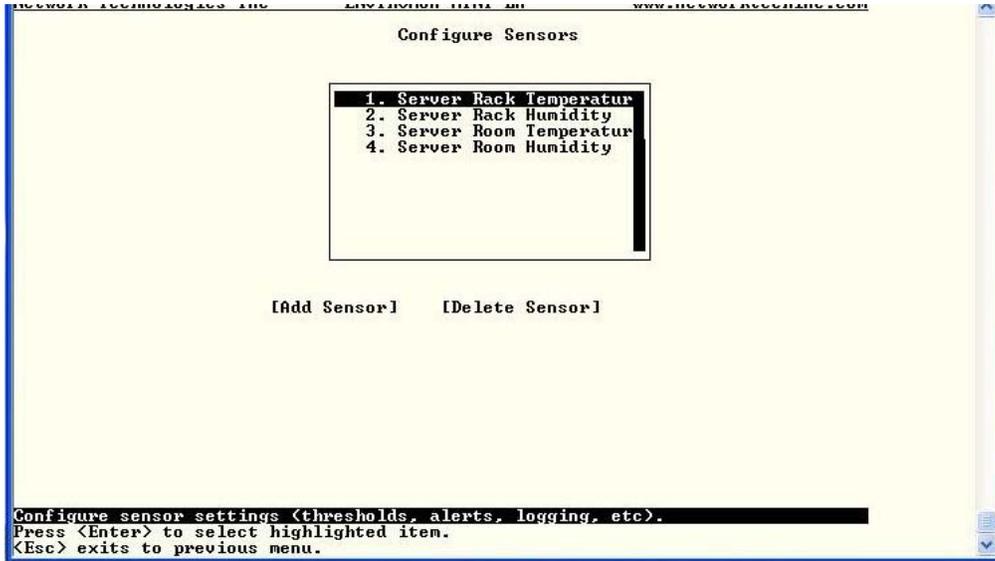


Figure 76- Text Menu-Configure Sensors list

The configuration menu for the sensor includes options to enter the Sensor Settings, Non-Critical Alert Settings, Critical Alert Settings, and Data Logging.

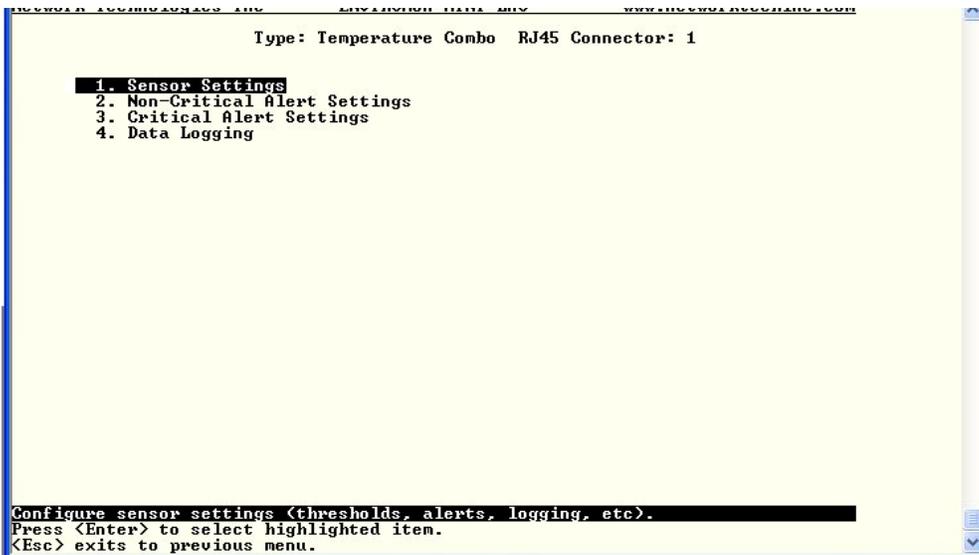


Figure 77- Text Menu-Configuration Menu for Sensor

From the Sensor Settings menu enter the Description for the sensor and select which sensor group the sensor should belong to (1 or 2).

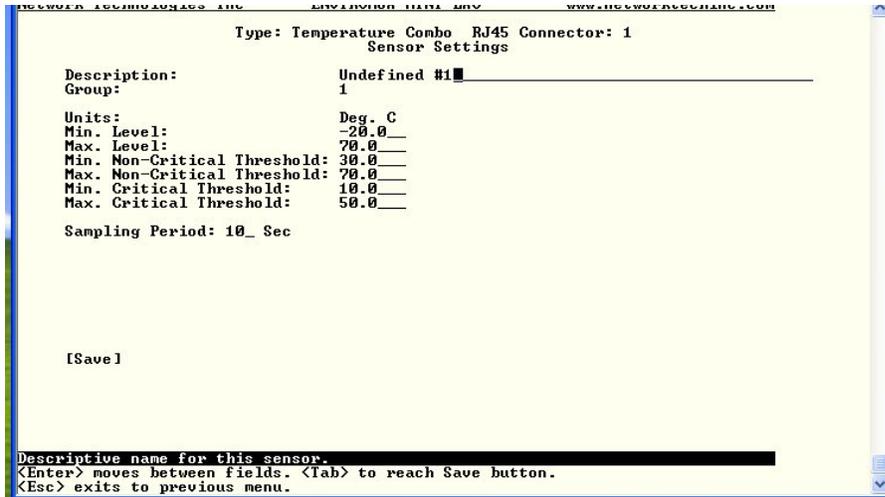


Figure 78- Text Menu-Sensor Settings

Sensor Settings	Description
Description	The description of the sensor that will be viewed in the Summary page and in the body of alert messages
Group	Assign the sensor to a group (1 -8) (see also page 88)
Units	This lets the operator choose between Celsius and Fahrenheit as the temperature measurement unit.
Min. Level	Displays the minimum value that this sensor will report
Max. Level	Displays the maximum value that this sensor will report
Minimum Non-Critical -Threshold	The user must define the lowest acceptable value for the sensors. If the sensor measures a value below this threshold, the sensor will move to non-critical alert status. The assigned value should be <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level and</li> <li>➤ lower than the assigned Maximum Threshold value.</li> </ul> If values out of the range are entered, and error message will be shown.
Maximum Non-Critical Threshold	The user must define the highest acceptable value for the sensors. If the sensor measures a value above this threshold, the sensor will move to non-critical alert status. The assigned value should be <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level and</li> <li>➤ higher than the assigned Minimum Threshold value.</li> </ul> If values out of the range are entered, and error message will be shown.
Minimum Critical Threshold	The user must define the lowest acceptable value for the sensors. If the sensor measures a value below this threshold, the sensor will move to alert status. The assigned value should be <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level,</li> <li>➤ lower than the assigned Maximum Threshold value, and</li> <li>➤ lower than the Minimum Non-Critical Threshold value.</li> </ul> If values out of the range are entered, and error message will be shown.
Maximum Critical Threshold	The user must define the highest acceptable value for the sensors. If the sensor measures a value above this threshold, the sensor will move to alert status. The assigned value should be <ul style="list-style-type: none"> <li>➤ within the range defined by Minimum Level and Maximum Level,</li> <li>➤ higher than the assigned Minimum Threshold value, and</li> <li>➤ higher than the Maximum Non-Critical Threshold value.</li> </ul> If values out of the range are entered, and error message will be shown.
Sampling Period	Determines how often the displayed sensor value is refreshed on the Sensor page. A numeric value and a measurement unit (minimum 1 seconds, maximum 999 minutes) should be entered.

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

From the Non-Critical or Critical Alert Settings menu, the user can enable/disable alert messages to be sent when the sensor is in an alert state and configure when and how alert messages are sent. Additionally, from the Critical Alert Settings menu, the user can configure the ENVIROMUX to capture a snapshot from an IP camera and attach the image to the alert message sent via email.

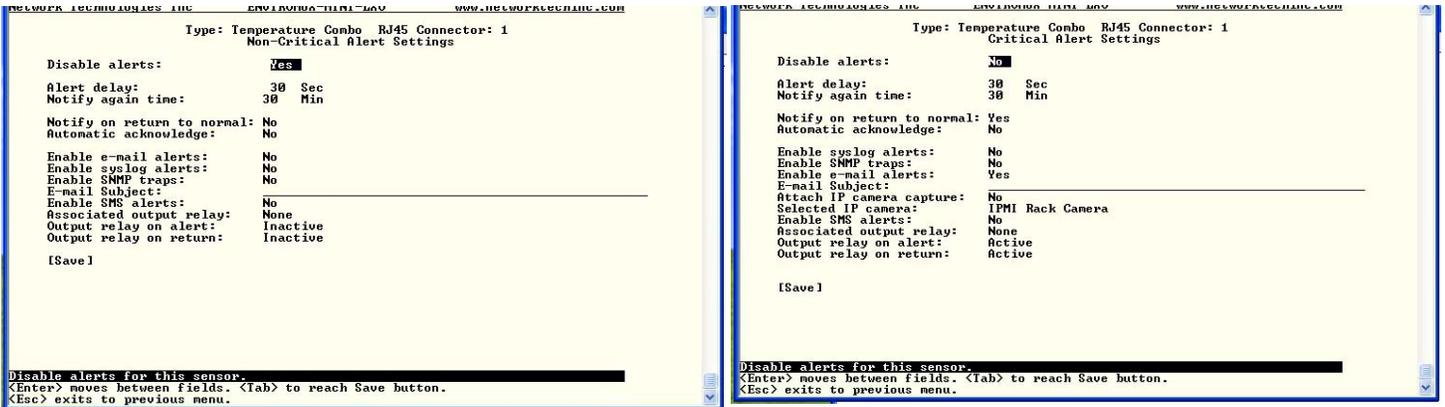


Figure 79- Text Menu-Non-Critical and Critical Alert Settings

Alert Settings	
Disable alerts	Change to "Yes" to prevent alerts from being sent when this sensor's status changes
Alert Delay	The alert delay is an amount of time the sensor must be in an alert condition before an alert is sent. This provides some protection against false alarms. The Alert Delay value can be set for 0-999 seconds or minutes.
Notify Again Time	Enter the amount of time in seconds, minutes, or hours (1-999) before an alert message will be repeated
Notify on Return to Normal	The user can also be notified when the sensor readings have returned to the normal range by changing to "Yes" for " <b>Notify on return to normal</b> " for a sensor.
Auto Acknowledge	Change to "Yes" to have alert notifications in the summary page return to normal state automatically when sensor readings return to normal.
Enable Email Alerts	Change to "Yes" to have alert notifications sent via Email
Enable Syslog Alerts	Change to "Yes" to have alert notifications sent via Syslog messages
Enable SNMP traps	Change to "Yes" to have alert notifications sent via SNMP traps (v2c)
Enable SMS Alerts	Change to "Yes" to have alert notifications sent via SMS (requires GSM modem)
Email Subject	Enter the subject to be viewed when an email alert message is received
Attach IP camera capture	Change to "Yes" to enable a snapshot to be taken from an IP camera and attached to the alert message (for critical alert messages only.)
Selected IP camera	Select which IP camera to take a snapshot from to be attached to an alert message (for critical alert messages only)
Associated output relay	Choose which output relay to change state when sensor is in alert
Output relay on alert	Choose the state the output relay should be in when the sensor is in alert
Output relay on return	Choose the state the output relay should be in when the sensor returns to normal

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

From the Data Logging menu for the sensor, the user can decide if the data sampled should be recorded in the Data Log and how frequently.

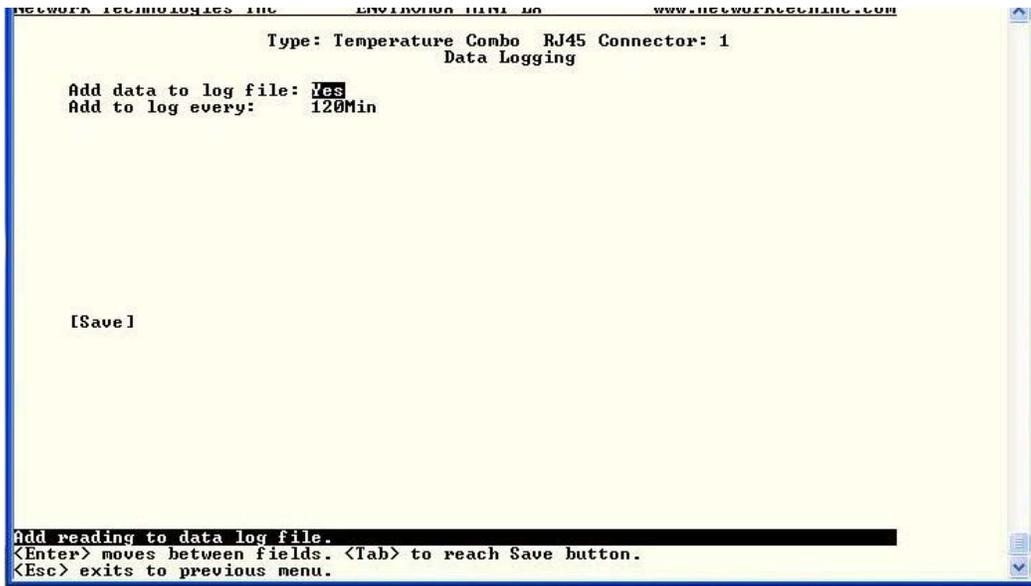


Figure 80- Text Menu-Sensor Data Logging

### Configure Digital Inputs

The Configure Digital Input Sensors menu lists the contact sensors connected to the ENVIROMUX. Press <Enter> to open the configuration menu for the selected contact sensor. (The Water Sensor menu contains the same options as the contact sensor menus.) The configuration menu for the Digital Inputs includes options to enter the Digital Input Settings, Alert Settings, and Data Logging.

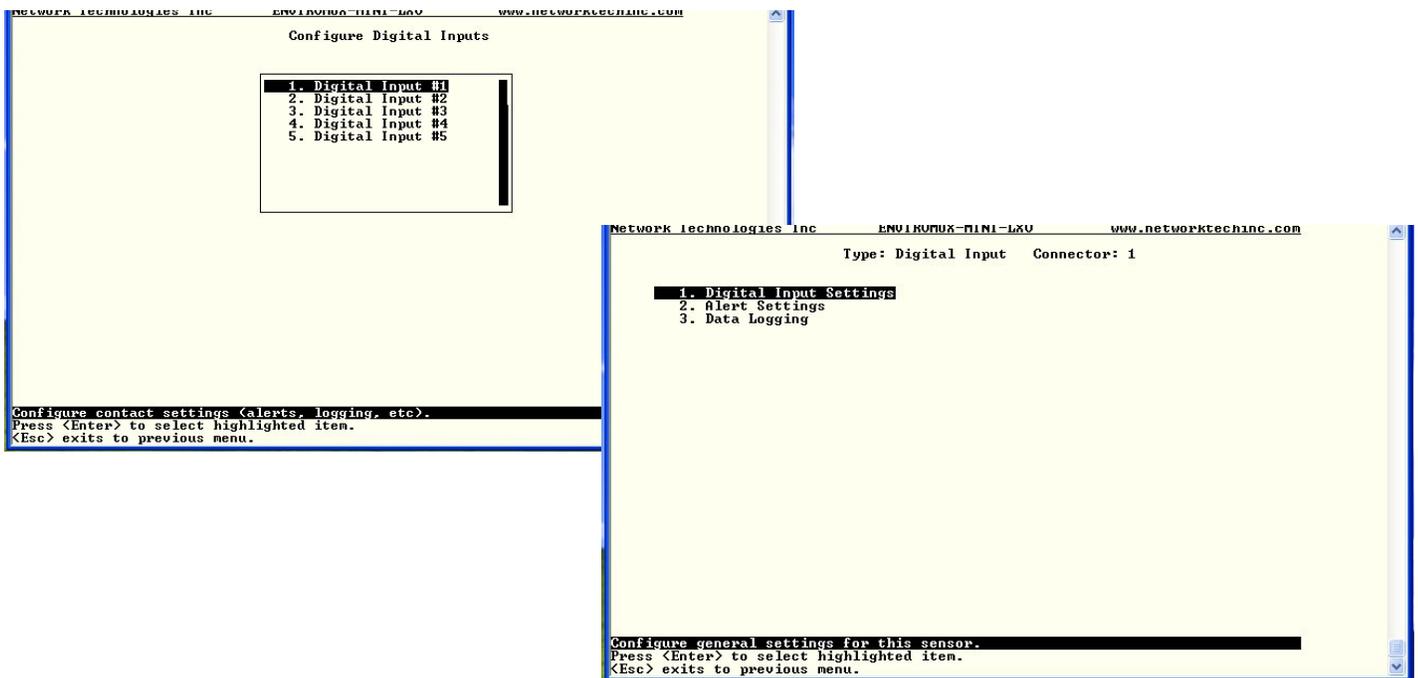


Figure 81- Configure Digital Input Sensors

Water sensors and contact sensors are each configured much like the temperature and humidity sensors previously described. Only the Sensor Settings menu (below) is different. Alert settings and data logging menus are as seen in Figure 79 and Figure 80.

Instead of threshold and minimum/maximum levels settings, water sensors and contact sensors are either open contact or closed contact sensors. Therefore, the field “**Normal Status**” is provided to select the status of the sensor when it is not in an alert state. Select between **Open** contacts, or **Close** contacts for the normal status of the sensor. (Water sensors are open contact when not in an alert state.)

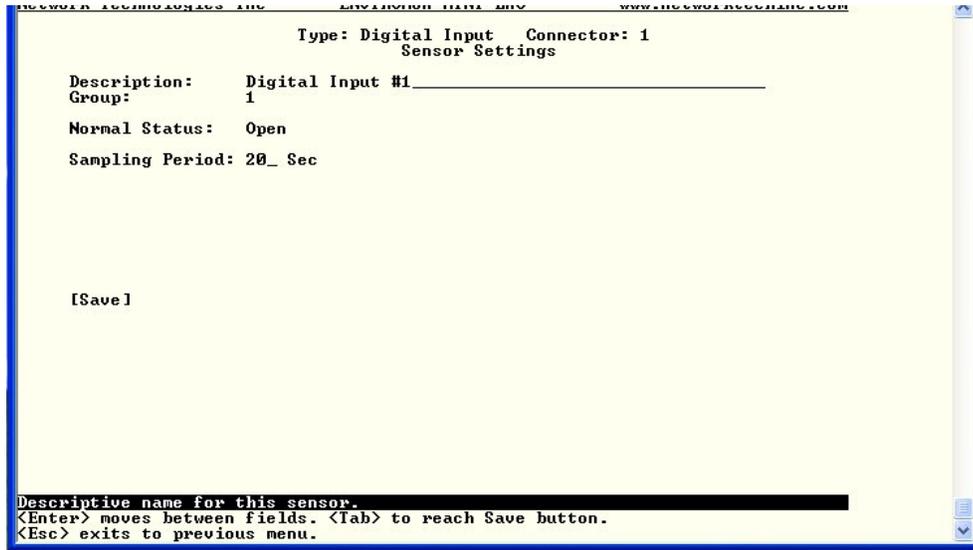


Figure 82- Digital Input Sensor Settings Menu

From the Alert Settings menu, the user can enable/disable alert messages to be sent when the sensor is in an alert state and configure when and how alert messages are sent.

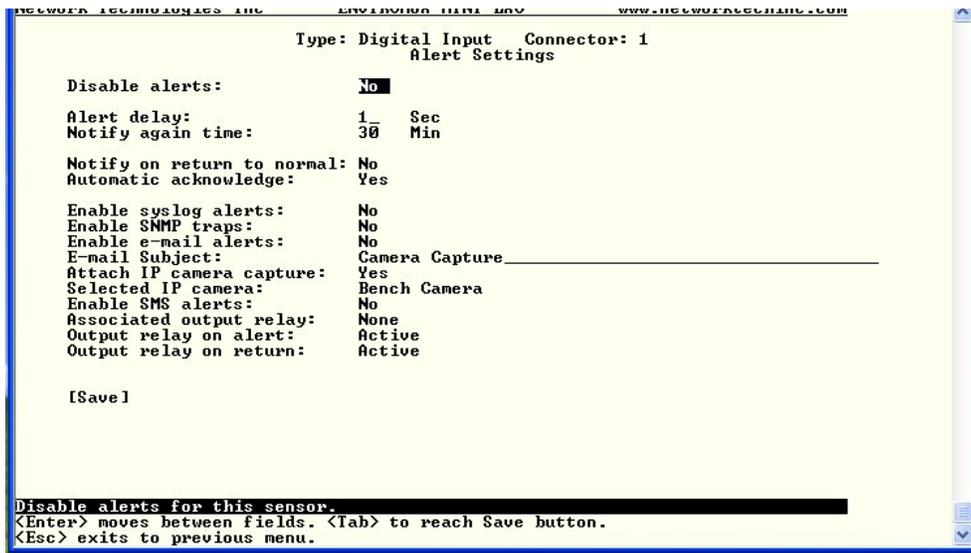


Figure 83- Digital Input Alert Settings

Alert Settings	
Disable alerts	Change to "Yes" to prevent alerts from being sent when this sensor's status changes
Alert Delay	The alert delay is an amount of time the sensor must be in an alert condition before an alert is sent. This provides some protection against false alarms. The Alert Delay value can be set for 0-999 seconds or minutes.
Notify Again Time	Enter the amount of time in seconds, minutes, or hours (1-999) before an alert message will be repeated
Notify on Return to Normal	The user can also be notified when the sensor readings have returned to the normal range by changing to "Yes" for " <b>Notify on return to normal</b> " for a sensor.
Auto Acknowledge	Change to "Yes" to have alert notifications in the summary page return to normal state automatically when sensor readings return to normal.
Enable Syslog Alerts	Change to "Yes" to have alert notifications sent via Syslog messages
Enable SNMP traps	Change to "Yes" to have alert notifications sent via SNMP traps (v2c)
Enable Email Alerts	Change to "Yes" to have alert notifications sent via Email
Email Subject	Enter the subject to be viewed when an email alert message is received
Attach IP camera capture	Change to "Yes" to enable a snapshot to be taken from an IP camera and attached to the alert message (for critical alert messages only.)
Selected IP camera	Select which IP camera to take a snapshot from to be attached to an alert message (for critical alert messages only)
Enable SMS Alerts	Change to "Yes" to have alert notifications sent via SMS (requires GSM modem)
Associated output relay	Choose which output relay to change state when sensor is in alert
Output relay on alert	Choose the state the output relay should be in when the sensor is in alert
Output relay on return	Choose the state the output relay should be in when the sensor returns to normal

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

From the Data Logging menu for the Digital Input sensor, the user can decide if the data sampled should be recorded in the Data Log and how frequently.

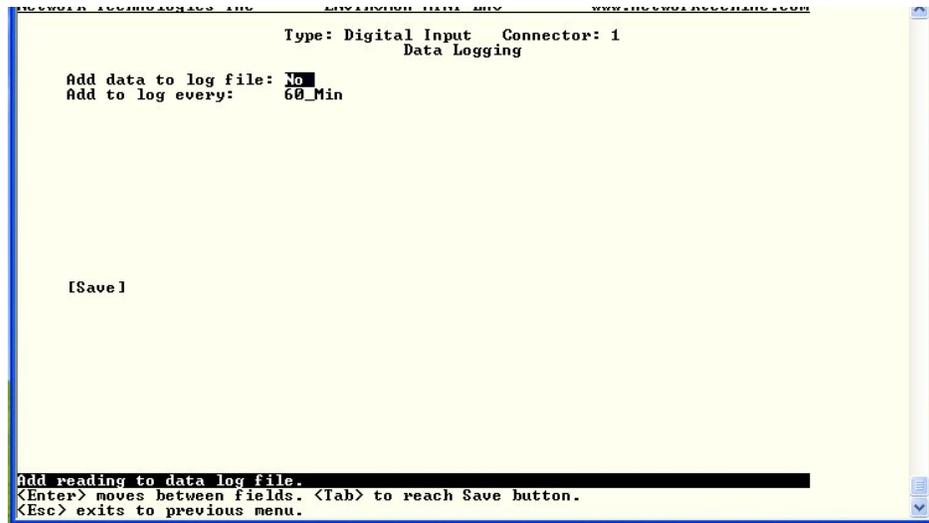


Figure 84- Data Logging for Digital Input Sensors

### Configure IP Devices

The Configure IP Devices menu lists the IP Devices monitored by the ENVIROMUX. Press <Enter> to open the configuration menu for the selected IP Device.

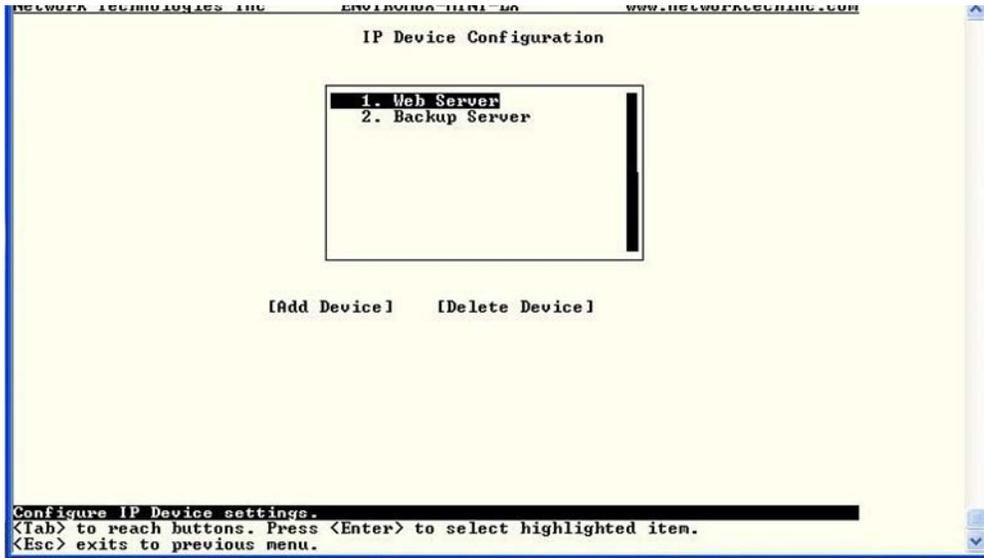


Figure 85- Text Menu-Configure IP Devices List

The configuration menu for the IP Device includes options to enter the IP Device Settings, Alert Settings, and Data Logging.

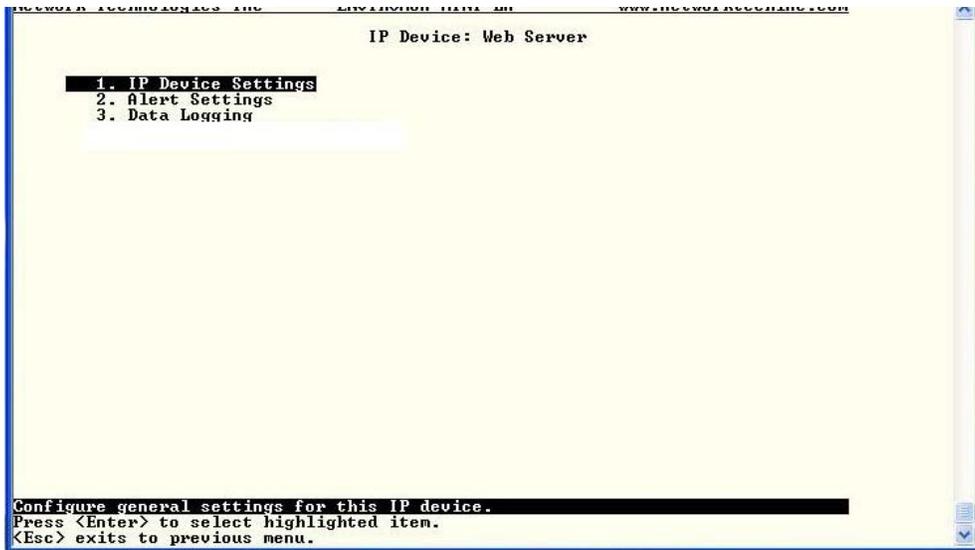


Figure 86- Text menu-Configuration Menu for IP Devices

From the IP Device Settings menu, the user can enter the name and address of the IP Device, assign a sensor group, and define how the IP Device will be monitored.

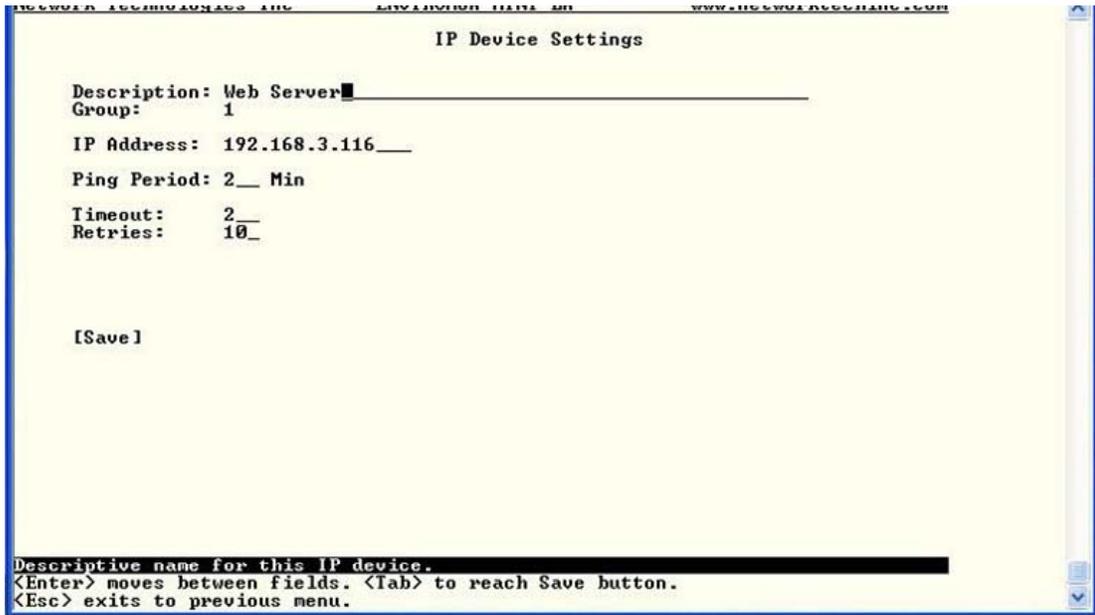


Figure 87-Text Menu-IP Device Settings

IP Device Settings	Description
Description	The description of the IP Device that will be viewed in the Summary page and in the body of alert messages
Group	Assign the IP device to a group (1 -8)
IP Address	The IP address of the IP Device
Ping Period	Enter the frequency in minutes or seconds that the ENVIROMUX should ping the IP Device
Timeout	Enter the length of time in seconds to wait for a response to a ping before considering the attempt a failure
Retries	Enter the number of times the ENVIROMUX should ping a non-responsive IP device before changing its status from normal to alarm and sending an alert

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

From the Alert Settings menu, the user can enable/disable alert messages to be sent when the IP Device is not responding and configure when and how alert messages are sent.

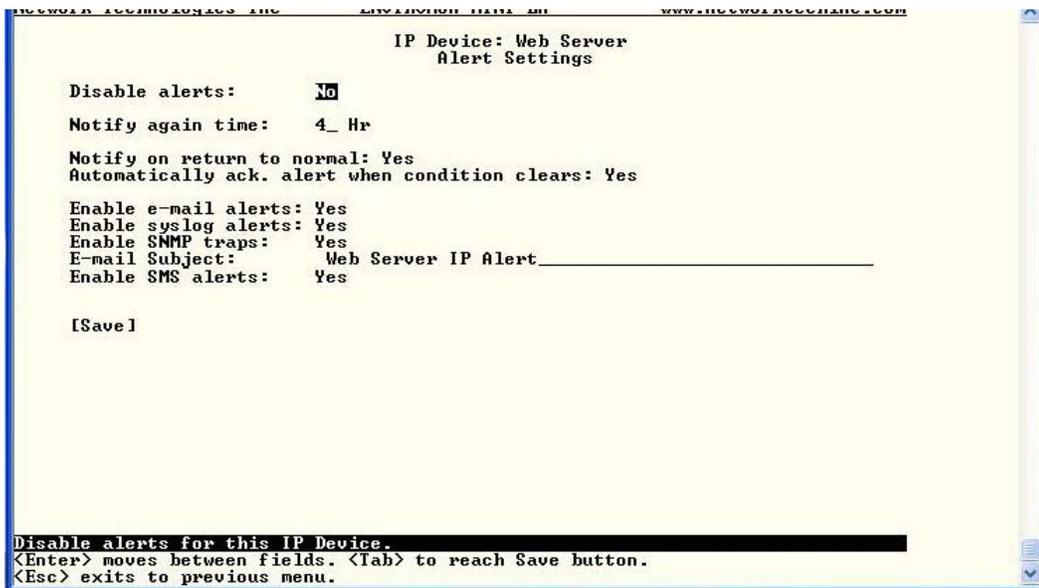


Figure 88- Text Menu-IP Device Alert Settings

Alert Settings	Description
Disable alerts	Change to "Yes" to prevent alerts from being sent when this IP Device's status changes
Alert Delay	The alert delay is an amount of time the IP Device must be in an alert condition before an alert is sent. This provides some protection against false alarms. The Alert Delay value can be set for 0-999 seconds or minutes.
Notify Again Time	Enter the amount of time in seconds, minutes, or hours (1-999) before an alert message will be repeated
Notify on Return to Normal	The user can also be notified when the IP Device's state has returned to the normal by changing to "Yes" for " <b>Notify on return to normal</b> " for a sensor.
Auto Acknowledge	Change to "Yes" to have alert notifications in the summary page return to normal state automatically when sensor readings return to normal.
Enable Email Alerts	Change to "Yes" to have alert notifications sent via Email
Enable Syslog Alerts	Change to "Yes" to have alert notifications sent via Syslog messages
Enable SNMP traps	Change to "Yes" to have alert notifications sent via SNMP traps (v2c)
Enable SMS Alerts	Change to "Yes" to have alert notifications sent via SMS (requires GSM modem)
Email Subject	Enter the subject to be viewed when an email alert message is received

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

From the Data Logging menu for the IP Device, the user can decide if the data sampled should be recorded in the Data Log and how frequently.

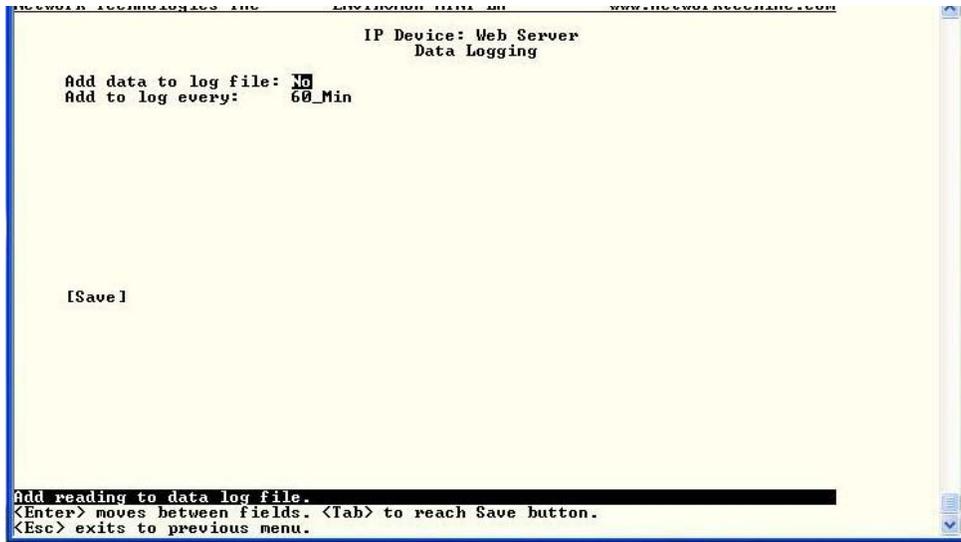


Figure 89- Text Menu-IP Device Data Logging

### Configure Output Relay

From the Monitoring menu, the user can select to configure the Output Relay. You will first be presented with the Output Relays list (only one in this product). Press <Enter> to be given a choice of configuring Output Relay Settings or Alert Settings to associate with the relay state.

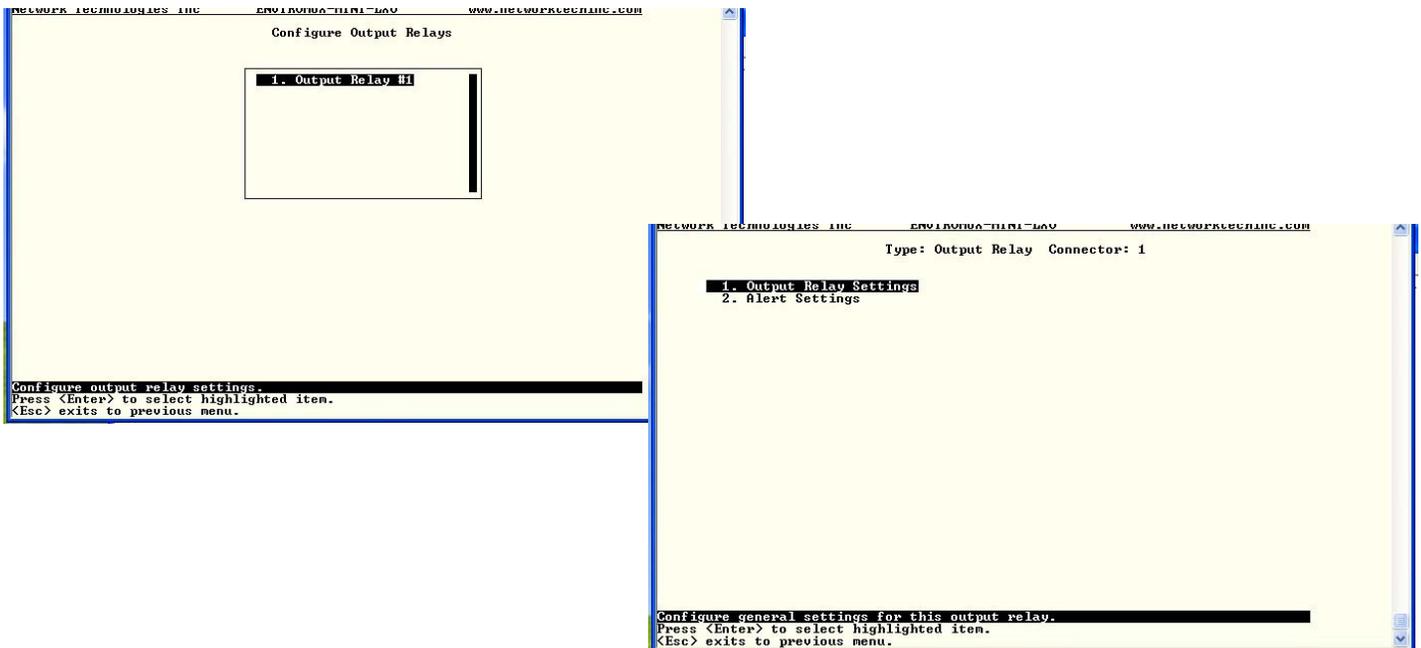


Figure 90- Text Menu- Select Configure Output Relay

Select the Output Relay Settings to access a menu where the description of the Output Relay can be defined. This definition will be presented in the View Output Relays list as well as in the description field when viewing the list through the WEB interface (page 20).

The group this relay will be associated with can be defined here to determine who will receive alerts generated by the relay state change, if any.

The "Normal Status" of the relay is defined here which determines what the ENVIROMUX will consider a normal versus alert condition for the relay.

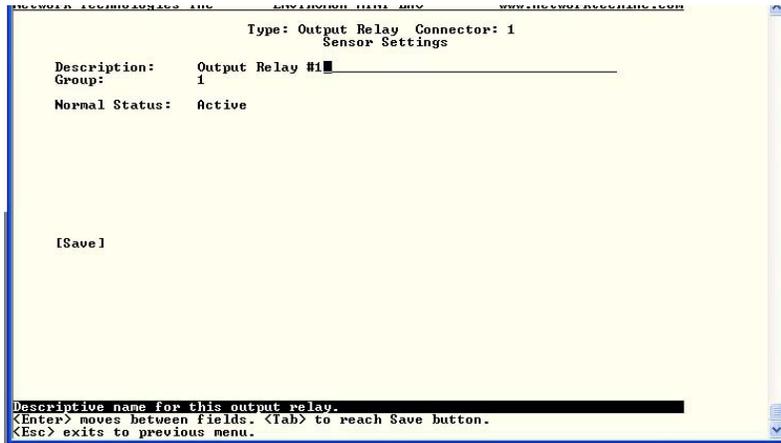


Figure 91- Text Menu- Output Relay Settings

Select the Alert Settings to access a menu for enabling alert messages that can be sent when the relay changes from its "Normal" state.

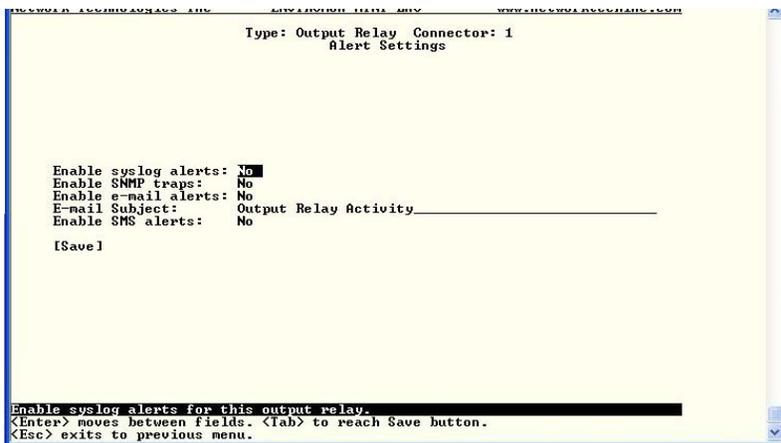


Figure 92- Text Menu- Output Relay Alert Settings

### Configure IP Cameras

From the Monitoring menu, the user can select to configure IP Cameras. You will first be presented with the IP Cameras list (up to 8 can be configured). Select an IP Camera in the list and press <Enter> to open the IP Camera Settings menu.

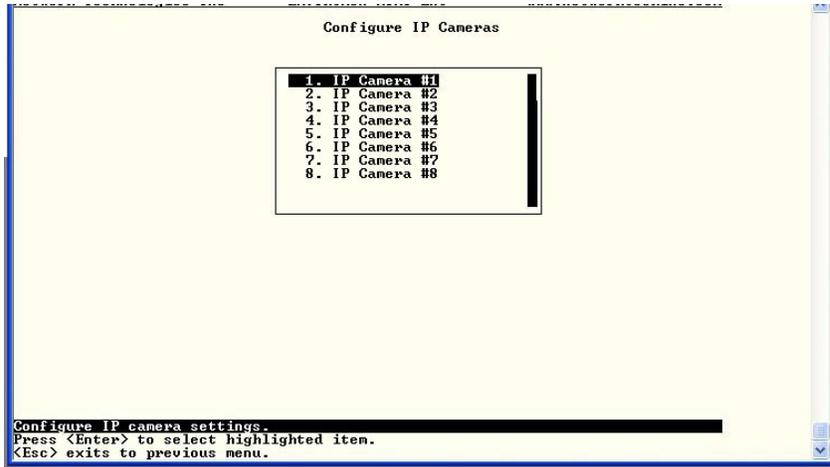


Figure 93- Text Menu- IP Camera List for Configuration

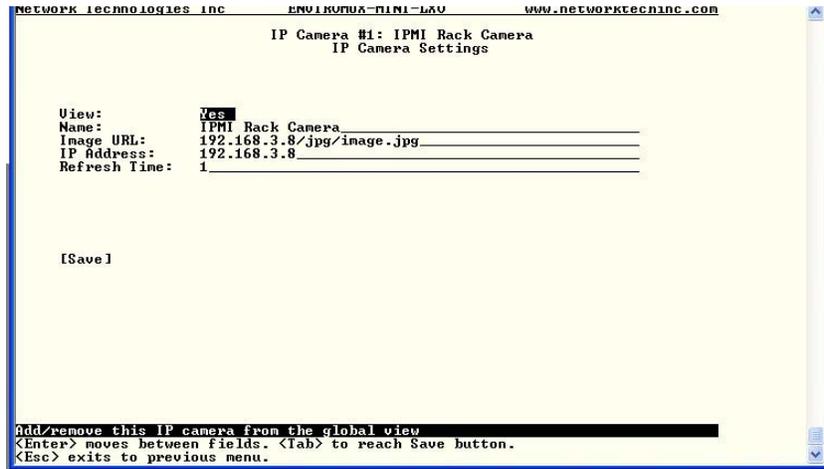


Figure 94- Text Menu- IP Camera Settings

Camera Settings	Description
View	Change to “Yes” to enable images from the IP Camera to appear in the view when selecting the IP Cameras from the Monitoring menu in the WEB interface (page 21).
Name	Characters entered will appear in any listing of the IP camera selection.
Image URL	Enter the full path to the image file captured by the IP camera under “Image URL”.
IP Address	the IP address for the IP camera.
Refresh Time	Enter a refresh time period in increments of 100 msec (milliseconds). That is, a value of 1 = 100 msec, 5 = 500 msec , 10 = 1000 msec (or 1 second). The images can be set to be refreshed every 100 msec (.1 second) up to 99,900 msec (almost 100 seconds).

## System Configuration

Under System Configuration (from the Main Menu), select “Time Settings” to enter the time of day, time zone, enable daylight saving time, or NTP server settings. Also, select “Restore Settings to Defaults” to clear all configuration and user settings and restore the ENVIROMUX to settings as received from the factory.

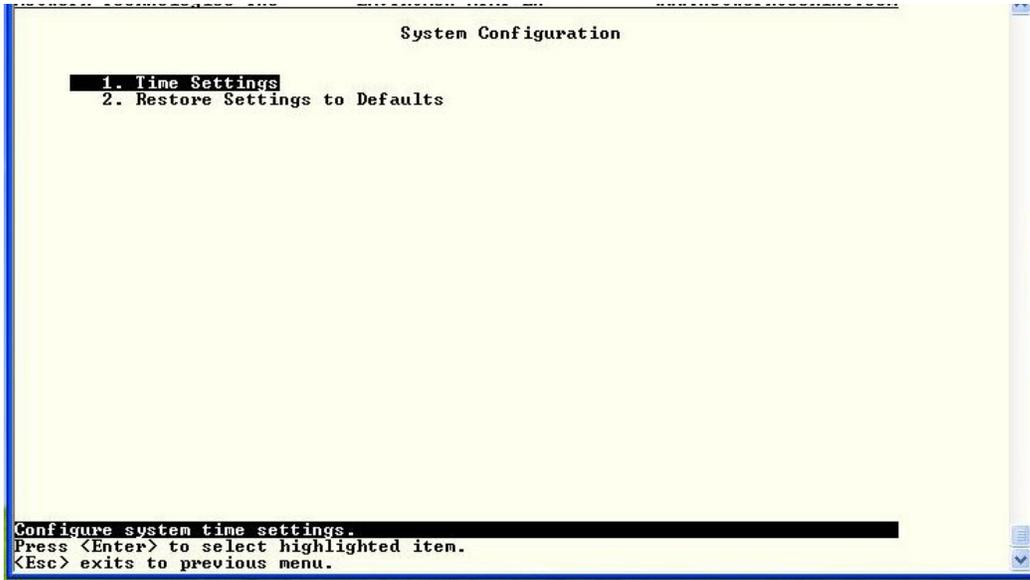


Figure 95- Text Menu- System Configuration

## Time Settings

On the Time Settings menu, the user can designate what time zone the unit is associated with, set the date and time manually or configure the ENVIROMUX to get this information from an NTP server.

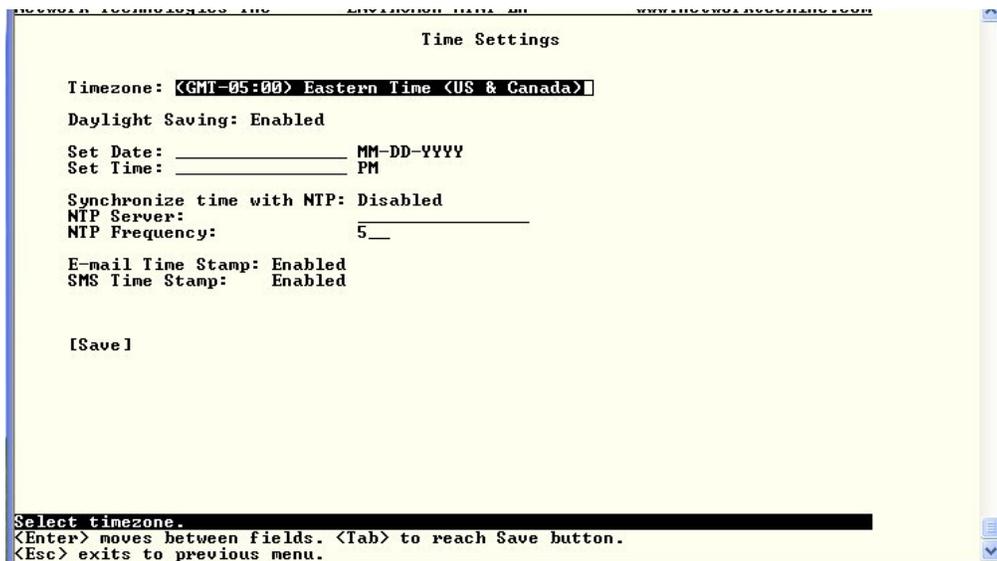


Figure 96- Text Menu-Time Settings menu

Time Settings	Description
Time Zone	Enter the appropriate time zone
Enable Daylight Saving	Change to "Yes" to have the time change in accordance Daylight Saving Time rules
Set Date	Enter the system date in MM-DD-YYYY format
Set Time	Enter the system time of day in hh:mm:ss format
Enable NTP	Change to "Enabled" to allow the ENVIROMUX to automatically sync up with a time server via NTP
NTP server	If the NTP is enabled, enter the Domain Name or IP address of the NTP server
NTP Frequency	Enter the frequency (in minutes) for the ENVIROMUX to query the NTP server (minimum is 5 minutes)
E-mail Time Stamp	Change to "Enabled" to allow the ENVIROMUX to automatically apply a time stamp to e-mail messages sent to users
SMS Time Stamp	Change to "Enabled" to allow the ENVIROMUX to automatically apply a time stamp to SMS messages sent to users

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

### Restore Default Settings

Select this option to restore the ENVIROMUX to the configuration settings it had upon receipt from the factory. **Be careful!** This will erase all user configuration settings. Upon restoration, the ENVIROMUX will reboot. Allow 1 minute before trying to reconnect and log in again.

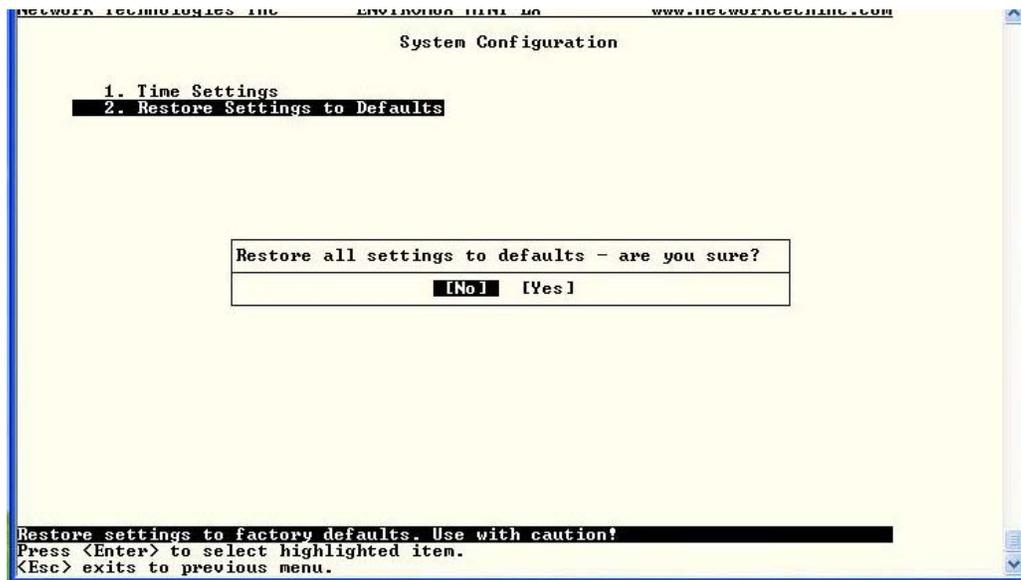


Figure 97- Text Menu-Restore Default Settings

**Note:** If "Restore Defaults" is used, the IP address will also be restored to its default address of 192.168.1.23 with a login name "root" and password "nti". To restore the root password "nti" without having to restore all default settings, contact NTI for assistance.

You can also restore settings to defaults from a button on the front of the ENVIROMUX (page 104).

To identify the IP address of the ENVIROMUX without restoring defaults, use the Discovery Tool (page 18).

## Enterprise Configuration

Under Enterprise Configuration (from the Main Menu), enter the unit name, location, the contact person emails should refer to and their phone number, and the email address of the ENVIROMUX to be used for outgoing alert messages.

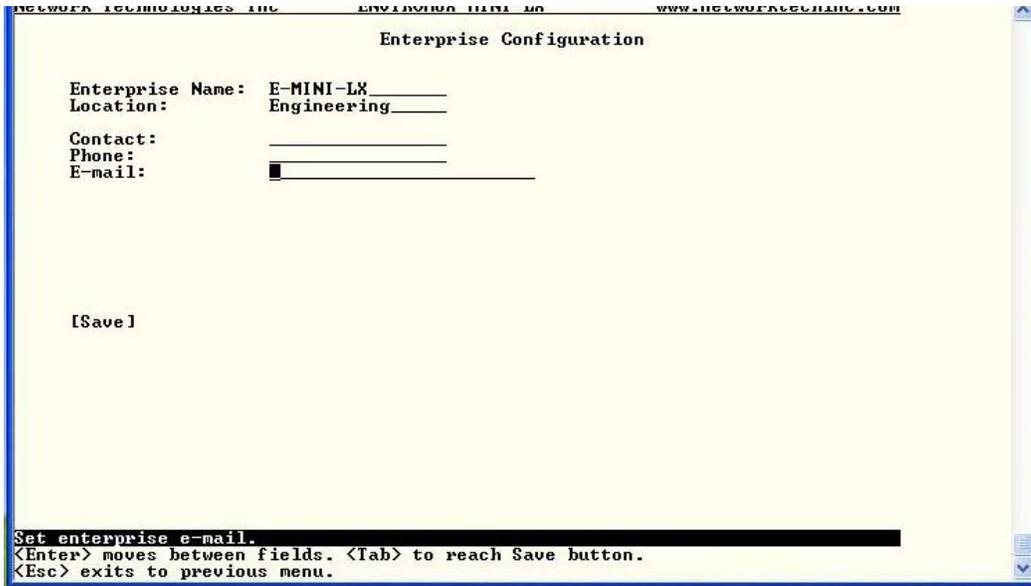


Figure 98- Text Menu-Enterprise Configuration

## Network Configuration

The Network Configuration menu (from the Main Menu) includes submenus for applying IPv4 and IPv6 Settings, SMTP server settings, SNMP settings, and miscellaneous settings to enable services for SSH, Telnet, HTTP, HTTPS and Web Timeout.

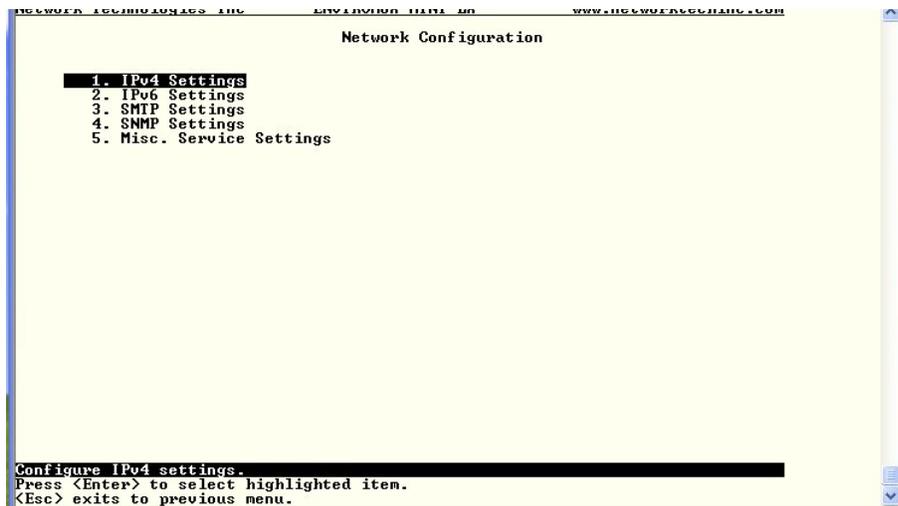


Figure 99- Text Menu-Network Configuration

## IPv4 Settings

The IP Settings menu contains the network connection settings for the ENVIROMUX.

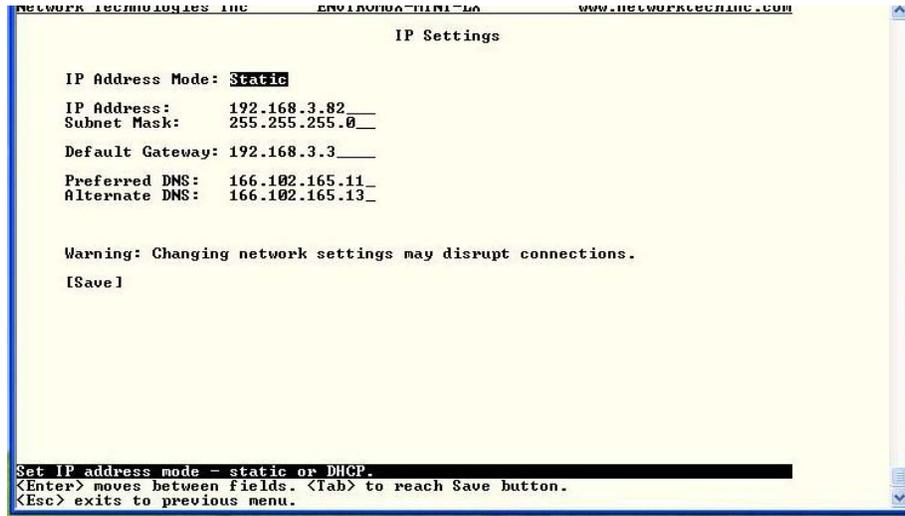


Figure 100- Text Menu-IPv4 Settings Menu

IP Settings	Description
Mode	Select between Static (manual) , or DHCP (automatic IP and DNS) settings
IP Address	Enter a valid IPv4 address (default value is 192.168.1.23)
Subnet Mask	Enter a valid subnet mask (default value is 255.255.255.0)
Default Gateway	Enter a valid gateway (default gateway value is 192.168.1.1)
Preferred DNS	Enter a preferred domain name server address
Alternate DNS	Enter an alternate domain name server address

If the administrator chooses to have the DNS and IP address information filled in automatically via DHCP, the SMTP server and port number still need to be entered for email alerts to work. If the SMTP server requires a password in order for users to send emails, the network administrator must first assign a user name and password to the ENVIROMUX.

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

## IPv6 Settings


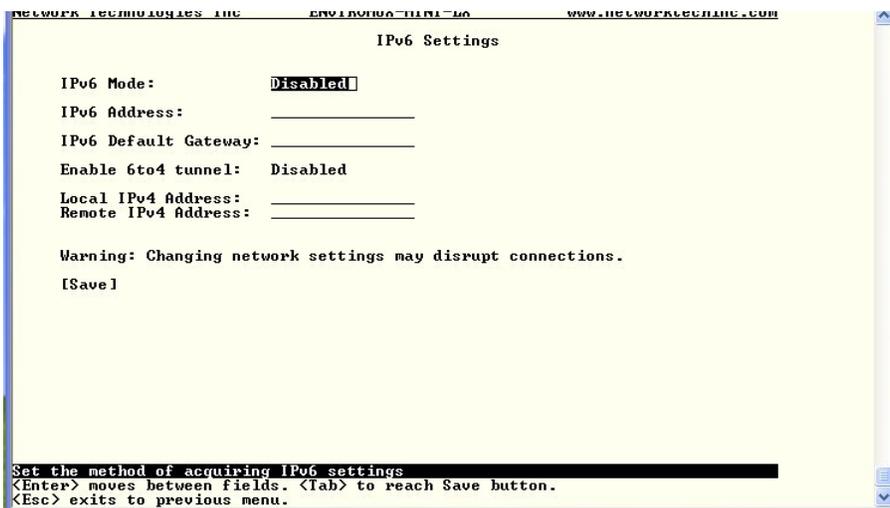


Figure 101- Text Menu-IPv6 Settings Menu

If IPv6 protocol will be used, change the mode to “Enabled” and apply valid in addresses for the IPv6 address and gateway. To use a 6to4 tunnel, change “Disabled” to “Enabled” and apply valid local and remote addresses.

### SMTP Settings

The SMTP Settings menu contains the SMTP server settings for the ENVIROMUX.

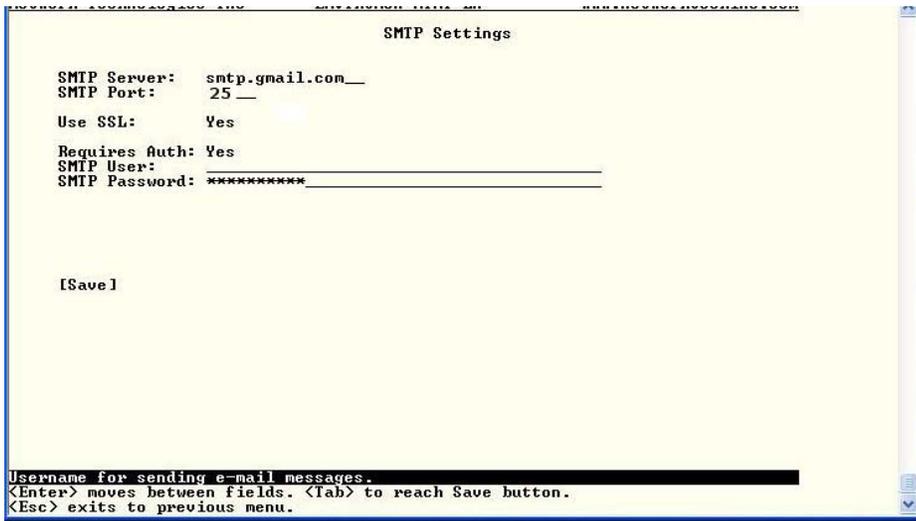

**Note:** The SMTP server port number is shown in Figure 102 as "25". This is a common port number assigned, but not necessarily the port number assigned to your SMTP server. For SMTP servers that support SSL, the common port number is 465.

Figure 102- Text Menu-SMTP Server Settings

SMTP Settings	Description
SMTP Server	Enter a valid SMTP server name (e.g. yourcompany.com)
Port	Enter a valid port number (default port is 25)
Use SSL	Change to "Yes" if the SMTP server supports SSL
Requires Authentication	Change to "Yes" if the SMTP server requires authentication to send email
SMTP User	Enter a valid username to be used by the ENVIROMUX to send emails
SMTP Password	Enter a valid password assigned to the ENVIROMUX username

### SNMP Settings

The SNMP Settings menu contains the SNMP server settings for the ENVIROMUX.

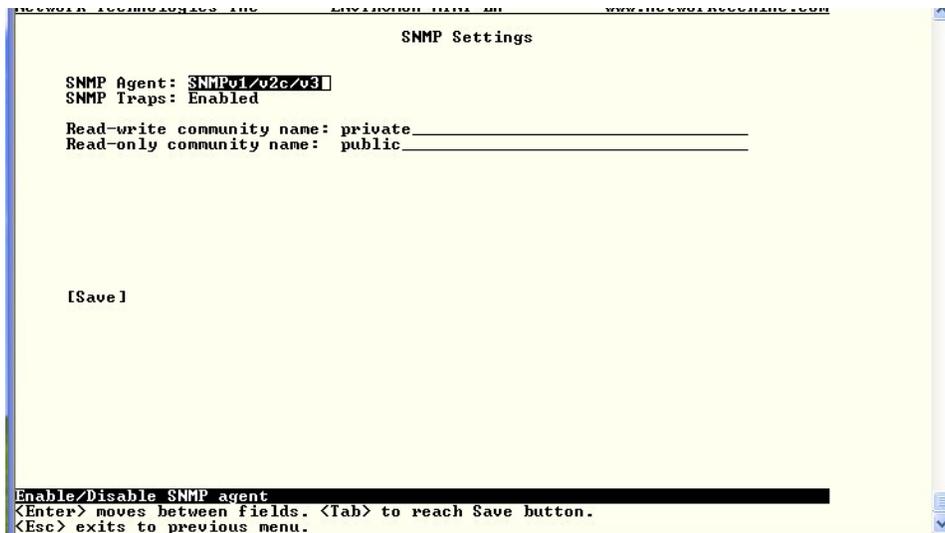


Figure 103- Text Menu-SNMP Server Settings

SNMP Settings	
Enable SNMP agent	Choose between v1/v2c, v3 , and v1/v2c/v3 SNMP agent version settings
Enable SNMP traps	Change to "Enabled" to enable SNMP traps to be sent
Read-write community name	Enter applicable name (commonly used- "private") <b>(not applicable as of this printing)</b>
Read-only community name	Enter applicable name (commonly used- "public")

### Read-Only Community Name

The SNMP Read-only community name enables a user to retrieve "read-only" information from the ENVIROMUX using the SNMP browser and MIB file. This name must be present in the ENVIROMUX and in the proper field in the SNMP browser.

### Read-Write Community Name

**(not applicable as of this printing)**

The SNMP Read-Write community name enables a user to read information from the ENVIROMUX and to modify settings on the ENVIROMUX using the SNMP browser and MIB file. This name must be present in the ENVIROMUX and in the proper field in the SNMP browser.

### Miscellaneous Service Settings

The Misc. Service Settings menu contains selections to configure services running on the ENVIROMUX.



Figure 104- Text Menu-Misc. Service Settings menu

Server Settings	
Enable SSH	Enable this to allow access to the ENVIROMUX via SSH
Enable Telnet	Enable this to allow access to the ENVIROMUX via Telnet <b>The default setting is Disabled.</b>
Enable HTTP access	Enable this to allow access to the ENVIROMUX via standard (non-secure) HTTP requests
HTTP Port	Port to be used for standard HTTP requests
HTTPS Port	Port to be used for HTTPS requests
Web Timeout	Number of minutes after which idle web uses will be logged-out (enter 0 to disable this feature)

The administrator may assign a different HTTP Server Port than is used by most servers (80).

## User Configuration

The User Configuration menu lists all configured user names of the ENVIROMUX. A maximum of 15 users (other than root) can be configured. From this screen the administrative user can add users, go to the user configuration page to edit a user's access to the ENVIROMUX, or delete a user from the list.

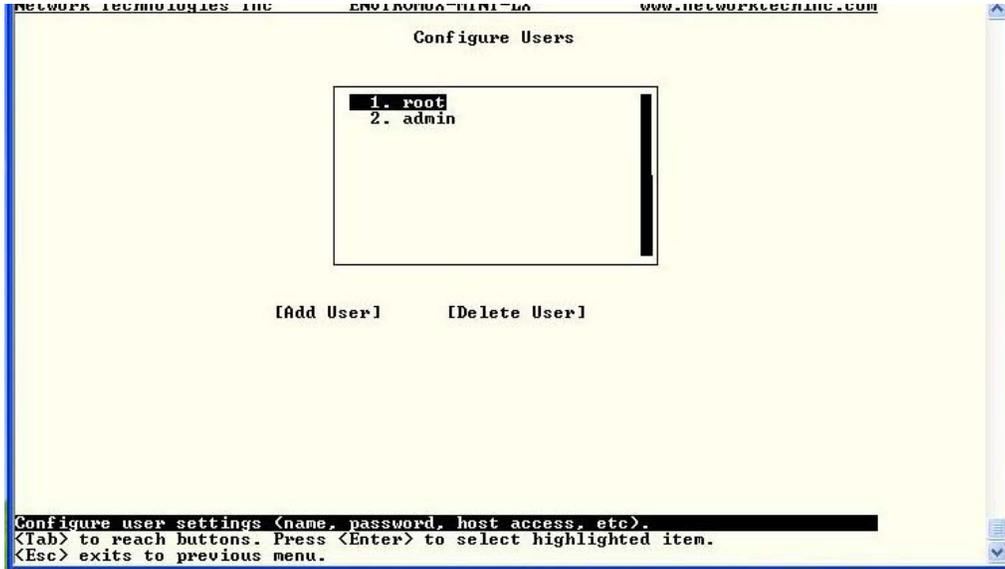


Figure 105- Text Menu-User Configuration

To add a user, Tab to "Add User" and press <Enter>.

To edit a user's configuration, select the listed username and press <Enter>

To delete a user and their configuration, select a listed username, Tab to "Delete User", and press <Enter>. You will be prompted for confirmation before deleting the user and configuration.

When adding a new user, you will be prompted to confirm the addition of the user. At that point, the Configure User menu will open a user settings list with the username "userx" assigned, where x = the next consecutive number (up to 15) based on the quantity of users in the list (other than the root user).

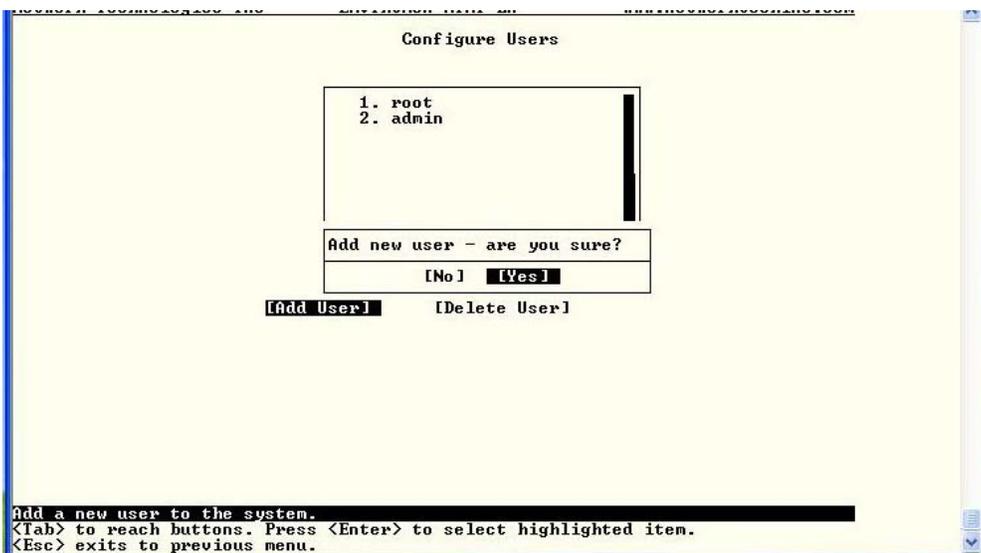


Figure 106- Text Menu-Confirm to add new user

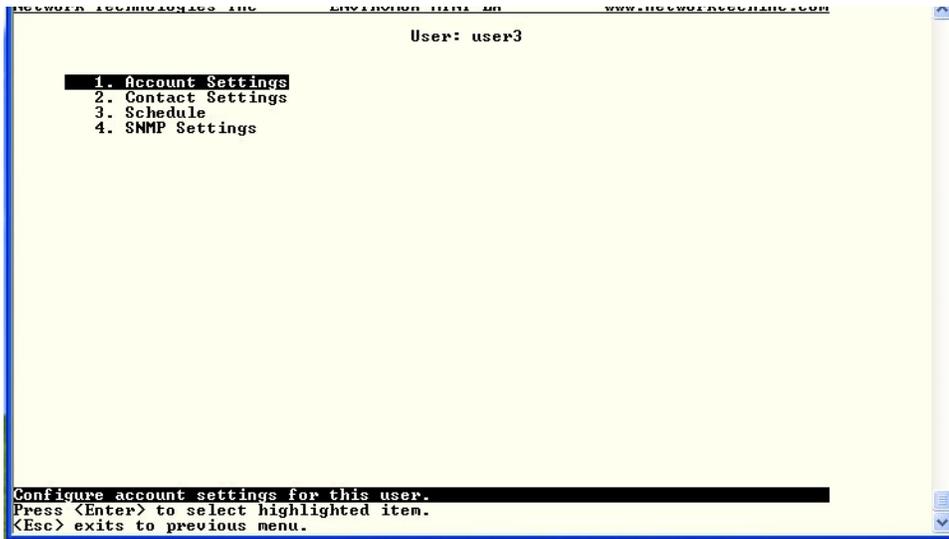


Figure 107- Text Menu-Configuration List for User

### User Account Settings

Select “Account Settings” from the list and press <Enter>. A menu with the account settings for that specific user will open where you can either leave the name as “userx”, or change it. With the name assigned, fill in the remaining information as needed.

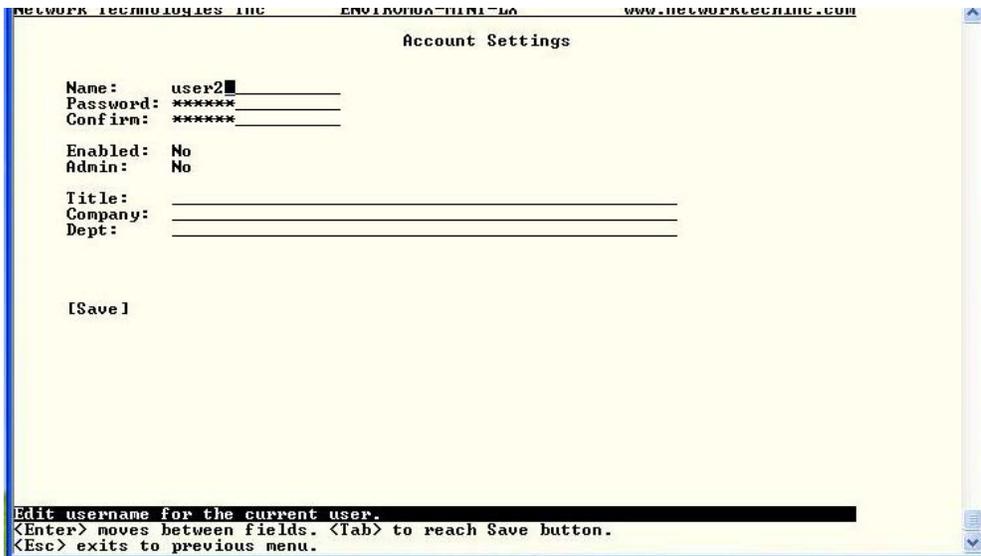


Figure 108- Text Menu-User Account Settings

Account Settings	Description
Username	Enter the desired username for this user
Password	Enter a password that a user must use to login to the system <b>A password must be assigned for the user’s login to be valid</b> <b>Passwords must be at least 1 keyboard character.</b>
Confirm	Re-enter a password that a user must use to login to the system

Account Settings	Description
Enabled	Change to "Yes" to enable this user to access the ENVIROMUX
Admin	Change to "Yes" if this user should have administrative privileges
Title	Enter information as applicable (optional)
Department	Enter information as applicable (optional)
Company	Enter information as applicable (optional)

### More about User Privileges

The root user (or any user with administrator rights) can change the root password and configure how the root user will receive alert messages. Users with administrative rights can change all configuration settings except for the root user name.

### User Contact Settings

Select "Contact Settings" from the list and press <Enter>. A menu with the contact settings for that specific user will open.

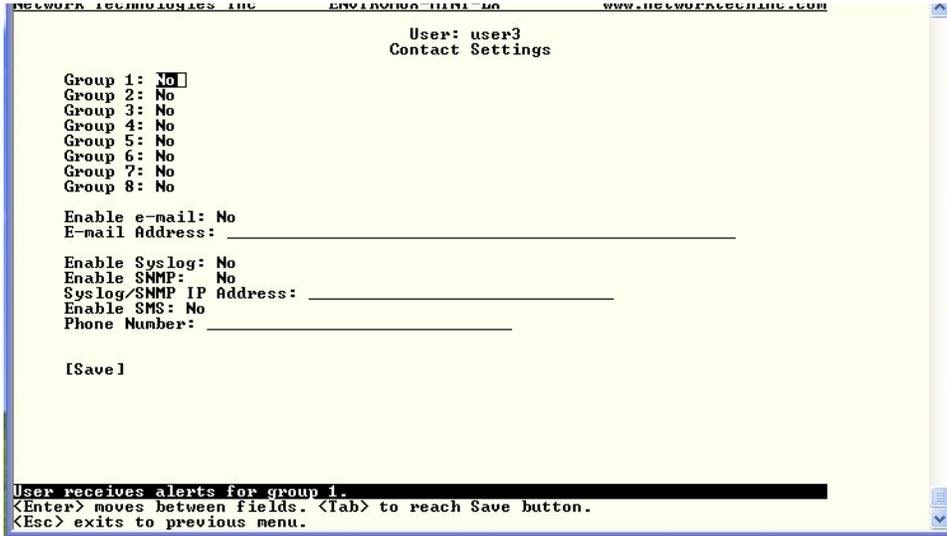


Figure 109- Text Menu-User Contact Settings

Contact Settings	Description
Group 1	Change to "Yes" if the user should receive messages from sensors, IP devices and accessories in Group 1
Group 2	Change to "Yes" if the user should receive messages from sensors, IP devices and accessories in Group 2
Enable Email	Change to "Yes" if the user should receive messages via email
Email address	Enter a valid email address if the user should receive email alert messages
Syslog alerts	Change to "Yes" if the user should receive alerts via syslog messages
SNMP traps	Change to "Yes" if the user should receive alerts via SNMP traps
Syslog/SNMP IP address	Enter a valid syslog/SNMP IP address for the user to receive syslog/SNMP messages
SMS	Change to "Yes" if the user should receive alerts via SMS messages
Phone Number	Enter a valid phone number for the user to receive SMS messages

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

### User Activity Schedule

Select "Schedule" from the list and press <Enter>. A menu with the user activity settings for that specific user will open.

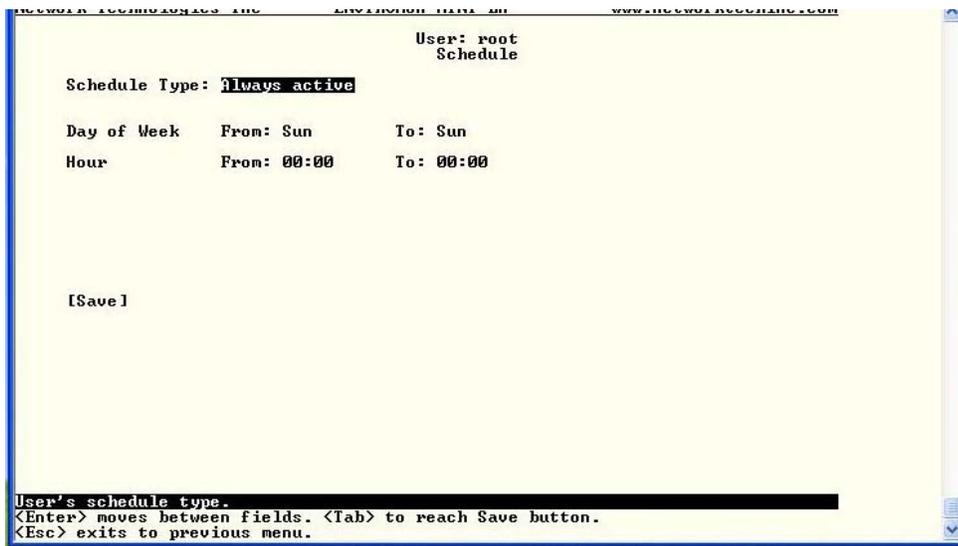


Figure 110- Text Menu-User Activity Schedule

Schedule Settings	
Schedule Type	<b>Always active</b> - user will receive messages at all hours of each day <b>Active during defined times</b> - user will only receive alert messages during times as outlined below
Day of Week-From:	First day of the week the user should begin receiving messages
Day of Week-To:	Last day of the week the user should receive messages
Hour From:	First hour of the day the user should begin receiving messages
Hour To:	Last hour of the day the user should receive messages

### User SNMP Settings

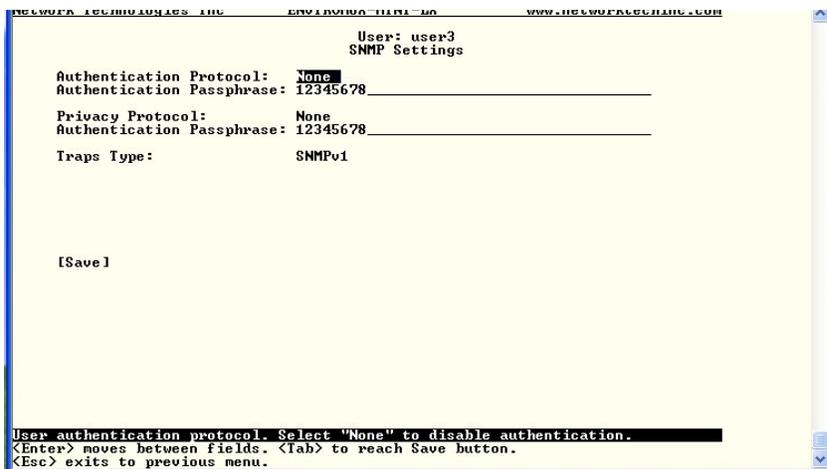


Figure 111-Text Menu- SNMP User Settings

Security settings can be configured within each user configuration if the SNMP protocol has been selected for use (page 85).

Settings	
Authentication Protocol	Choose between MD5 or SHA to require authentication, or none to disable it. This only needs to be changed from "none" if SNMPv3 is used.
Privacy Protocol	Choose between DES or AES to encrypt SNMP readings or traps or none to disable encryption. If encryption is enabled, then the Authentication Protocol must also be set at "MD5" or "SHA".
Authentication Passphrase	Assign the passphrase to be used to enable the receipt of SNMP messages. This only needs to be changed from "none" if SNMPv3 is used.
Privacy Passphrase	Assign the passphrase to be used to open and read readings or alert messages received via SNMPv3
Traps Type	Choose which format traps should be received in, SNMP v1, v2c, or v3

After changing any settings in the user profile, press "Apply".

### Security Configuration

The Security Configuration menu provides two submenus for setting local versus LDAP authentication methods and for applying IP filtering rules to prevent unwanted access to the ENVIROMUX.



Figure 112- Text Menu-Security Configuration

### Authentication Settings

Security in the ENVIROMUX can be managed one of two ways; through the local settings (passwords assigned in user settings on page 87) or through an LDAP server. If security is configured to use LDAP mode, then the passwords for users must be those found on a configured LDAP server.

Select "Authentication Settings" from the list and press <Enter>. A menu providing an option to either user Local authentication or LDAP mode. When in LDAP mode, usernames on the LDAP server must match those in the user settings of the ENVIROMUX or access will be denied.

**Note: When the root user logs with the ENVIROMUX in LDAP mode, if the LDAP server is not responding, local authentication will be tried.**

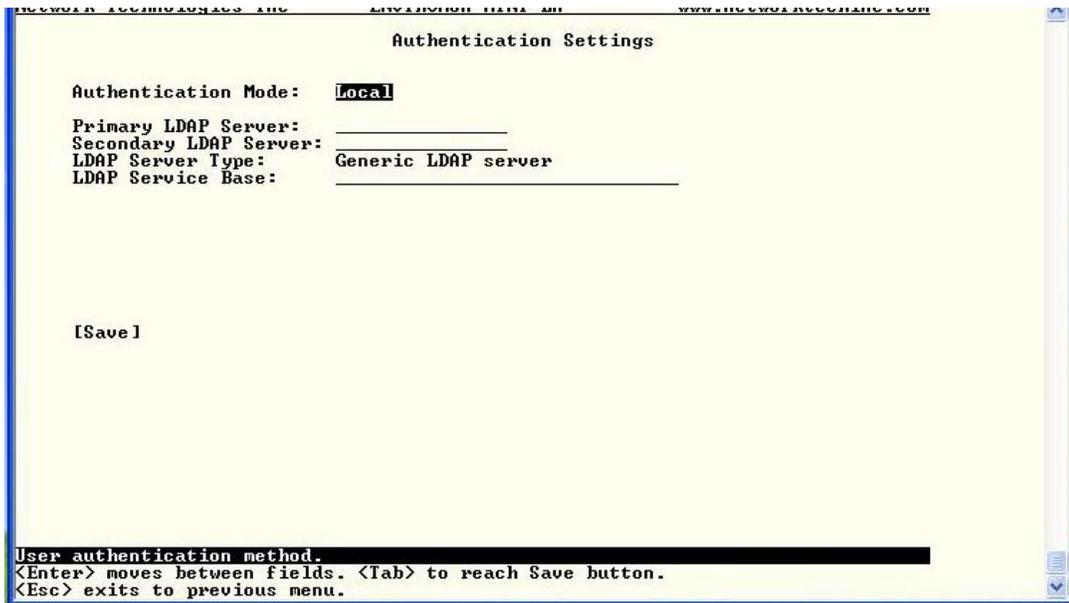


Figure 113- Text Menu-Authentication Settings

User Authentication	
Mode	Select Local to use authentication based on passwords in the ENVIROMUX user configuration Select LDAP to use authentication based on passwords in an LDAP server
Primary LDAP Server	Enter Hostname or IP address of Primary LDAP Server
Secondary LDAP Server	Enter Hostname or IP address of Secondary LDAP Server (optional)
LDAP Server Type	Tab to choose from the following: Generic LDAP server Novell Directory server Microsoft Active Directory
LDAP Service Base	Enter the Base DN for users (ex: ou=People,dc=mycompany,dc=com)

Even though LDAP authentication is being used, each user must also have a local account. User permission level is established by the local account.

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

## IP Filtering

Included in the Security Configuration options is IP Filtering. IP Filtering provides an additional mechanism for securing the ENVIROMUX. Access to the ENVIROMUX network services (SNMP, HTTP(S), SSH, Telnet) can be controlled by allowing or disallowing connections from various IP addresses, subnets, or networks.

Up to 16 IP Filtering rules can be defined to protect the ENVIROMUX from unwanted access from intruders. Each rule can be set as Enabled or Disabled. Rules can be set to explicitly drop attempts to connect, or to accept them.

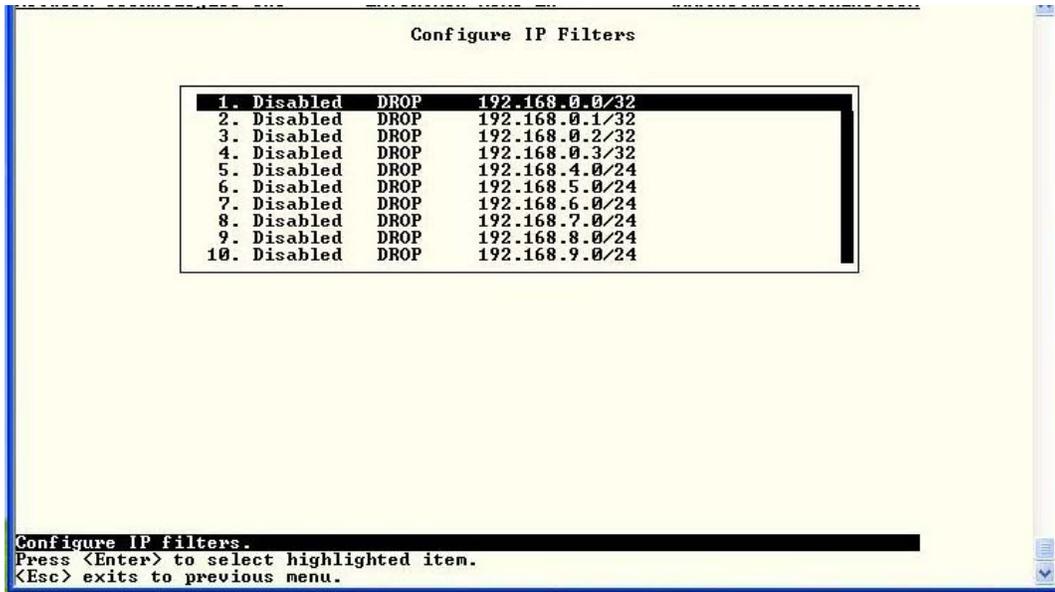


Figure 114- Text Menu-IP Filtering

To configure an IP Filter, select an IP Filter rule from the list and press <Enter>.

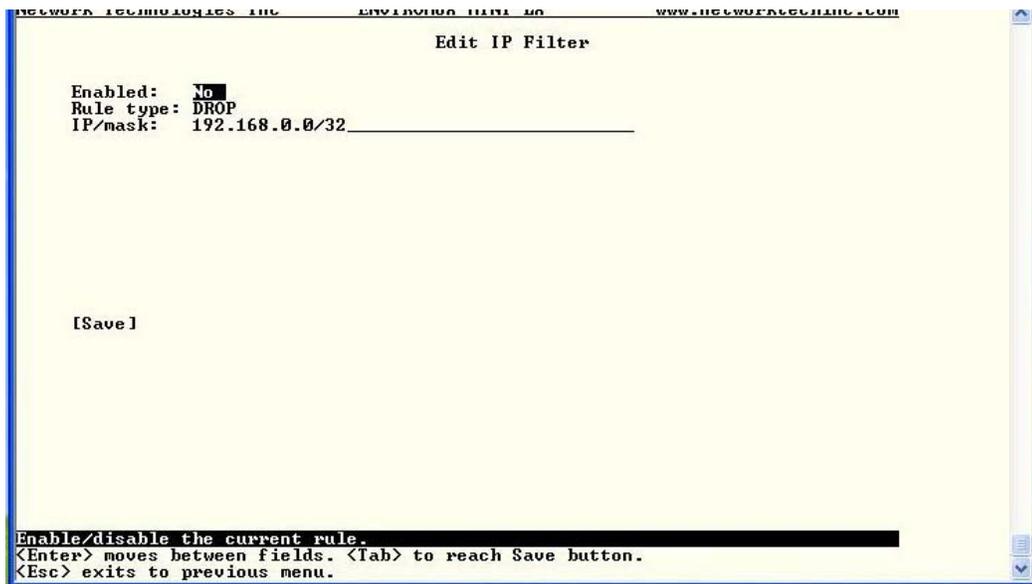


Figure 115- Text Menu-Configure IP Filter rule

The most common approach is to only allow “white-listed” IP addresses, subnets, or networks to access the device while blocking all others. The IP Filters are processed sequentially from top to bottom, so it is important to place the most precise rules at the top of the list and the most generic rules at the bottom of the list.

As an example, assume we wish to block all connections except those which come from the IP address 192.168.1.100. To allow connections from 192.168.1.100, we need to configure and enable an ACCEPT rule at the top of the list:

### (Rule 1)

```
Enabled: Yes
Rule type: ACCEPT
IP/mask: 192.168.1.100
```

Then, to block all other IP addresses from connecting to the ENVIROMUX, we add a rule to drop all other connections.

### (Rule 16)

```
Enabled: Yes
Rule type: DROP
IP/mask: 0.0.0.0/0
```

If the preceding “drop all connections” rule was placed in position one, no connections at all would be allowed to the unit. Remember: rules are processed from top to bottom. As soon as a rule matches, the processing stops and the matching rule is executed.

To match a particular IP address, simply enter in the desired IP address (e.g. 192.168.1.100).

To match a subnet, enter in the subnet with the associated mask (e.g. 192.168.1.0/24).

To match all IP address, specify a mask of 0 (e.g. 0.0.0.0/0).

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

## Event and Data Logs

Under the Event and Data Logs menu find 4 submenus for viewing a log record of the events monitored by the ENVIROMUX and configuring how the ENVIROMUX will handle reaching the capacity of those logs.



Figure 116- Text Menu-Event & Data Logs

### View Event Log

The Event Log provides the administrative user with a listing of many events that occur within the ENVIROMUX. The event log will record the date and time of:

The event

- each ENVIROMUX startup,
- each user login and logout time,
- any time an unknown user tries to login,
- sensor and IP device alerts
- an alert handled by a user

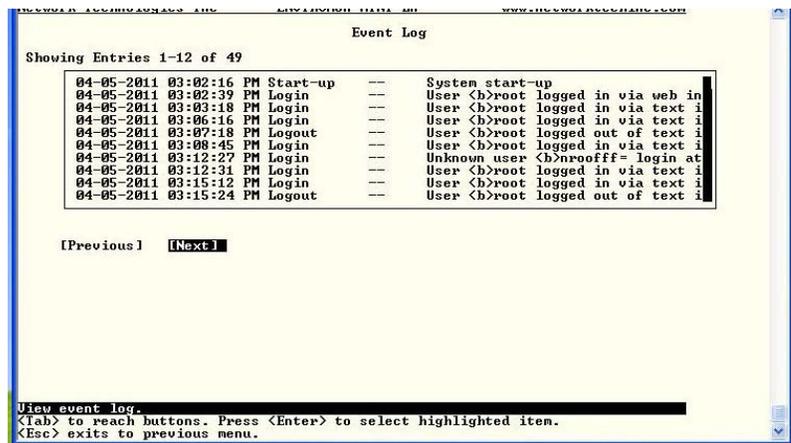


Figure 117- Text Menu-View Event Log

From the Event Log the administrative user can view the logs. In order to clear specific logs, download log entries, or clear the entire log, use the Web Interface (see page 58). To navigate between pages of logs, pres <Tab> to move between **Previous** and **Next** and press <Enter>.

## View Data Log

The Data Log provides the administrative user with a listing of all the readings taken by the ENVIROMUX pertaining to the sensors and IP Devices being monitored. The data log will record the date and time of each reading.

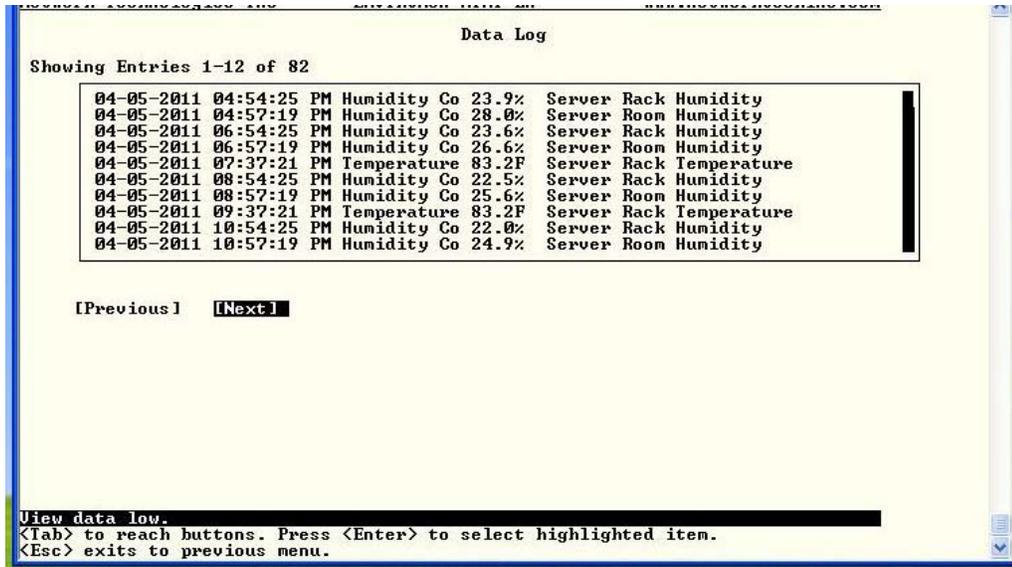


Figure 118- Text Menu-View Data Log

From the Data Log the administrative user can view the logs. In order to clear specific logs, download log entries, or clear the entire log, use the Web Interface (see page 59). To navigate between pages of logs, press <Tab> to move between **Previous** and **Next** and press <Enter>.

## Log Settings Menus

The Log Settings menus (Figure 119 and Figure 120 ) provide settings for how the ENVIROMUX will react when its Data and Event logs reach capacity.

The Event Log settings include a logging level that can be configured to log different amounts of information:

- Error : shows only system errors (like sending email failures or SMS)
- Alerts: shows recorded system errors and alert messages
- Info: In addition to all of the above, the log will show less relevant information: user login/logout for example

Each log can be assigned to a group and any user that receives messages from that group can be notified when capacity is being reached.

As a capacity overflow action the log can be set to either :

- Discontinue- stop logging information
- Clear and restart- delete all log entries and restart with new entries
- Wrap- continue logging but delete the oldest entries and new ones are recorded

The Data and/or Event log can be set to sent alerts to users via email, syslog, and/or SNMP traps once it has reached 90% of capacity, allowing them time to react.

The Data log can also be set to send log entries via email, syslog, or SNMP traps to users in addition to the entries it records internally. Enable Remote Logging for email, syslog, or SNMP as desired.

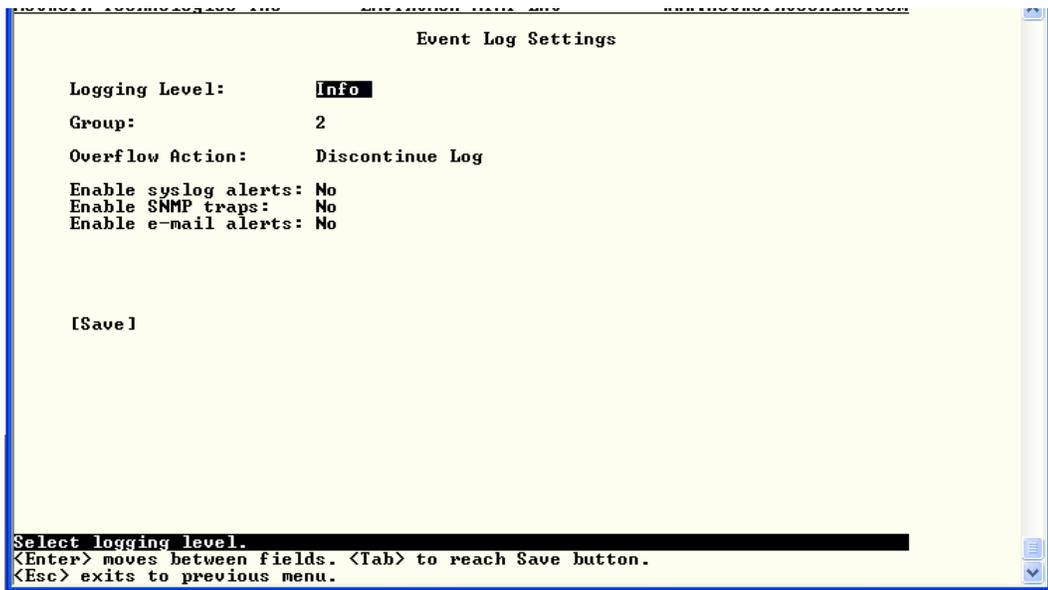


Figure 119- Text Menu-Event Log Settings

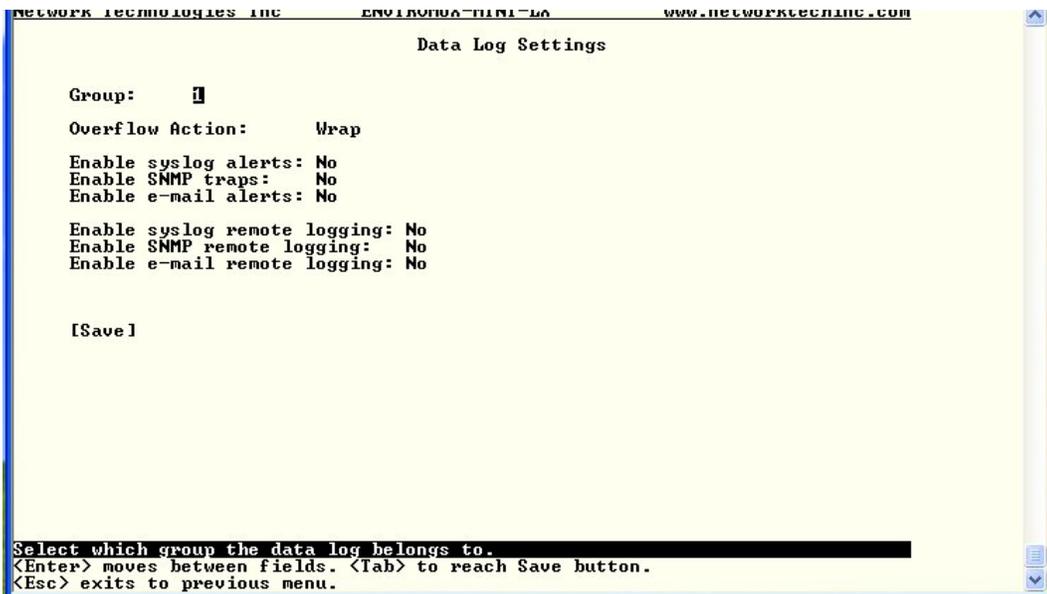


Figure 120-Text Menu-Data Log Settings

## System Information

The System Information page lists current firmware, time, and network settings for the ENVIROMUX. It also lists the ENVIROMUX MAC address.

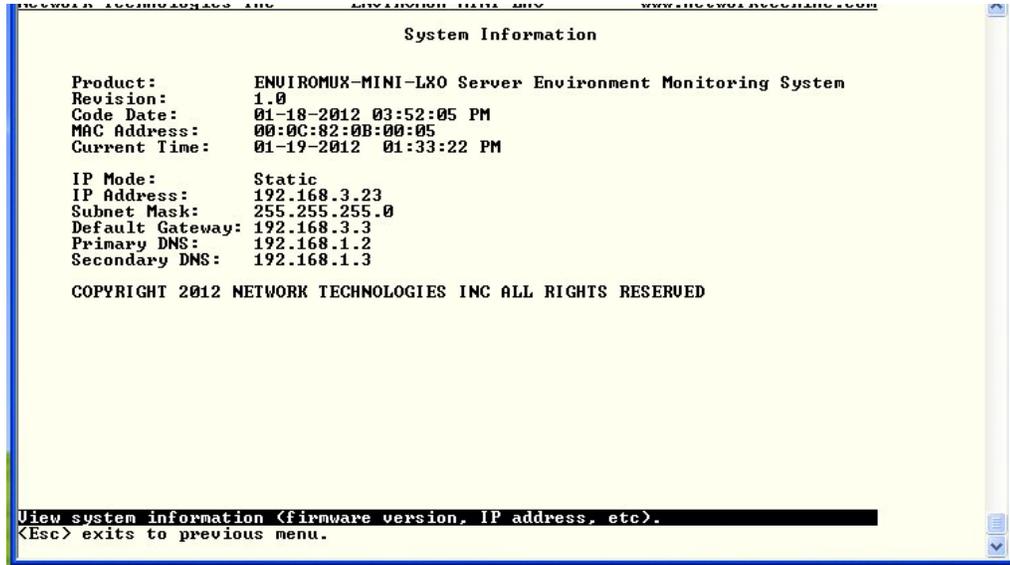


Figure 121-Text Menu-System Information

## Reboot

From the Main Menu the administrative user can initiate a reboot of the ENVIROMUX. By highlighting "Reboot" and pressing <Enter> (or <9> and <Enter>), you will be prompted to confirm that you want to reboot the ENVIROMUX. Press <Enter> to cancel, or press the <Tab> or either <arrow> key to highlight "Yes" and <Enter> to reboot. The ENVIROMUX will reboot and a new connection must be initiated to reconnect, login, and resume operation.

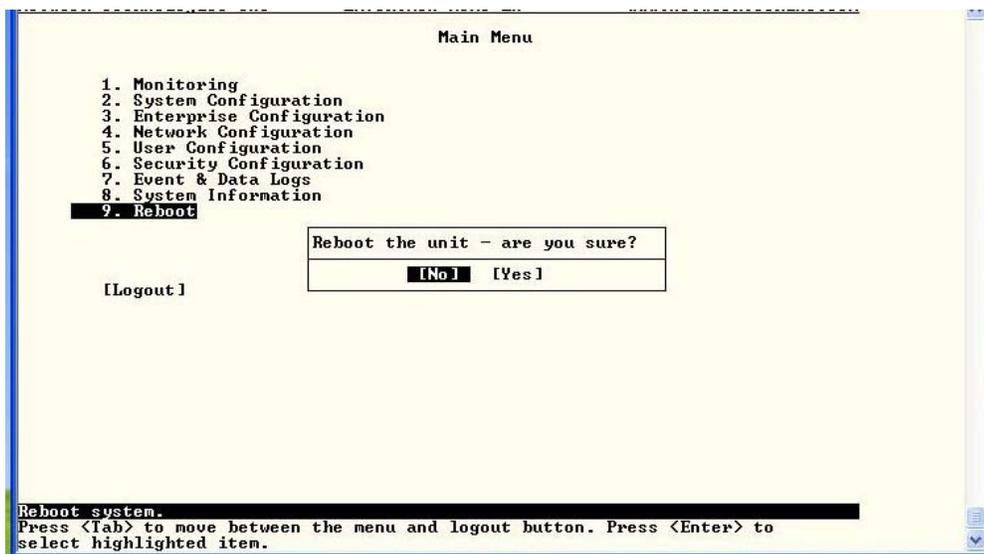


Figure 122- Text Menu-Reboot the ENVIROMUX

## Text Menu for Non-Administrative Users

Users without administrative privileges are able to view sensors and IP Devices and edit their own account settings.

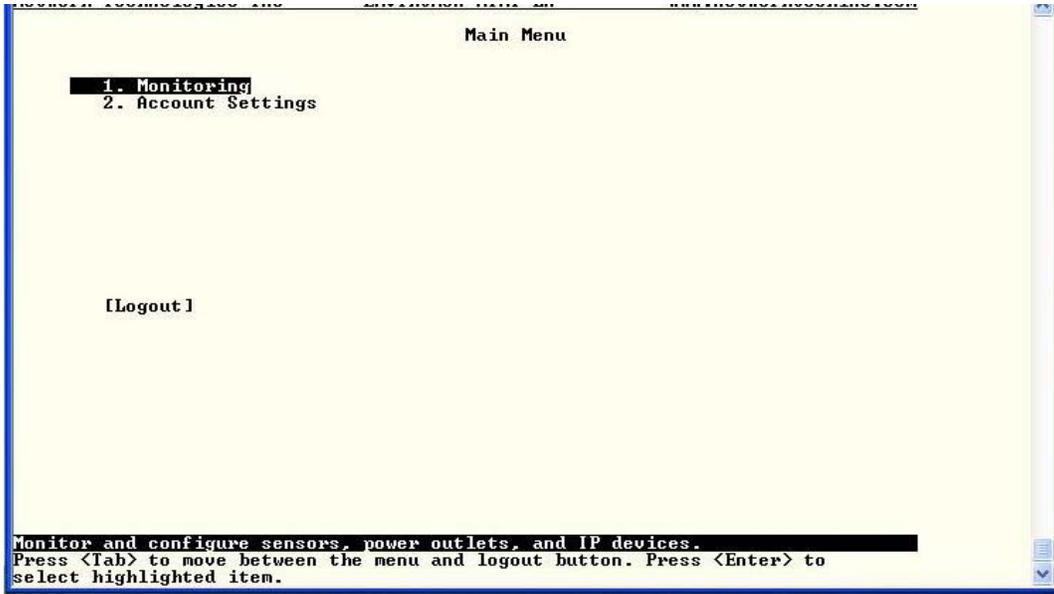


Figure 123- Text Menu-User Main Menu

### Monitoring

The Monitoring menu lists 4 options for viewing the status of the items monitored by the ENVIROMUX.

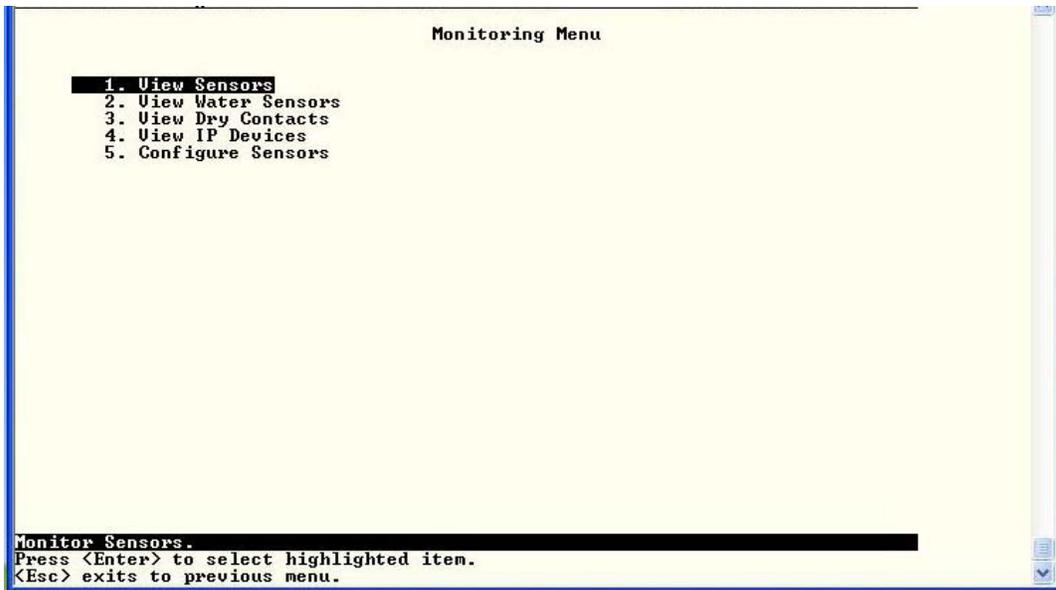


Figure 124-Text Menu-User Monitoring Menu

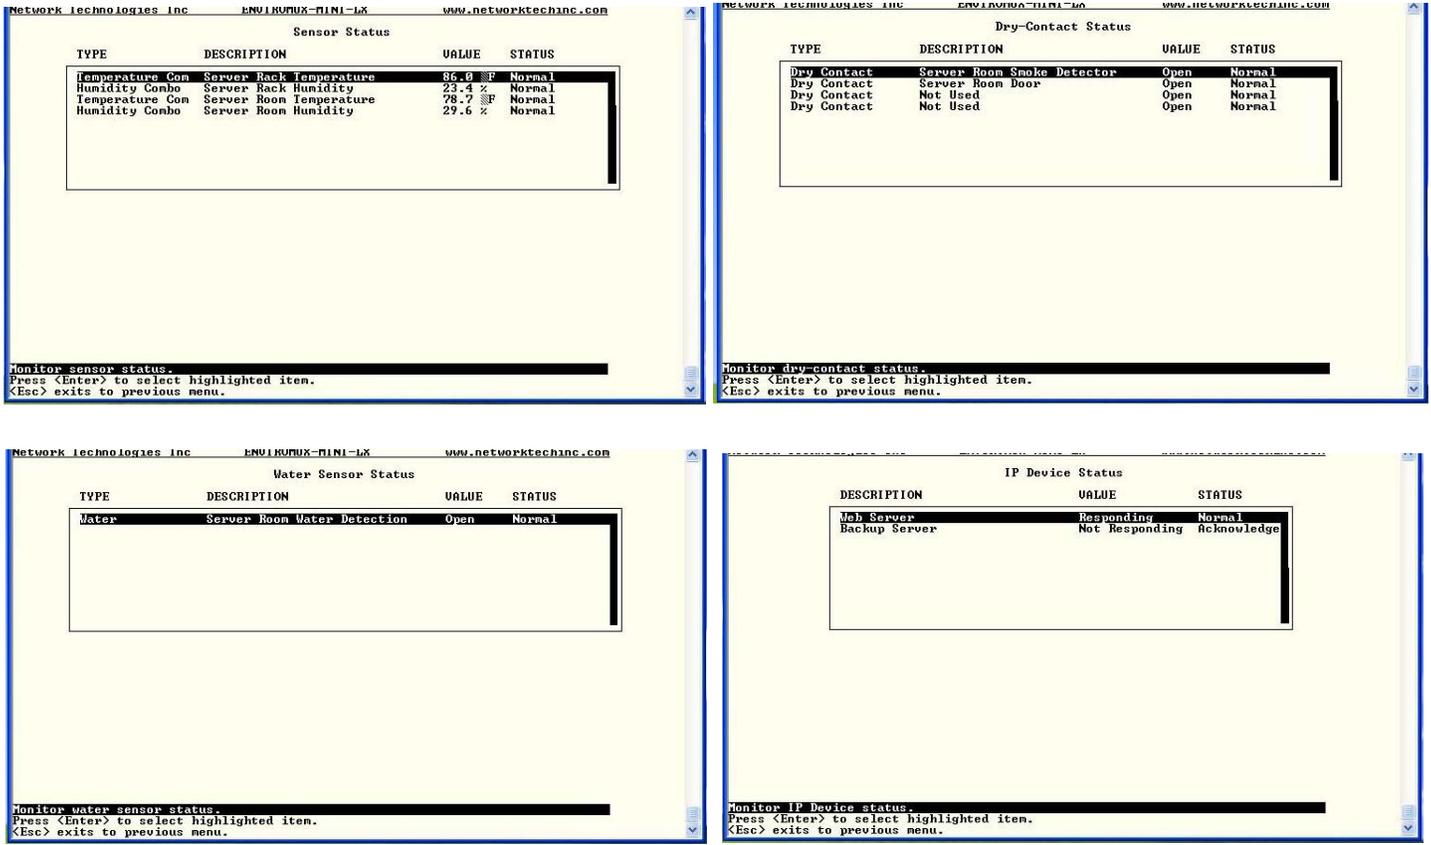


Figure 125- Text Menu-User accessible status menus

If a monitored item is in alert status, the non-administrative user can enter a response to it. By pressing the <Enter> key with the sensor selected, the user will have the option to either **acknowledge** the alert or **dismiss** it. If the user acknowledges the alert, no additional alert messages will be sent during that alert status cycle. If the user dismisses the alert, another alert message will be sent once the “notify again after” time designated on the configuration page (one example on page 24) elapses.

## User Accessible Settings

The User without administrative privileges has access to setting for their own account.

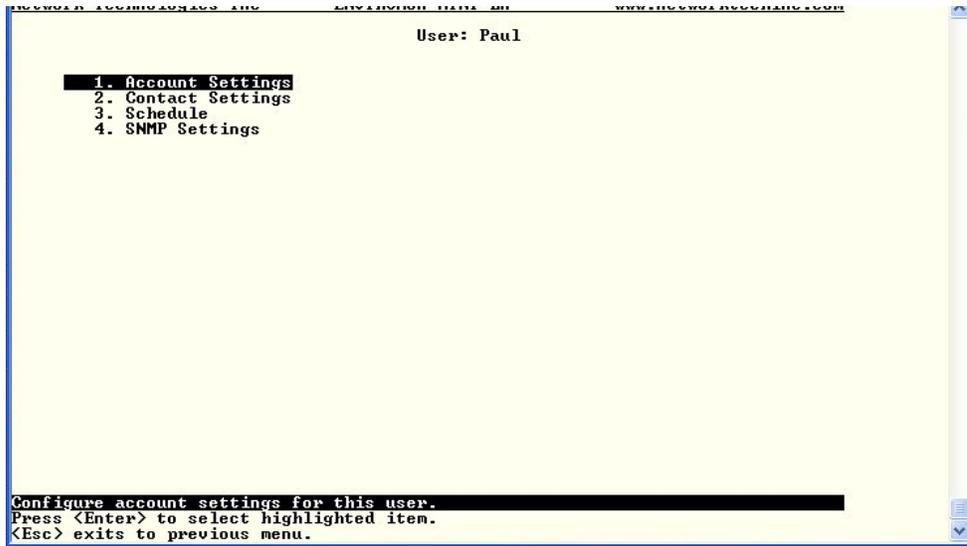


Figure 126- Text Menu-User Accessible Settings

## Account Settings

Under Account Settings, the non-administrative user can edit their password, title, company, or department settings. Other settings are only accessible to the administrative user.

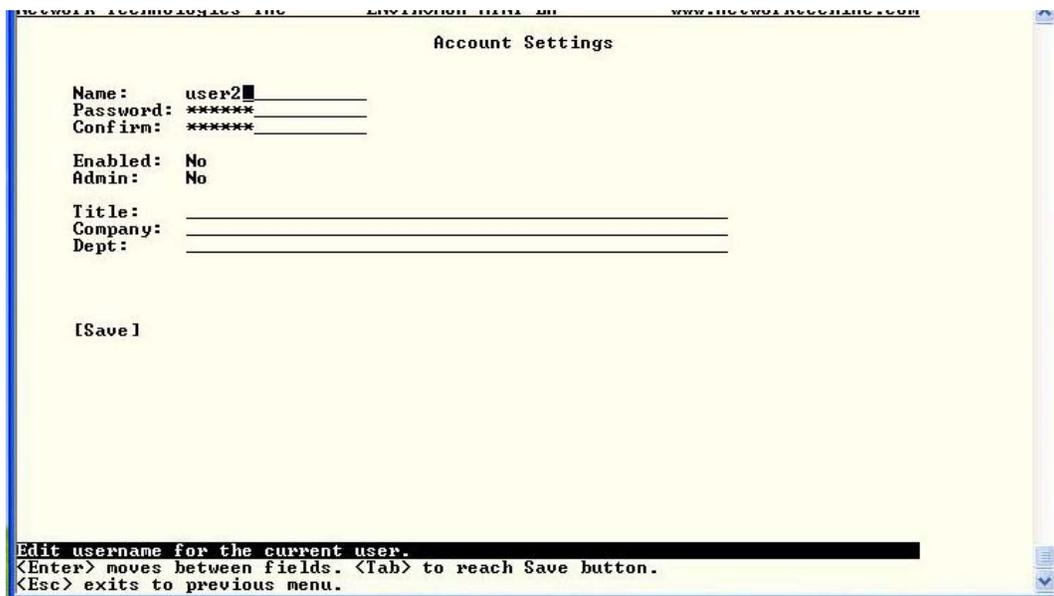


Figure 127- Text Menu-User Account Settings

## Contact Settings

Under Contact Settings, the non-administrative user can decide which sensor group messages they will receive and how.

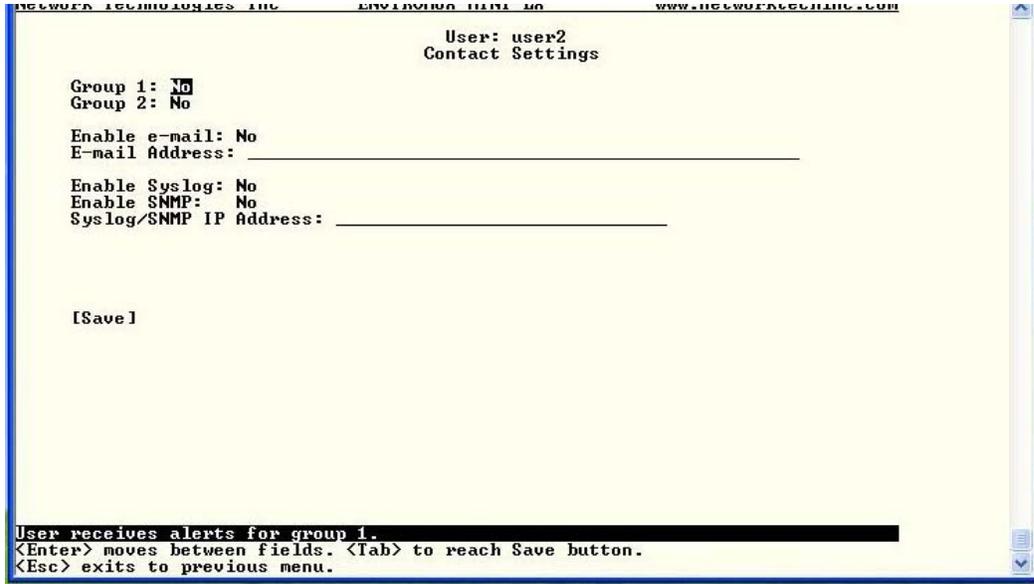


Figure 128- Text Menu-User Contact Settings

Contact Settings	
Group x	Change to “Yes” to receive messages from sensors, IP devices and accessories in any Group that sensors have been assigned to
Enable Email	Change to “Yes” to receive messages via email
Email address	Enter a valid email address to receive email alert messages
Syslog alerts	Change to “Yes” to receive alerts via syslog messages
SNMP traps	Change to “Yes” to receive alerts via SNMP traps
Syslog/SNMP IP address	Enter a valid syslog/SNMP IP address to receive syslog/SNMP messages

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

## Schedule

Under Schedule, the non-administrative user can edit their activity schedule to control when messages should be sent to them.

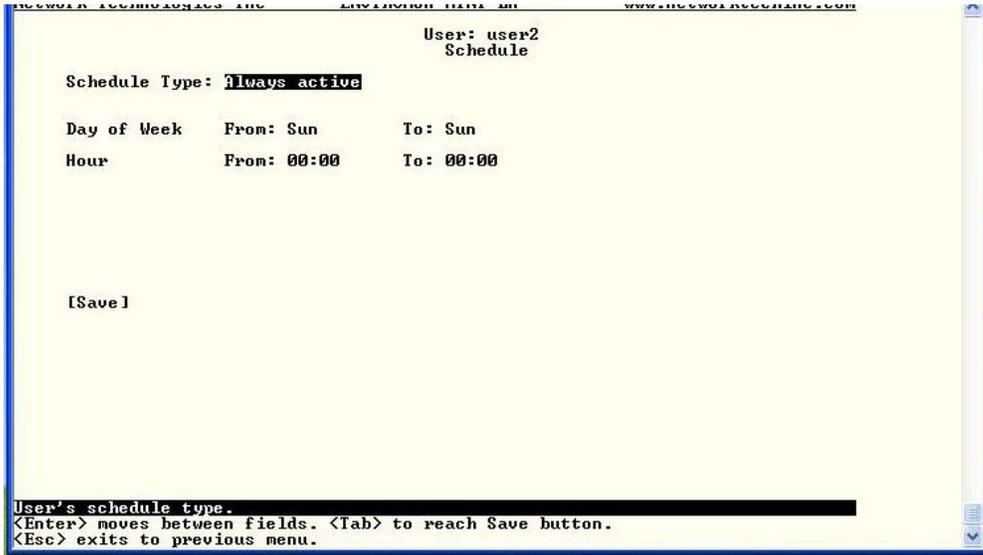


Figure 129- Text Menu-User Activity Schedule

Schedule Settings	
Schedule Type	<p><b>Always active</b>- user will receive messages at all hours of each day</p> <p><b>Active during defined times</b>- user will only receive alert messages during times as outlined below</p>
Day of Week-From:	First day of the week the user should begin receiving messages
Day of Week-To:	Last day of the week the user should receive messages
Hour From:	First hour of the day the user should begin receiving messages
Hour To:	Last hour of the day the user should receive messages

Press <Tab> to highlight **Save** and press <Enter> to save before pressing <Esc> to exit.

## SNMP Settings

Under SNMP Settings, the non-administrative user can edit the settings required to receive SNMP messages.

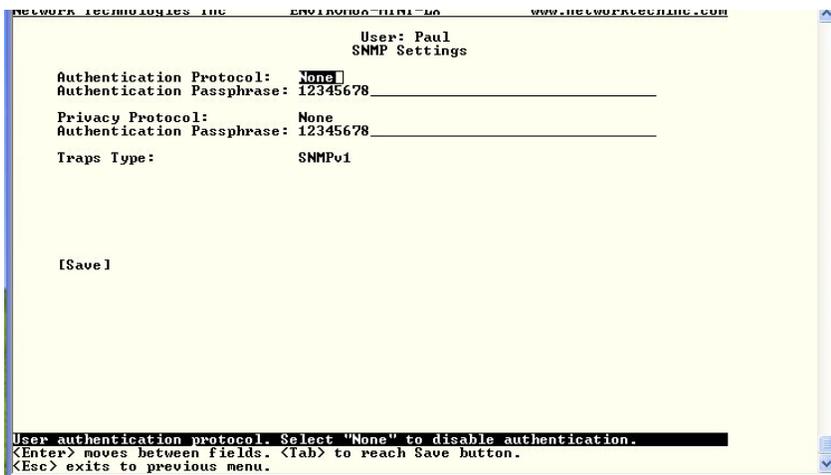


Figure 130- Text Menu-User SNMP Settings

Security settings can be configured within each user configuration if the SNMP protocol has been selected for use (page 85).

Settings	
Authentication Protocol	Choose between MD5 or SHA to require authentication, or none to disable it
Privacy Protocol	Choose between DES or AES to encrypt SNMP readings or traps or none to disable encryption. If encryption is enabled, then the Authentication Protocol must also be set at "MD5" or "SHA"
Authentication Passphrase	Assign the passphrase to be used to enable the receipt of SNMP messages
Privacy Passphrase	Assign the passphrase to be used to open and read readings or alert messages received via SNMP

After changing any settings in the user profile, press "Apply".

If any changes are made to the user's SNMP Settings, the ENVIROMUX must be rebooted (page 50) before they will take effect. If other users' settings need to be changed, the reboot can be done after all users' settings are complete.

## RESET BUTTON

A System Reset push-button is on the front-panel and is recessed from the panel to prevent accidental use of the button. Pressing the System Reset button will cause the ENVIROMUX to restart, just as if it were power-cycled. A momentary press of the System Reset push-button will activate this function. The reset button can be used at any time.

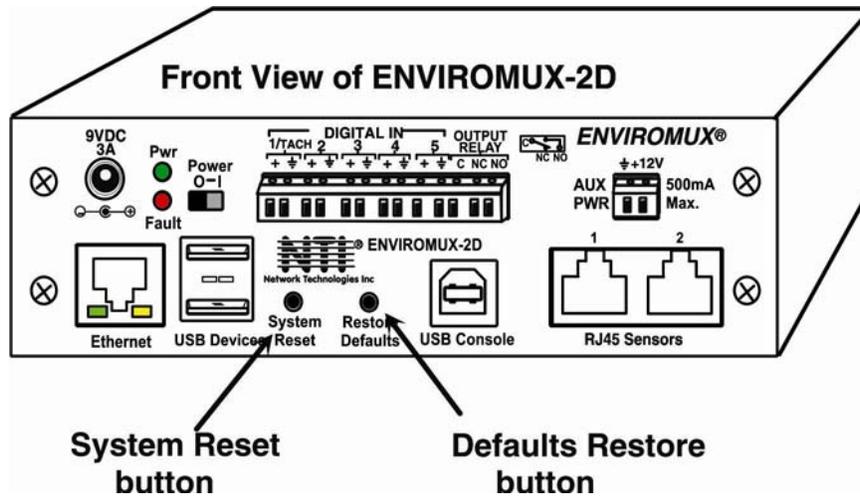


Figure 131- Location of Reset button

## RESTORE DEFAULTS BUTTON

Another button, “Restore Defaults”, is located on the front of the ENVIROMUX-2D (see Figure 131). The button can be used to clear all configuration changes and restore the ENVIROMUX to default settings including the administrative password. To use this button, press it with a pen or other small pointed object and hold it for 5 seconds. The ENVIROMUX will reboot and be ready for login within its usual start-up time period. If possible, consider saving the ENVIROMUX configuration before using this button (page 36).

## USB PORTS

The ENVIROMUX are each equipped with USB Type A female ports for connection of a USB flash drive, a GSM modem for receiving alert messages via SMS, or an ENVIROMUX-LCD7U USB LCD Monitor (page 15).

- The ports are compatible with USB 2.0 Full Speed flash drives. When enabled (page 60) and with the USB flash drive connected, the Event and Data Logs will be written to a text file on the flash drive in addition to the memory in the ENVIROMUX.
- When a modem is connected (page 15), it will automatically be sensed by the ENVIROMUX (page 38).
- When a USB LCD monitor is connected, and a selection is made as to what will be viewed on the monitor (page 37), the ENVIROMUX will automatically send video to the connected monitor.

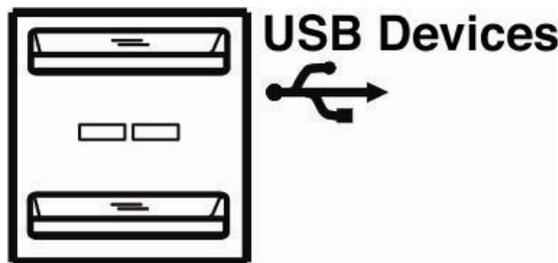


Figure 132- USB ports for Flash Drive, GSM modem, and/or LCD Monitor

## HOW TO SETUP EMAIL

Use this guide to assist in the configuration of the ENVIROMUX to send email messages.

1. Apply a valid email address for the ENVIROMUX to the Enterprise Setup Page (see page 38).

### Enterprise Configuration

Enterprise Settings	
Enterprise Name	<input type="text" value="Server Room E-MINI-LX"/> Name to identify this unit
Location	<input type="text" value="NTI"/> Location/Address
Contact	<input type="text" value="Sales"/> Contact person
Phone	<input type="text" value="330-555-5555"/> Phone number of contact person
E-mail	<input type="text" value="NTI@Gmail.com"/> E-mail address for messages sent from this unit

**Note:** When authentication is required (check your email server requirements) the Username and Password applied on the Network Configuration page must be for the user's email address applied in the Enterprise Setup Page. If no authentication is required, the Username and Password fields can be left empty.

### Network Configuration

+ IPv4 Settings	
+ IPv6 Settings	
- SMTP Settings	
SMTP Server	<input type="text" value="smtp.gmail.com"/> SMTP server used when sending e-mails
Port	<input type="text" value="587"/> SMTP server port
Use SSL	<input type="checkbox"/> SMTP server requires the use of SSL
Use STARTTLS	<input checked="" type="checkbox"/> SMTP server requires the use of STARTTLS
Use Authentication	<input checked="" type="checkbox"/> SMTP server requires authentication to send e-mail
Username	<input type="text" value="user@gmail.com"/> Username for sending e-mails
Password	<input type="password" value="••••••••"/> Password for sending e-mails

Figure 133- Example of configuration for Gmail server

2. Fill in Network Page (page 39) with valid information:

- A. SMTP Server - check with your service provider as to what this should be. Sometimes it is just the name of the provider (gmail.com), sometimes characters are added (mail.gmail.com, smtp.gmail.com, smtp-mail.gmail.com, etc)
- B. The default port is 25. If authentication is required, a different port number may be required. Check with your service provider.
- C. Check "Use SSL" if your SMTP server requires SSL, or "Use STARTTLS" if it requires TLS.
- D. Check "Use Authentication" if SMTP server requires authentication to send emails.
  - a. If required, Enter "Username" and "Password" that has been assigned to ENVIROMUX. Make sure they apply to the email address applied in the Enterprise Setup Page.

**Example:** `username@gmail.com` Most servers (not all, check with your service provider) use just the characters in front of the "@" for your Username on the account. These, and only these characters should be entered into the "Username" block.

**Note:** Passwords are case sensitive. Be sure to apply the password exactly as it is required by the server.

- 3. Verify User is configured to receive notifications for at least one sensor group as well as having "E-Mail Alerts" selected and a valid E-Mail address to send the notifications to entered.

### Configure User

<b>Account Settings</b>	
<b>Group Settings</b>	
Group 1	<input checked="" type="checkbox"/> User receives notifications for Group 1
Group 2	<input type="checkbox"/> User receives notifications for Group 2
Group 3	<input type="checkbox"/> User receives notifications for Group 3
Group 4	<input type="checkbox"/> User receives notifications for Group 4
Group 5	<input type="checkbox"/> User receives notifications for Group 5
Group 6	<input type="checkbox"/> User receives notifications for Group 6
Group 7	<input type="checkbox"/> User receives notifications for Group 7
Group 8	<input type="checkbox"/> User receives notifications for Group 8
<b>Contact Settings</b>	
E-mail Alerts	<input checked="" type="checkbox"/> User receives alerts via e-mail
Brief E-mail	<input checked="" type="checkbox"/> User receives brief e-mail
E-mail Address	<input type="text" value="User@Gmail.com"/> E-mail address for the user
Syslog Alerts	<input type="checkbox"/> User receives alerts via syslog
SNMP Traps	<input type="checkbox"/> User receives alerts via SNMP traps
Syslog/SNMP IP Address	<input type="text"/> IP address where syslog messages/SNMP traps are sent for this user
SMS Alerts	<input type="checkbox"/> User receives alerts via SMS
SMS Number	<input type="text"/> Phone number where SMS messages are sent for this user


Figure 134- Configure user to receive alerts via email

## WIRING METHODS

### PC-to ENVIROMUX Crossover Cable

In order to make a direct connection between a PC and the ETHERNET connector of the ENVIROMUX, a crossover cable must be used. The cable is made with CAT5 cable terminated with RJ45 connectors and wired according to the chart below.

Pin assignment at Standard End	Wire Color	Pin assignment at Crossed End
1	White/Orange	3
2	Orange	6
3	White/Green	1
4	Blue	4
5	White/Blue	5
6	Green	2
7	White/Brown	7
8	Brown	8

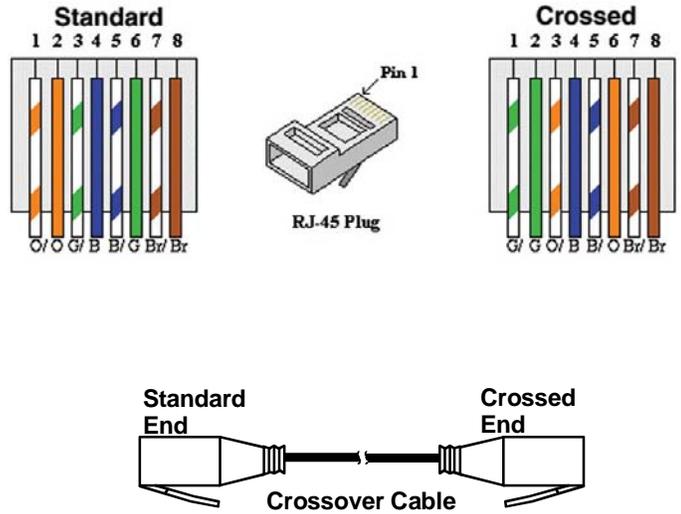

## TECHNICAL SPECIFICATIONS

<b>Ports</b>	
Temperature/Humidity Inputs	Two female RJ45 connectors for connecting temperature sensors, humidity sensors, and/or combined temperature/humidity sensors.
Max. Sensor Cable Length	Temperature and Humidity Sensors- 25 feet Liquid and Contact Sensors- 1000 feet
DIGITAL IN Dry Contact Closures	Five screw terminal pairs for connecting dry contact devices and liquid detection sensors. <ul style="list-style-type: none"> <li>* Potential-free.</li> <li>* Output voltage: +5 V DC</li> <li>* Current limited to 10 mA</li> <li>* Maximum contact resistance: 10K Ohm</li> </ul>
Ethernet Port	One female RJ45 connector with LEDs. 10 BaseT Ethernet interface.
USB Console Port	Virtual Serial Port- USB Type B female connector
USB Devices Ports	Two female USB Type A connector Supports USB 2.0 Full Speed
Output Relay	SPDT relay- contacts rated for up to 1A, 30VDC or 0.5A, 125VAC
Aux Pwr	contacts rated for 12VDC, maximum 500mA
<b>Environmental</b>	
Operating temperature	32°F to 122°F (0°C to 50°C)
Storage temperature	-13°F to 149°F (-25°C to 65°C)
Operating and Storage Relative Humidity	17 to 90% non-condensing RH
<b>General</b>	
Compatible Modems	ENVIROMUX-GSM-3GU (NetComm N3GS003)
Protocols	HTTP, HTTPS,SNMP, SMTP, TCP/IP, UDP, Xmodem, SSHv2, SSLv3, IP Filtering, LDAPv3, AES 256-bit encryption, SNMPv1,v2c,v3
Power Supply	120VAC or 240VAC at 50 or 60Hz-9VDC/3A AC Adapter
Dimensions WxDxH (in.)	5.82x3x1.73
Approvals	RoHS

## TROUBLESHOOTING

Each and every piece of every product produced by Network Technologies Inc is 100% tested to exacting specifications. We make every effort to insure trouble-free installation and operation of our products. If problems are experienced while installing this product, please look over the troubleshooting chart below to see if perhaps we can answer any questions that arise. If the answer is not found in the chart, a solution may be found in the knowledgebase on our website at <http://information.networktechinc.com/jive/kbindex.jspa> or please call us directly at (800) 742-8324 (800-RGB-TECH) or (330) 562-7070 and we will be happy to assist in any way we can.

Problem	Cause	Solution
Cannot connect via telnet	telnet service not enabled	Enable telnet (page 41)
Cannot connect via web interface- no login screen	<ul style="list-style-type: none"> <li>wrong IP address</li> <li>HTTP not enabled</li> <li>HTTP moved from default (port 80)</li> </ul>	<ul style="list-style-type: none"> <li>Use Discovery Tool to locate configured IP address (page 18)</li> <li>Enable HTTP (page 39)</li> <li>Identify port number assigned (page 39)</li> </ul>
Cannot get Discovery Tool to work	Java not installed	Java Runtime Environment must be installed before the Discovery Tool can be used (page 18)
LDAP user cannot login	Login username and/or password does not match same in ENVIROMUX user list	Make sure the username and password used in the LDAP server matches the username and password in the ENVIROMUX user configuration (page 42)
Cannot login	cannot remember root password	Either restore default settings (page 36 or 81) or contact NTI for assistance

### SMTP Error Codes:

Without SSL enabled:	Meaning	Comments
-1	SMTP_CONN_ERR,	Cannot establish a connection to the SMTP server. Possible reasons: bad setting for IP of SMTP server, firewall blocking the connection
-4	SMTP_SERVER_NOT_READY_ERR,	Server denied connection
-5	SMTP_EHLO_ERR,	Server did not answer to HELO command
-6	SMTP_AUTH_NO_SUPPORT_ERR,	Authentication method is not supported
-7	SMTP_AUTH_FAILURE_ERR,	Authentication failure (user or password rejected)
-8	SMTP_BAD_FROM_ERR,	SMTP Server did not accept the sender e-mail address
-9	SMTP_BAD_TO_ERR,	SMTP Server did not accept the destination e-mail address
-10	SMTP_DATA_ERR,	SMTP Server did not accept the DATA command
-11	SMTP_BAD_DATA_ERR,	SMTP Server did not accept the body of e-mail message
With SSL enabled:		
-100	SMTP_SSL_CONN_ERR,	Cannot establish a connection to the SMTP server. Possible reasons: bad setting for IP of SMTP server, firewall blocking the connection
-99	SMTP_SSL_CONN_ERR1,	
-98	SMTP_SSL_CONN_ERR2,	
-97	SMTP_SSL_PROTOCOL_ERR,	SMTP server connected but did not accept SSL connection
-95	SMTP_SSL_SERVER_NOT_READY_ERR,	Server denied connection
-94	SMTP_SSL_EHLO_ERR,	Server did not answer to HELO command
-93	SMTP_SSL_AUTH_NO_SUPPORT_ERR,	Authentication method is not supported
-92	SMTP_SSL_AUTH_FAILURE_ERR,	Authentication failure (user or password rejected)
-91	SMTP_SSL_BAD_FROM_ERR,	SMTP Server did not accept the sender e-mail address
-90	SMTP_SSL_BAD_TO_ERR,	SMTP Server did not accept the destination e-mail address
-89	SMTP_SSL_DATA_ERR,	SMTP Server did not accept the DATA command
-88	SMTP_SSL_BAD_DATA_ERR,	SMTP Server did not accept the body of e-mail message

## INDEX

- AC adapter, 14
- acknowledge, 22, 27, 66, 67, 99
- Administration**, 35, 58
- authentication, 91
- AUX PWR, 7
- connect sensors, 4
- console port connect, 62
- crossover cable, 107
- data log-view, 59, 95
- DC Power Alert**, 34
- default IP address, 19
- Device Discovery Tool, 18
- DHCP server**, 39
- dismiss, 22, 27, 66, 67, 99
- download configuration, 36
- downloads, 61
- drivers-USB**, 8
- dry-contact sensors, 4
- email setup, 105
- enterprise configuration, 38, 82
- Ethernet connection, 7
- event and data logs, 94
- event log-view, 58, 94
- event settings, 52
- firmware update-web, 49
- flash drive, 104
- groups, 26
- GSM modem, 15, 17
- HTTP Server Port, 41, 85
- IP Cameras, 33, 79
- IP devices-configure, 30, 74
- IP devices-monitor, 29
- IP devices-view, 67
- IP filtering, 47, 92
- Java Runtime Environment**, 18
- Language selection**, 37
- LDAP mode, 46
- LEDs-front panel**, 14
- liquid detection sensor, 5
- log in, 19
- log settings, 95
- log settings-configure, 59
- log to flashdrive, 60
- login-web interface, 19
- monitoring-text menu, 65
- monitoring-web interface, 21
- Network configuration, 82
- Network Configuration**, 39
- output relay**, 6, 31, 77
- overview, 16
- Password**, 19
- port number, 41
- reboot, 97
- reboot, 50
- reset button, 104
- restore defaults, 36, 81
- security, 46
- security configuration, 90
- sensors-configure**, 68, 71
- sensors-view, 66
- service settings, 85
- setup email, 105
- smart alerts**, 51
- SMTP server, 41, 83
- SNTP server, 36
- SSH, 63
- Summary page**, 20
- system configuration, 35, 80
- system information, 48, 97
- Telnet, 63
- text menu navigation, 65
- text menu-login, 62
- text menu-non-admin, 98
- threshold, 25, 69
- time settings, 80
- troubleshooting, 109
- USB Console port**, 8
- USB Flashdrive**, 60
- USB LCD monitor**, 37
- USB port, 104
- user configuration, 42, 86
- username and password, 19
- web browsers supported, 2

## WARRANTY INFORMATION

The warranty period on this product (parts and labor) is two (2) years from the date of purchase. Please contact Network Technologies Inc at **(800) 742-8324** (800-RGB-TECH) or **(330) 562-7070** or visit our website at <http://www.networktechinc.com> for information regarding repairs and/or returns. A return authorization number is required for all repairs/returns.

MAN145 Rev. 9/21/12